



DESIGN REFERENCE GUIDE

Existing Non-Residential Building

Version 3.0


1ST October 2015

Contents

1. Certification Process	1
2. GreenRE Award Rating	3
3. GreenRE Assessment	4
3.1 Framework	4
3.2 Credits Allocation	5
3.3 Prerequisite Requirements	6
3.4 Existing Non-Residential Building Criteria	8
4. Documentation Requirements	76

1. Certification Process

The GreenRE Existing Non-Residential Building Certification process is as follows:

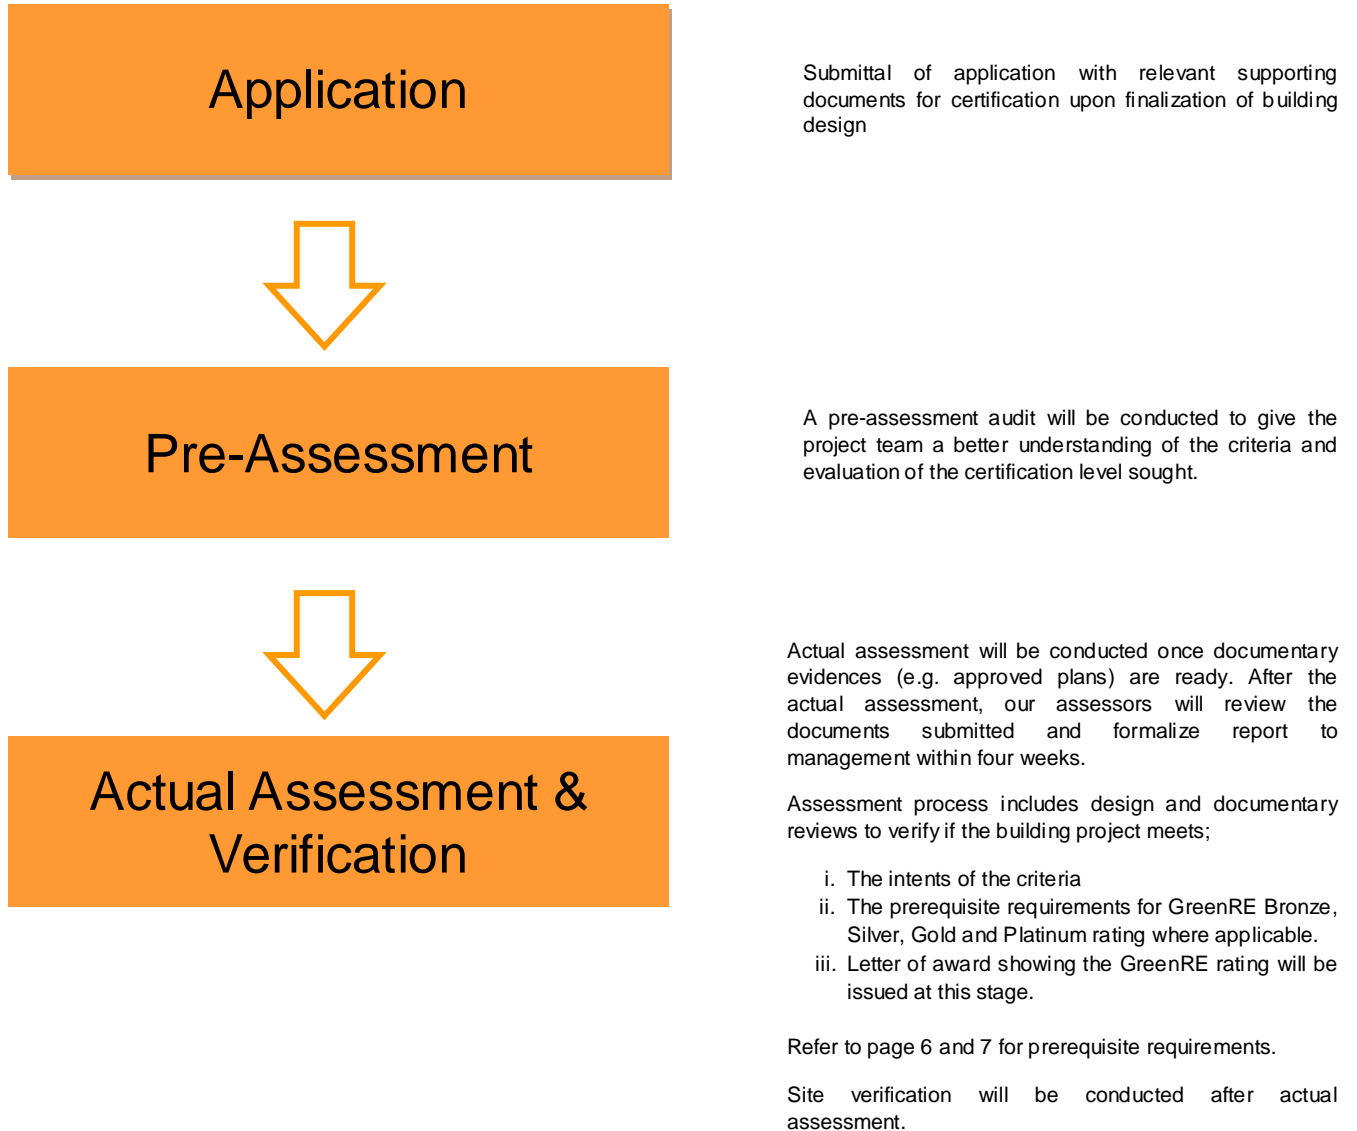

GreenRE assessment criteria consist of six (6) environmental impact categories namely:

- (a) Part 1 – Energy Efficiency: This category focuses on the approach that can be used in the building design and system selection to optimise the energy efficiency of buildings.
- (b) Part 2 – Water Efficiency: This category focuses on the selection of fittings and strategies enabling water use efficiency during construction and building operation.
- (c) Part 3 – Sustainable Operation & Management: This category focuses on the sustainability of operation and management that would reduce the environmental impacts upon building operation.
- (d) Part 4 – Indoor Environmental Quality: This category focuses on the design strategies that would enhance the indoor environmental quality which include air quality, thermal comfort, acoustic control and daylighting.
- (e) Part 5 – Other Green Features: This category focuses on the adoption of green practices and new technologies that are innovative and have potential environmental benefits.
- (f) Part 6 – Carbon Emission of Development: This category focuses on the use of carbon calculator to calculate the carbon emission of the development.

These environment impact categories are broadly classified under two main groupings namely (I) Energy Related Requirements and (II) Other Green Requirements.

Energy Related Requirements consist of Part 1- Energy Efficiency where credits are allocated for the various energy efficient designs, practices and features used. A minimum of 30 credits must be obtained from this group to be eligible for certification. The number of points achievable for this group is capped at 50 points (exclude 15 bonus points that are obtainable under ENRB 1-10 – Renewable Energy).

Other Green Requirements consist of Part 2 – Water Efficiency; Part 3 – Sustainable Operation & Management; Part 4 – Indoor Environmental Quality; Part 5 – Other Green Features and Part 6: Carbon Emission of Development. Credits are allocated for the water efficient features, environmentally friendly design practices, innovative green features used and carbon emission of development. A minimum of 20 credits must be obtained from this group to be eligible for certification. The number of points achievable for this group is also capped at 50 points.

The maximum GreenRE score achievable for a project is capped at 100 points and this does not include 15 bonus points that are obtainable under Energy Related Requirements if a project uses renewable energy sources.


Under the non-residential building criteria, the environmental impact category Part 1 – Energy Efficiency applies to both air-conditioned and non air-conditioned spaces. Where there is a combination of air-conditioned and non air-conditioned spaces, the points allocated are to be prorated in accordance with the respective floor areas. For simplicity, points applicable to air-conditioned areas are accounted only if the aggregate air-conditioned areas exceed 500 m². Similarly, points applicable to non air-conditioned areas are accounted only if the aggregate non air-conditioned areas are more than 10% of the total floor areas excluding carparks.

2. GreenRE Award Rating

Score	Rating
90 and above	GreenRE Platinum
85 to < 90	GreenRE Gold
75 to < 85	GreenRE Silver
50 to < 75	GreenRE Bronze

3. GreenRE Assessment

3.1 Framework

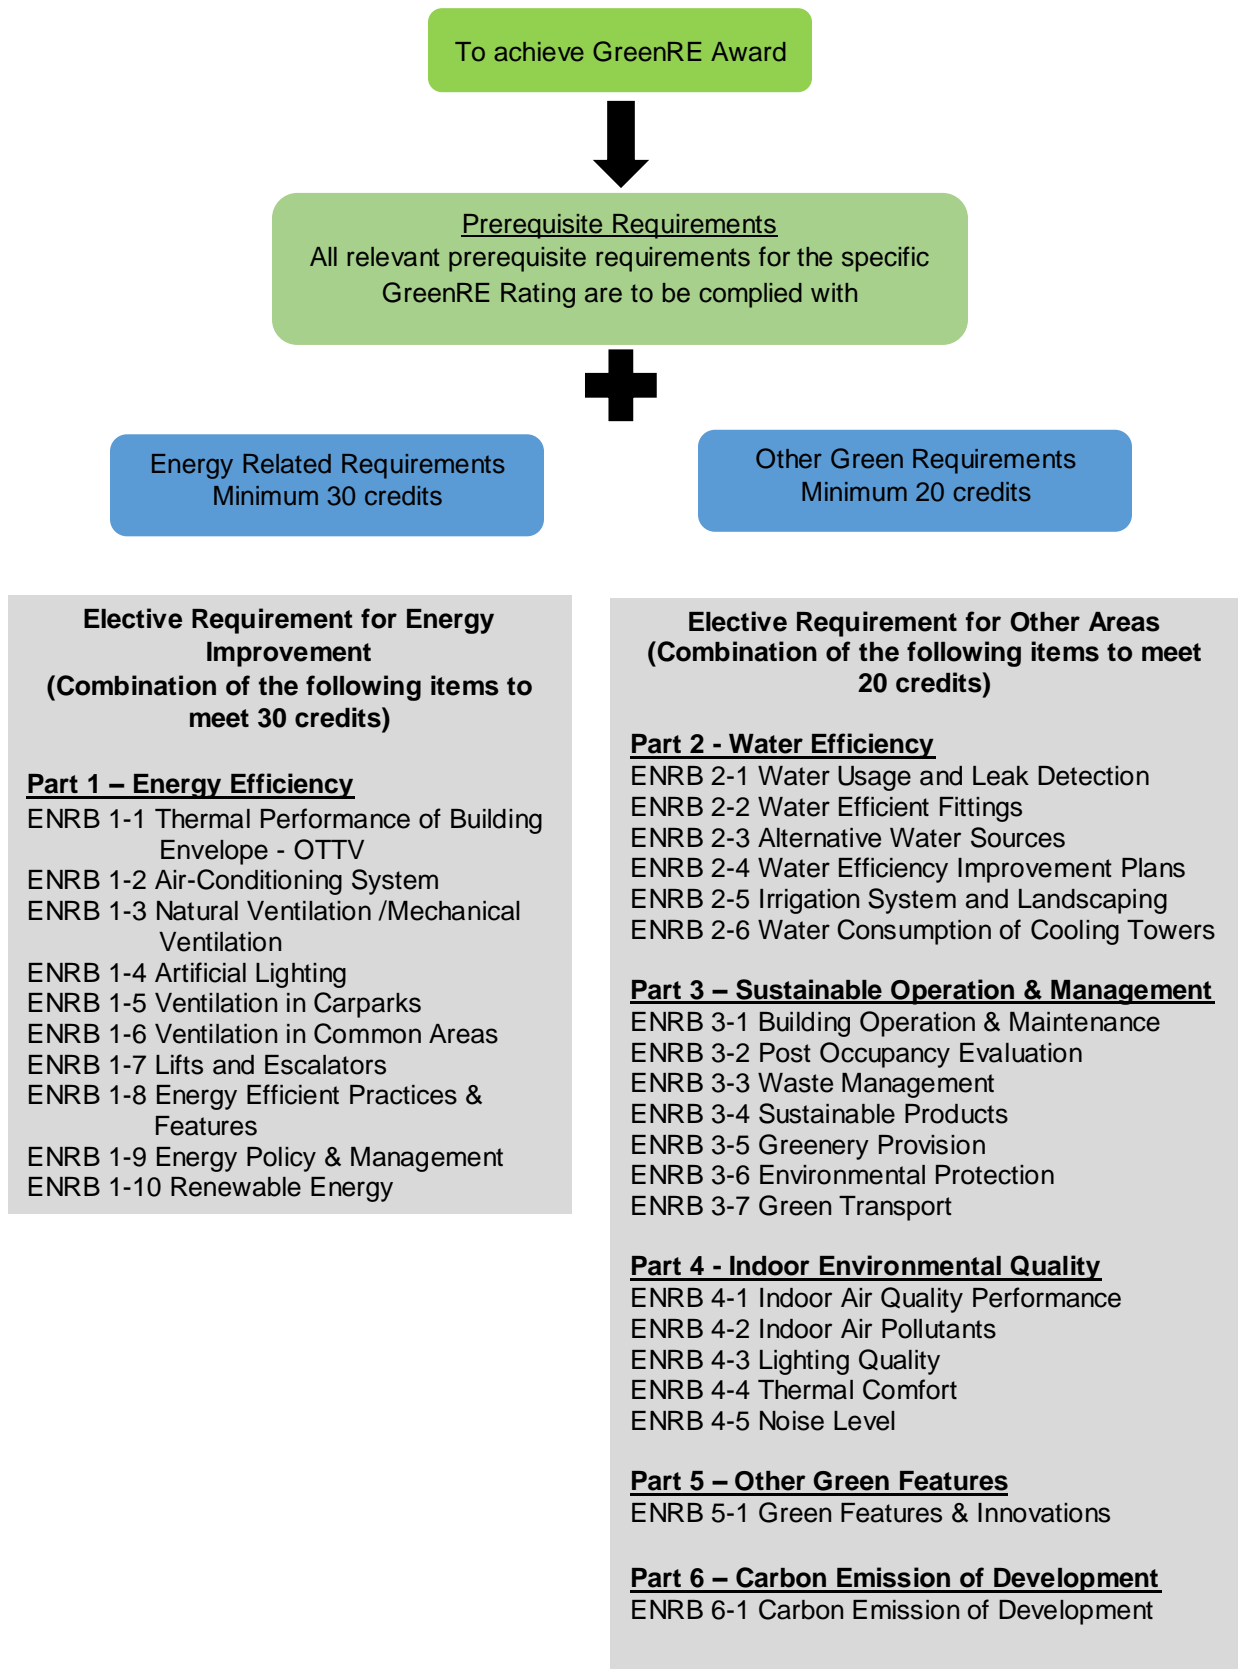

3.2 Credit Allocation

Category		Credit allocation	
(I) Energy Related Requirements			
Minimum 30 credits	Part 1: Energy Efficiency		
	ENRB 1-1 Thermal Performance of Building Envelope-OTTV	5	
	ENRB 1-2 Air-Conditioning System (applicable to air-conditioned areas)	32	
	ENRB 1-3 Natural Ventilation / Mechanical Ventilation (applicable to non air-conditioned areas excluding carpark and common areas)		
	ENRB 1-4 Artificial Lighting	13	
	ENRB 1-5 Ventilation in Carpark	4	
	ENRB 1-6 Ventilation in Common Areas	5	
	ENRB 1-7 Lifts & Escalators	3	
	ENRB 1-8 Energy Efficient Practices & Features	12	
	ENRB 1-9 Energy Policy & Management	1	
	ENRB 1-10 Renewable Energy	15	
Category Score for Part 1 – Energy Efficiency		90	
(II) Other Green Requirements			
Minimum 20 credits	Part 2: Water Efficiency		
	ENRB 2-1 Water Usage and Leak Detection System	4	
	ENRB 2-2 Water Efficient Fittings	12	
	ENRB 2-3 Alternative Water Sources	3	
	ENRB 2-4 Water Efficiency Improvement Plans	1	
	ENRB 2-5 Irrigation System and Landscaping	3	
	ENRB 2-6 Water Consumption of Cooling Towers	2	
	Category Score for Part 2 – Water Efficiency		25
	Part 3: Sustainable Operation & Management		
	ENRB 3-1 Building Operation & Maintenance	4	
	ENRB 3-2 Post Occupancy Evaluation	3	
	ENRB 3-3 Waste Management	7	
	ENRB 3-4 Sustainable Products	8	
	ENRB 3-5 Greenery Provision	8	
	ENRB 3-6 Environmental Protection	3	
	ENRB 3-7 Green Transport	4	
	Category Score for Part 3 – Sustainable Operation & Management		37
	Part 4: Indoor Environmental Quality		
	ENRB 4-1 Indoor Air Quality Performance	8	
	ENRB 4-2 Indoor Air Pollutants	2	
ENRB 4-3 Lighting Quality	5		
ENRB 4-4 Thermal Comfort	2		
ENRB 4-5 Internal Noise Level	1		
Category Score for Part 4: Indoor Environmental Quality		18	
Part 5: Other Green Features			
ENRB 5-1 Green Features & Innovations	10		
Category Score for Part 5: Other Green Features		10	
Part 6: Carbon Emission of Development			
ENRB 6-1 Carbon Emission of Development	4		
Category Score for Part 6: Carbon Emission of Development		4	
Category Score for Part 2 to Part 6 - Other Green Requirements		94	
GreenRE Existing Non-Residential Building Score		184	

3.3 Prerequisite Requirements

PART 1 – ENERGY EFFICIENCY

1. ENERGY EFFICIENCY

GreenRE Rating	Minimum credits achievement from Part 1 – Energy Efficiency
GreenRE Bronze	30 credits
GreenRE Silver	35 credits
GreenRE Gold	40 credits
GreenRE Platinum	45 credits

2. MINIMUM SYSTEMS' EFFICIENCY

Minimum Design System Efficiency/Operating System Efficiency (DSE/OSE)

(i) For buildings using Water-Cooled Chilled Water Plant

GreenRE Rating	Building Cooling Load (RT)	
	< 500	≥ 500
	Efficiency (kW/RT)	
Bronze	0.85	0.75
Silver	0.80	0.70
Gold	0.75	0.68
Platinum	0.70	0.65

(ii) For buildings using Air-Cooled Chilled Water Plant or Unitary Air-Conditioner

GreenRE Rating	Building Cooling Load (RT)	
	< 500	≥ 500
	Efficiency (kW/RT)	
Bronze	1.1	1.0
Silver	1.0	Not applicable
Gold	0.85	
Platinum	0.78	

For building with building cooling load of more than 500RT, the use of air cooled central chilled water plant or other unitary air-conditioners are not applicable for Silver and higher ratings.

Note: The performance of the overall air-conditioning system for the building is based on the Operating System Efficiency (OSE) of the system during normal building operating hours as defined below:

<u>Office Building</u> Monday to Friday: 9am to 6pm <u>Retail Mall:</u> Monday to Sunday: 10am to 9pm <u>Institutional:</u> Monday to Friday: 9am to 5pm	<u>Hotel and Hospital:</u> 24-hour <u>Industrial and Other Building Types:</u> To be determined based on the operating hours
---	---

3. CHILLER PLANT M&V INSTRUMENTATION

- (i) Provision of permanent measuring instruments for monitoring of water-cooled chilled-water system and air-cooled chilled water system operating system efficiency. The installed instrumentation shall have the capability to calculate resultant plant operating system efficiency (i.e. kW/RT) within 5% of its true value and in accordance with ASHRAE Guide 22 and AHRI 550/590. Heat balance test for water-cooled chilled water system is required for verification of the accuracy of the Measurement and Verification (M&V) instrumentation.

4. NATURAL VENTILATION AREA (only applicable to occupied areas, excluding circulation, plant rooms and transit areas):

Prerequisite requirement for Platinum - At least 75% of natural ventilated areas with effective cross ventilation with North and South facing window opening

PART 4 - INDOOR ENVIRONMENTAL QUALITY

1. IAQ Audit - to conduct a full IAQ audit three yearly that complies with Code of Practice on Indoor Air Quality, Department of Occupational Safety and Health, Ministry of Human Resources Malaysia (2005). **[4 credits]** [ENRB 4-1(a)]

3.4 Existing Non- Residential Building Criteria

Part 1 – Energy Efficiency	GreenRE Credits								
<p><u>ENRB 1-1 THERMAL PERFORMANCE OF BUILDING ENVELOPE - OTTV</u></p> <p>Enhance the overall thermal performance of building envelope to minimize heat gain thus reducing the overall cooling load requirement.</p> <p><u>Baseline:</u> Maximum permissible OTTV = 50 W/m²</p>	<p>0.5 credits for every reduction of 1 W/m² in OTTV from the baseline of 50 W/m²</p> <p>Credit scored = 0.5 x (50 – OTTV)</p> <p>(Up to 5 credits)</p>								
<p><u>ENRB 1-2 AIR-CONDITIONING SYSTEM</u></p> <p>Applicable to Air-conditioned Building Areas (with an aggregate air-conditioned areas > 1000m²)</p> <p>Encourage the use of better efficiency air-conditioned equipment to minimize the energy consumption. (System efficiency in kW/ton)</p> <p><u>(a) Water-Cooled Chilled-Water Plant:</u></p> <ol style="list-style-type: none"> i. Water-Cooled Chiller ii. Chilled water pump iii. Condenser water pump iv. Cooling tower <table border="1" data-bbox="193 1339 767 1688"> <thead> <tr> <th rowspan="2">Baseline</th> <th colspan="2">Building Cooling Load</th> </tr> <tr> <th>< 500 RT</th> <th>≥ 500 RT</th> </tr> </thead> <tbody> <tr> <td><u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant</td> <td>0.85 kW/RT</td> <td>0.75 kW/RT</td> </tr> </tbody> </table> <p style="text-align: center;">OR</p>	Baseline	Building Cooling Load		< 500 RT	≥ 500 RT	<u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant	0.85 kW/RT	0.75 kW/RT	<p><u>(a) Water-Cooled Chilled-Water Plant:</u></p> <div style="border: 1px solid black; padding: 5px; text-align: center; margin: 10px 0;"> <p>Building cooling load < 500RT</p> </div> <p>14 credits for achieving plant efficiency of 0.85 kW/ton</p> <p>0.3 credit for every percentage improvement in the chiller plant efficiency better than 0.85 kW/ton</p> <p>Credit scored = 0.3 x (% improvement)</p> <div style="border: 1px solid black; padding: 5px; text-align: center; margin: 10px 0;"> <p>Building cooling load ≥ 500RT</p> </div> <p>14 credits for achieving plant efficiency of 0.75 kW/ton</p> <p>0.35 credit for every percentage improvement in the chiller plant efficiency better than 0.75 kW/ton</p> <p>Credit scored = 0.35 x (% improvement)</p> <p>(up to 20 credits)</p> <p style="text-align: center;">OR</p>
Baseline		Building Cooling Load							
	< 500 RT	≥ 500 RT							
<u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant	0.85 kW/RT	0.75 kW/RT							

(b) Air Cooled Chilled-Water Plant / Unitary Air-Conditioners:

Air cooled Chilled-Water Plant:

- Air-Cooled Chiller
- Chilled Water Pump

Unitary Air-Conditioners:

- Variable Refrigerant Flow (VRF) System
- Water-Cooled Package Unit
- Single-Split Unit
- Multi-Split Unit

Baseline	Building Cooling Load	
	< 500 RT	≥ 500 RT
<u>Prerequisite Requirements</u> Minimum system efficiency of air cooled chilled water plant or unitary conditioners	1.1 kW/RT	1.0 kW/RT

Note(1): Where there is a combination of centralised air-con system with unitary air-conditioned system, the computation for the credits scored will only be based on the air-conditioning system with a larger aggregate capacity.

(c) Air Distribution system:

- Air Handling units (AHUs)
- Fan Coil Units (FCUs)

Baseline – Fan power limitation in air conditioning system

Allowable nameplate motor power	
Constant volume	Variable volume
1.7 kW/m ³ /s	2.4 kW/m ³ /s

Note (2): For buildings using district cooling system, there is no need to compute the plant efficiency under Part 1-2 (a) and (b). The credits obtained will be pro-rated based on the air distribution system efficiency under Part 1-2(c).

(b) Air Cooled Chilled-Water Plant / Unitary Air-Conditioners:

Building cooling load < 500RT

14 credits for achieving plant efficiency of 1.1 kW/ton

0.2 credit for every percentage improvement in the chiller plant efficiency better than 1.1 kW/ton

Credit scored = 0.2 x (% improvement)

Building cooling load ≥ 500RT

14 credits for achieving plant efficiency of 1.0 kW/ton

0.25 credit for every percentage improvement in the chiller plant efficiency better than 1.0 kW/ton

Credit scored = 0.25 x (% improvement)

(up to 20 credits)

(c) Air Distribution system:

0.15 credits for every percentage improvement in the air distribution system efficiency over the baseline

Credits scored = 0.15 x (% improvement)

(up to 8 credits)

(d) *Prerequisite requirements:* Provision of permanent measuring instruments for monitoring of water-cooled chilled water plant and air-cooled chilled water plant efficiency. The installed instrumentation shall have the capability to calculate resultant plant efficiency (i.e. kW/RT) within 5% of its true value and in accordance with ASHRAE Guide 22 and AHRI 550/590. The following instrumentation and installation are also required to be complied:

- Location and installation of the measuring devices to meet the manufacturer's recommendation.
- Data acquisition system to have a minimum resolution of 16 bit.
- All data logging with capability to trend at 1minute sampling time interval.
- Dedicated digital power meters shall be provided for the following groups of equipment: chiller(s), chilled water pump(s), condenser water pump(s) and cooling tower(s).
- Flow meters to be provided for chilled-water and condenser water loop and shall be of ultrasonic / full bore magnetic type or equivalent.
- Temperature sensors are to be provided for chilled water and condenser water loop and shall have an end-to-end measurement uncertainty not exceeding $\pm 0.05^{\circ}\text{C}$ over entire measurement or calibration range. All thermo-wells shall be installed in a manner that ensures that the sensors can be in direct contact with fluid flow. Provisions shall be made for each temperature measurement location to have two spare thermo-wells located at both side of the temperature sensor for verification of measurement accuracy.

1 credit

(e) *Prerequisite requirements:* Verification of central water cooled chilled-water plant instrumentation: Heat Balance – substantiating test for water cooled chilled-water plant to be computed in accordance with AHRI 550/590. The operating system efficiency and heat balance to be submitted to GreenRE upon commissioning.

1 credit

<p>(f) Provision of variable speed controls for chiller plant equipment such as chilled-water pumps and cooling tower fans to ensure better part-load plant efficiency.</p> <p>(g) Sensors or similar automatic control devices are used to regulate outdoor air flow rate to maintain the concentration of carbon dioxide.</p> <p>Indoor carbon dioxide acceptable range ≤ 700 ppm above outdoor concentration.</p>	<p>1 credit</p> <p>1 credit</p>						
<p><u>ENRB 1-3 NATURAL VENTILATION / MECHANICAL VENTILATION</u></p> <p>Applicable to Non Air-Conditioned Building Areas (with an aggregate non air-conditioned areas > 10% of total floor area excluding carparks and common areas)</p> <p>(a) <u>Natural Ventilation</u> (only applicable to occupied areas, excluding circulation, plant rooms and transit areas)</p> <p>Encourage building that facilitates good natural ventilation. Proper design of building layout that utilises prevailing wind conditions to achieve adequate cross ventilation.</p> <p>(b) <u>Mechanical Ventilation</u> Encourage energy efficient mechanical ventilation system as the preferred ventilation mode to non-air-conditioning in buildings.</p> <p>Baseline: Fan power limitation in mechanical ventilation systems:</p> <table border="1" data-bbox="197 1619 746 1738"> <thead> <tr> <th colspan="2">Allowable nameplate motor power</th> </tr> <tr> <th>Constant volume</th> <th>Variable volume</th> </tr> </thead> <tbody> <tr> <td>1.7 kW/m³/s</td> <td>2.4 kW/m³/s</td> </tr> </tbody> </table> <p>Note(3): Where there is a combination of naturally ventilated and mechanical ventilated spaces, the credits scored will only be based on the predominant ventilation modes of normally occupied spaces.</p>	Allowable nameplate motor power		Constant volume	Variable volume	1.7 kW/m ³ /s	2.4 kW/m ³ /s	<p>20 based credits will be awarded for use of natural ventilation</p> <p>1.2 credits for every 10% of NV areas with window openings facing north and south directions and cross ventilation</p> <p>(Up to 32 credits)</p> <p>0.6 credit for every subsequent 1% improvement from the baseline</p> <p>(Up to 32 credits)</p>
Allowable nameplate motor power							
Constant volume	Variable volume						
1.7 kW/m ³ /s	2.4 kW/m ³ /s						

<p><u>ENRB 1-4 ARTIFICIAL LIGHTING</u></p> <p>Encourage the use of energy efficient lighting to minimize energy consumption from lighting usage while maintaining proper lighting level.</p> <p><u>Baseline:</u> Luminance level stated in MS 1525:2014–Energy Efficient and use of renewable energy for non-residential building - Code of Practice</p>	<p>0.3 credit for every percentage improvement in lighting power budget</p> <p>Credit scored = 0.3 x (% improvement) (Up to 13 credits)</p> <p>Excluding tenant lighting provision – (Up to 5 credits)</p>
<p><u>ENRB 1-5 VENTILATION IN CARPARKS</u></p> <p>Encourage the use of energy efficient design and control of ventilation systems in carparks.</p> <p>(a) Carparks designed with natural ventilation.</p> <p>(b) CO sensors are used to regulate the demand for mechanical ventilation (MV)</p> <p>Note (4): Where there is a combination of different ventilation mode adopted for carpark design, the credits obtained will be prorated accordingly.</p>	<p>Naturally Ventilated Carparks – 4 credits</p> <p>Credits scored based on the mode of mechanical ventilation provided:</p> <p>Fume extract – 2.5 credits MV with or without supply – 2 credits</p> <p>(Up to 4 credits)</p>
<p><u>ENRB 1-6 VENTILATION IN COMMON AREAS</u></p> <p>Encourage the use of energy efficient of ventilation systems in the following common areas:</p> <ul style="list-style-type: none"> • Toilets • Staircases • Lift Lobbies • Corridors • Atriums 	<p>Extent of Coverage: At least 90% of each applicable area</p> <p>Credit scored based on the mode of ventilation provided in the applicable areas</p> <p>Natural Vent. – 1.5 credits for each area Mechanical Vent. – 0.5 credit for each area</p> <p>(Up to 5 credits)</p>
<p><u>ENRB 1-7 LIFTS AND ESCALATORS</u></p> <p>Encourage the use of energy efficient lifts and escalators.</p> <p>(a) Lifts with the following energy efficient features:</p> <ol style="list-style-type: none"> i. AC variable voltage and variable frequency (VVVF) motor drive or equivalent. ii. Sleep mode features or equivalent. <p>(b) Escalators with energy efficient features such as motion sensors.</p>	<p>Extent of Coverage: All lifts and/or escalators</p> <p>1 credit</p> <p>1 credit</p> <p>1 credit</p>

<p><u>ENRB 1-8 ENERGY EFFICIENT PRACTICES & FEATURES</u></p> <p>Encourage the use of energy efficient practices and features which are innovative and/or have positive environmental impact.</p> <p>(a) Computation of the energy consumption in the form of energy efficiency index (EEI)</p> <p>(b) Use of energy efficiency product that are certified by approved local certification body</p> <p>(c) Use of energy efficient features Example:</p> <ul style="list-style-type: none"> • Re-generative lift • Heat recovery system • Motion sensors • Sun pipes • Light shelves • Photocell sensors to maximize the use of Daylight • Heat pumps, etc. 	<p>1 credit</p> <p>0.5 credit for each equipment type (Up to 2 credits)</p> <p>2 credits for every 1% energy saving over the total building energy consumption (Up to 9 credits)</p>
<p><u>ENRB 1-9 ENERGY POLICY AND MANAGEMENT</u></p> <p>(a) Energy policy, energy targets and regular review with top management's commitment as part of an environmental strategy</p> <p>(b) To show intent, measures and implementation strategies of energy efficiency improvement plans to achieve energy target set over the next three years. Committed energy savings accrued from proposed measures should be quantified.</p>	<p>0.5 credit</p> <p>0.5 credit</p>

ENRB 1-10 RENEWABLE ENERGY

Encourage the application of renewable energy sources in buildings.

Credit scored based on the expected energy efficiency index (EEI) and % replacement of electricity by renewable energy source

Energy Efficiency Index (EEI)	Every 1% replacement of electricity (based on total electricity consumption) by renewable energy source	
	Include tenant's usage	Exclude tenant's usage
≥ 50 kWh/m ² /yr	5 credits	3 credits
< 50 kWh/m ² /yr	3 credits	1.5 credits

(Up to 15 credits)

PART 1 – ENERGY EFFICIENCY CATEGORY SCORE:

$$\begin{aligned}
 & (\text{ENRB 1-2}) \times \frac{\text{Air-conditioned Building Floor Area}}{\text{Total Floor Area}} \\
 & \quad + \\
 & (\text{ENRB 1-3}) \times \frac{\text{Non Air-Conditioned Building Floor Area}}{\text{Total Floor Area}} \\
 & \quad + \\
 & (\text{ENRB 1-1, ENRB 1-4 to ENRB 1-10})
 \end{aligned}$$

Where :

ENRB 1-2 = Total GreenRE credits obtained under ENRB 1-2

ENRB 1-3 = Total GreenRE credits obtained under ENRB 1-3

ENRB 1-1, ENRB 1-4 to ENRB 1-10
= Total GreenRE credits obtained under ENRB 1-1, ENRB 1-4 to ENRB 1-10

Part 2 – Water Efficiency	GreenRE Credits									
<p><u>ENRB 2-1 WATER USAGE AND LEAK DETECTION</u></p> <p>Provide sub-metering and leak detection system for better control and monitoring</p> <p>(a) To monitor the water consumption on monthly basis</p> <p>(b) Provision of sub-meters for major water uses (e.g. cooling tower, water features, irrigation, swimming pools, tenants' usage)</p> <p>(c) Provision of automated / smart metering for monitoring and leaking detection</p>	<p>1 credit</p> <p>1 credit</p> <p>2 credits</p>									
<p><u>ENRB 2-2 WATER EFFICIENT FITTINGS</u></p> <p>Encourage the use of water efficient fittings under Water Efficiency Product Labelling Scheme (WEPLS) or Water Efficiency Labelling Scheme (WELS).</p> <ul style="list-style-type: none"> • Basin taps and mixers • Showers • Sink/Bib taps and mixers • Urinals and Urinal Flush Valves • Dual flushing cistern for WC • Other water fittings (eg. Ablution taps and mixers) 	<table border="1" data-bbox="831 999 1402 1236"> <thead> <tr> <th colspan="3">Weightage Based on Water Efficiency Products Labelling Scheme (WEPLS)</th> </tr> <tr> <th>Efficient *</th> <th>Highly Efficient **</th> <th>Most Efficient ***</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">6</td> <td style="text-align: center;">9</td> <td style="text-align: center;">12</td> </tr> </tbody> </table> <p>Credits scored based on the number and water efficiency rating of the fitting type used</p> <p style="text-align: center;">(Up to 12 credits)</p>	Weightage Based on Water Efficiency Products Labelling Scheme (WEPLS)			Efficient *	Highly Efficient **	Most Efficient ***	6	9	12
Weightage Based on Water Efficiency Products Labelling Scheme (WEPLS)										
Efficient *	Highly Efficient **	Most Efficient ***								
6	9	12								
<p><u>ENRB 2-3 ALTERNATIVE WATER SOURCES</u></p> <p>Use of suitable systems that utilize alternative water sources for non-potable uses: irrigation, washing, water features, toilet flushing, etc (excluding cooling tower make up water) to reduce use of potable water. Alternative sources can include rainwater, greywater (for toilet flushing only), AHU condensate and recycled water from approved sources.</p>	<p>Credits awarded based on % reduction in total potable water usage of the applicable uses</p> <table border="1" data-bbox="831 1794 1402 1917"> <tbody> <tr> <td style="text-align: center;">> 50 %</td> <td style="text-align: center;">3 credits</td> </tr> <tr> <td style="text-align: center;">≥ 10 % to 50 %</td> <td style="text-align: center;">2 credits</td> </tr> <tr> <td style="text-align: center;">< 10 %</td> <td style="text-align: center;">1 credit</td> </tr> </tbody> </table> <p style="text-align: center;">(Up to 3 credits)</p>	> 50 %	3 credits	≥ 10 % to 50 %	2 credits	< 10 %	1 credit			
> 50 %	3 credits									
≥ 10 % to 50 %	2 credits									
< 10 %	1 credit									

<p><u>ENRB 2-4 WATER EFFICIENCY IMPROVEMENT PLANS</u></p> <p>Targets to improve building water performance against own building water performance baseline should be set. To show intent, measures and implementation strategies of water efficiency improvement plans over the next three years. Committed water savings accrued from proposed measures should be quantified.</p>	<p>1 credit</p>
<p><u>ENRB 2-5 IRRIGATION SYSTEM AND LANDSCAPING</u></p> <p>Reduce potable water consumption for irrigation and landscaping.</p> <p>(a) Use of non-potable water including rainwater for landscape irrigation</p> <p>(b) Use of automatic water efficient irrigation system with rain sensor, soil moisture sensor or equivalent control system.</p> <p>(c) Use of drought tolerant plants that require minimal irrigation.</p>	<p>1 credit</p> <p>Extent of Coverage: At least 50% of the landscape areas are served by the system 1 credit</p> <p>Extent of Coverage: At least 80% of the landscape areas 1 credit</p>
<p><u>ENRB 2-6 WATER CONSUMPTION OF COOLING TOWERS</u></p> <p>Reduce potable water use for cooling purpose.</p> <p>(a) Use of cooling tower water treatment system which can achieve 6 or better cycles of concentration at acceptable water quality.</p> <p>(b) Use of recycled water from approved sources for cooling purpose.</p>	<p>1 credit</p> <p>1 credit</p>
<p>PART 2 – WATER EFFICIENCY CATEGORY SCORE :</p>	<p>Sum of GreenRE credits obtained from ENRB 2-1 to 2-6</p>

Part 3 – Sustainable Operation & Management	GreenRE Credits
<p><u>ENRB 3-1 BUILDING OPERATION & MAINTENANCE</u></p> <p>(a) The environmental policy that reflects the sustainability goals set.</p> <p>(b) A green guide for the occupants or visitors should be disseminated through various channels. Best practices to reduce energy use, water use and maintain a good indoor environment should be documented in this green guide. To demonstrate evidences of occupant involvement in environmental sustainability.</p> <p>(c) In-house building management team comprises one Certified GreenRE Manager/ Green Mark Manager or one Certified GreenRE Professional/ Green Mark Professional</p> <p>(d) The environmental management system of the building is ISO14000 or ISO 50001 certified.</p>	<p>1 credit</p> <p>1 credit</p> <p>0.5 credit for certified GreenRE Manager/ Green Mark Manager 1 credit for certified GreenRE Professional/ Green Mark Professional (Up to 1 credit)</p> <p>1 credit</p>
<p><u>ENRB 3-2 POST OCCUPANCY EVALUATION</u></p> <p>(a) Conduct post occupancy survey for occupant's satisfaction on energy and environmental performance.</p> <p>Required number of people surveyed shall be:</p> <ul style="list-style-type: none"> • 10% of total occupancy and up to 100 maximum. • Minimum 5 people shall be surveyed if total occupancy is less than 50. <p>(b) List of corrective actions taken following the post occupancy evaluation, if any.</p>	<p>2 credits</p> <p>1 credit</p>

<p><u>ENRB 3-3 WASTE MANAGEMENT</u></p> <p>(a) Provision of facilities or recycling bins for collection and storage of different recyclable waste such as paper, glass, plastic, food waste, etc.</p> <p>(b) Promote and encourage waste minimization and recycling among occupants, tenants and visitors through various avenues</p> <p>(c) Provide the proper storage area for the recyclable waste</p> <p>(d) To quantify and monitor the recycling programme for continuous improvement.</p>	<p>2 credits</p> <p>2 credits</p> <p>1 credit</p> <p>2 credits</p>														
<p><u>ENRB 3-4 SUSTAINABLE PRODUCTS</u></p> <p>Promote use of environmentally friendly products that are certified by approved local certification body and are applicable to non-structural and architectural related building components.</p>	<table border="1" data-bbox="810 913 1362 1227"> <thead> <tr> <th>Extent of Environmental Friendliness of Product</th> <th>Weightage for Credit Allocation</th> </tr> </thead> <tbody> <tr> <td>Good</td> <td>1</td> </tr> <tr> <td>Very Good</td> <td>1.5</td> </tr> <tr> <td>Excellent</td> <td>2</td> </tr> </tbody> </table> <p>Credits scored will be based on the weightage, extent of coverage and impact. (Up to 8 credits)</p>	Extent of Environmental Friendliness of Product	Weightage for Credit Allocation	Good	1	Very Good	1.5	Excellent	2						
Extent of Environmental Friendliness of Product	Weightage for Credit Allocation														
Good	1														
Very Good	1.5														
Excellent	2														
<p><u>ENRB 3-5 GREENERY PROVISION</u></p> <p>Encourage greater use of greenery to reduce heat island effect.</p> <p>(a) Green Plot Ratio (GnPR) is calculated by considering the 3D volume covered by plants using the Leaf Area Index (LAI).</p> <p>(b) Restoration of trees on site, conserving or relocating of existing trees on site.</p> <p>(c) Use of compost recycled from horticulture waste.</p>	<table border="1" data-bbox="810 1496 1362 1814"> <thead> <tr> <th>GnPR</th> <th>Credits Allocation</th> </tr> </thead> <tbody> <tr> <td>1.0 to < 2.0</td> <td>1</td> </tr> <tr> <td>2.0 to < 3.0</td> <td>2</td> </tr> <tr> <td>3.0 to < 4.0</td> <td>3</td> </tr> <tr> <td>4.0 to < 5.0</td> <td>4</td> </tr> <tr> <td>5.0 to < 6.0</td> <td>5</td> </tr> <tr> <td>≥ 6.0</td> <td>6</td> </tr> </tbody> </table> <p>1 credit</p> <p>1 credit</p>	GnPR	Credits Allocation	1.0 to < 2.0	1	2.0 to < 3.0	2	3.0 to < 4.0	3	4.0 to < 5.0	4	5.0 to < 6.0	5	≥ 6.0	6
GnPR	Credits Allocation														
1.0 to < 2.0	1														
2.0 to < 3.0	2														
3.0 to < 4.0	3														
4.0 to < 5.0	4														
5.0 to < 6.0	5														
≥ 6.0	6														

<p><u>ENRB 3-6 ENVIRONMENTAL PROTECTION</u></p> <p>(a) Green procurement policy – Adoption of sustainable and environmental-friendly procurement and purchasing policy in the operation and maintenance of the building.</p> <p>(b) Reduce the potential damage to the ozone layer and the increase in global warming through the release of ozone depleting substances and greenhouse gases.</p> <ul style="list-style-type: none"> • Refrigerants with ozone depletion potential (ODP) of zero or with global warming potential (GWP) of less than 100. • Use of refrigerant leak detection system at critical areas of plant rooms containing chillers and other equipment with refrigerants. 	<p>1 credit</p> <p>1 credit</p> <p>1 credit</p>
<p><u>ENRB 3-7 GREEN TRANSPORT</u></p> <p>Promote the use of public transport or bicycles to reduce pollution from individual car use with the following provision:</p> <p>(a) Good access (<800m walking distance) to public transport networks such as MRT/LRT stations or bus stops.</p> <p>(b) Provision of covered walkway to facilitate connectivity and the use of public transport.</p> <p>(c) Provision of hybrid/electric vehicle charging stations and priority parking lots within the development.</p> <p>(d) Provision of covered / sheltered bicycles parking lots with adequate shower and changing facilities.</p>	<p>1 credit</p> <p>1 credit</p> <p>1 credit</p> <p>Extent of Coverage : Minimum 10 number and maximum 50 numbers of bicycle parking lots (1 credit)</p>
<p>PART 3 – SUSTAINABLE OPERATION & MANAGEMENT CATEGORY SCORE :</p>	<p>Sum of GreenRE credits obtained from ENRB 3-1 to 3-7</p>

Part 4 – Indoor Environmental Quality	GreenRE Credits
<p><u>ENRB 4-1 INDOOR AIR QUALITY PERFORMANCE</u></p> <p>To promote a healthy indoor environment.</p> <p>(a) <i>Prerequisite Requirements:</i> To conduct full IAQ audit once in three years that complies with Code of Practice on Indoor Air Quality, Department of Occupational Safety and Health, Ministry of Human Resources Malaysia (2005).</p> <p>(b) Implement effective IAQ management plan to ensure building ventilation systems are frequently maintained to ensure clean delivery of air.</p> <p>(c) Use of high efficiency air filter (at least MERV 13) in AHU to reduce indoor contaminants and provide good protection for cooling coil and reducing frequency or eliminating duct cleaning</p> <p>(d) Room Temperature display (at least 1 unit per floor)</p> <p>(e) Additional carbon dioxide sensor display (at least 1 unit per floor)</p>	<p>4 credits</p> <p>1 credit</p> <p>1 credit</p> <p>1 credit</p> <p>1 credit</p>
<p><u>ENRB 4-2 INDOOR AIR POLLUTANTS</u></p> <p>Minimise airborne contaminants, mainly from inside sources to promote a healthy indoor environment.</p> <p>(a) Use of low volatile organic compounds (VOC) paints certified by approved local certification body.</p> <p>(b) Use of environmental friendly adhesives certified by approved local certification body.</p>	<p>1 credit</p> <p>1 credit</p>

<p><u>ENRB 4-3 LIGHTING QUALITY</u></p> <p>To encourage good workplace lighting quality to promote productivity and occupant's comfort</p> <p>(a) Lighting level to comply with MS1525:2014</p> <p>(b) Controllability of lighting system</p> <p>(c) High frequency ballast</p>	<p>1 credit</p> <p>At least 90% of occupants are able to adjust lighting to suit their task needs and preference</p> <table border="1" data-bbox="815 689 1370 846"> <tr> <td>Controlled by light switches</td> <td>1 credit</td> </tr> <tr> <td>Controlled by task lights</td> <td>2 credits</td> </tr> </table> <p>(Up to 2 credits)</p> <p>All applicable areas in the entire building that are served by fluorescent lightings.</p> <table border="1" data-bbox="815 1039 1370 1196"> <tr> <td>20% to < 40%</td> <td>0.5 credit</td> </tr> <tr> <td>40% to < 60%</td> <td>1 credit</td> </tr> <tr> <td>60% to < 80%</td> <td>1.5 credits</td> </tr> <tr> <td>80% and above</td> <td>2 credits</td> </tr> </table> <p>(Up to 2 credits)</p>	Controlled by light switches	1 credit	Controlled by task lights	2 credits	20% to < 40%	0.5 credit	40% to < 60%	1 credit	60% to < 80%	1.5 credits	80% and above	2 credits
Controlled by light switches	1 credit												
Controlled by task lights	2 credits												
20% to < 40%	0.5 credit												
40% to < 60%	1 credit												
60% to < 80%	1.5 credits												
80% and above	2 credits												
<p><u>ENRB 4-4 THERMAL COMFORT</u></p> <p>(a) Ensure the consistent indoor conditions for thermal comfort:</p> <ul style="list-style-type: none"> • Indoor dry-bulb temperature between 23°C to 26°C • Relative humidity between 50% to 70% <p>(b) Controllability of temperature.</p>	<p>1 credit</p> <p>1 credit</p>												
<p><u>ENRB 4-5 INTERNAL NOISE LEVEL</u></p> <p>Ensure internal noise level is maintained at appropriate levels and to comply with the Planning Guidelines for Environment Noise Limits and Control (Department of Environmental Malaysia).</p>	<p>1 credit</p>												
<p>PART 4 – INDOOR ENVIRONMENTAL QUALITY CATEGORY SCORE:</p>	<p>Sum of GreenRE credits obtained from ENRB 4-1 to 4-5</p>												

Part 5 – Other Green Features	GreenRE Credits
<p><u>ENRB 5-1 GREEN FEATURES & INNOVATIONS</u></p> <p>To encourage the use of other green features which are innovative or/and have positive environmental impact.</p> <p>Examples :</p> <ul style="list-style-type: none"> • Vertical greening • Green Lease • Ultraviolet light-C band (UV) emitters in air handling units (AHUs) to improve indoor air quality • Provision of car park guidance system • Use of self-cleaning façade system • Use of grey water recycling system • Titanium Dioxide coating to remove odour in toilets • Use of pneumatic waste collection system • Use of double refuse chutes for separating recyclable from non-recyclable waste • Stormwater management 	<p>2 credits for high impact item</p> <p>1 credit for medium impact item</p> <p>0.5 credit for low impact item</p> <p>(Up to 10 credits)</p>
<p>PART 5 – OTHER GREEN FEATURES CATEGORY SCORE :</p>	<p>Sum of GreenRE credits obtained from ENRB 5-1</p>

Part 6 – Carbon Emission of Development	GreenRE Credits
<p><u>ENRB 6-1 CARBON EMISSION OF DEVELOPMENT</u></p> <p>Recognise the carbon emission based on carbon footprint computation of the building comprising energy and water consumption.</p>	<p>0.1 x (% improvement)</p> <p>(Up to 4 credits)</p>
<p>PART 6 – CARBON EMISSION OF DEVELOPMENT CATEGORY SCORE:</p>	<p>Sum of GreenRE credits obtained from ENRB 6-1</p>
<p>GreenRE Score (Existing Non-Residential Building)</p> <p>GreenRE Score (ENRB) = \sumCategory score [(Part 1-Energy Efficiency)+ (Part 2-Water Efficiency)+ (Part 3-Sustainable Operation & Management)+ (Part 4-Indoor Environmental Quality)+ (Part 5-Other Green Features)+ (Part 6-Carbon Emission of Development)]</p> <p>Where: Category Score for Part 1 \geq 30 credits and \sumCategory score for Part 2, 3, 4, 5 & 6 \geq 20 credits</p>	

(I) Energy Related Requirements

Part 1- Energy Efficiency

ENRB 1-1 Thermal Performance of Building Envelope-OTTV

ENRB 1-2 Air-Conditioning System

ENRB 1-3 Natural Ventilation /Mechanical Ventilation

ENRB 1-4 Artificial Lighting

ENRB 1-5 Ventilation in Carparks

ENRB 1-6 Ventilation in Common Areas

ENRB 1-7 Lifts and Escalators

ENRB 1-8 Energy Efficient Practices & Feature

ENRB 1-9 Energy Policy & Management

ENRB 1-10 Renewable Energy

ENRB 1-1 THERMAL PERFORMANCE OF BUILDING ENVELOPE - OTTV

Objectives	Enhance overall thermal performance of building envelope to minimise heat gain thus reducing the overall cooling load requirement.
Applicability	Applicable to air-conditioned building spaces with aggregate areas > 1000m ² .
Baseline Standard	<p>Maximum permissible OTTV = 50 W/m²</p> <p>OTTV stands for Overall Thermal Transfer Value.</p> <p>Maximum permissible RTTV = 25 W/m²</p> <p>RTTV stands for Roof Thermal Transfer Value.</p> <p>In the case of an air-conditioned building, the concept of Roof Thermal Transfer Value (RTTV) is applied if the roof is provided with skylight and the entire enclosure below is fully air-conditioned.</p> <p>The computation of OTTV & RTTV shall be based on the methodology specified in the MS 1525:2014.</p>
Requirements	<p>Up to 5 credits can be scored for building envelope with better thermal performance than the baseline standard:</p> <p>0.5 credits for every reduction of 1 W/m² in OTTV from the baseline.</p> <p>Credits scored = 0.5 x [50 – OTTV] where OTTV ≤ 50 W/m²</p> <p>For developments consisting of more than one building, the weighted average of the OTTVs based on the façade areas of these buildings shall be used as the basis for credit allocation.</p> <p>That is,</p> $OTTV_{\text{weighted average}} = \sum (OTTV_{\text{bldg}} \times A_{\text{bldg}}) / A_{\text{devt}}$ <p>Where:</p> <p>OTTV_{bldg} = OTTV for building (W/m²)</p> <p>A_{bldg} = Summation of all façade areas that enclose all the air-conditioning areas (m²) in a building</p> <p>A_{devt} = Summation of total applicable façade areas of all buildings within the development (m²) (i.e. $\sum A_{\text{bldg}}$)</p>

Documentary Evidences	<ul style="list-style-type: none"> • Architectural elevation drawing showing the composition of the different façade or wall systems that are relevant for the computation of OTTV; • Architectural plan layouts and elevations showing all the air-conditioning areas; • Product catalogue or materials schedule showing the salient data of the materials used for the façade or external wall systems; and • OTTV & RTTV calculation.
References	MS 1525:2014 - Energy Efficiency and use of renewable energy for non-residential building – Code of Practice

ENRB 1-2 AIR-CONDITIONING SYSTEM

Objectives	Encourage the use of better efficient air-conditioned equipment to minimise energy consumption.								
Applicability	<p>Applicable to air-conditioned building areas where its aggregate air-conditioned areas > 1000m².</p> <p>Scope covers on below air-conditioned equipment installed for the buildings:</p> <ul style="list-style-type: none"> • Chillers • Chilled water pumps • Condenser water pumps • Cooling Towers • Air Handling Units (AHU) • Fan Coil Units (FCU) • Unitary Air-Conditioners/ Condensing Units which include single-split units, multi-split units and variable refrigerant flow (VRF) system 								
Baseline Standard	<p>Minimum efficiency requirement of the air-conditioning system stated in MS 1525:2014 or SS 530 & SS CP 13.</p> <p>1-2(a) <u>Water-Cooled Chilled Water Plant</u></p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th rowspan="2" style="text-align: center;">Baseline</th> <th colspan="2" style="text-align: center;">Building Cooling Load</th> </tr> <tr> <th style="text-align: center;">< 500 RT</th> <th style="text-align: center;">≥ 500 RT</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;"><u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant</td> <td style="text-align: center;">0.85 kW/RT</td> <td style="text-align: center;">0.75 kW/RT</td> </tr> </tbody> </table> <p>i. Water-Cooled Chiller – Refer Table 23 of MS 1525:2014 to calculate Its Coefficient of Performance (COP)</p> <p>ii & iii. Chilled-water pump and condenser water pump efficiency – Refer to Clause 8.2.5 in MS 1525:2014 which states that for chilled water or condenser water pumping system operating for more than 750 hours a year, the pump efficiency shall be:</p> <ul style="list-style-type: none"> a) > 70% for flowrate between 50 m³/h to 100 m³/h b) > 73% for flowrate between 100 m³/h to 270 m³/h c) >80% for flowrate exceeding 270 m³/h <p>This data can be collect during Testing & Commissioning (T&C)</p> <p>iv. Cooling tower performance at the rating condition states in Table 3 SS 530.</p> <p><u>Rating condition is as follows:</u> 35°C Entering water 29°C Leaving water 24°C Wet Bulb Outdoor air</p>	Baseline	Building Cooling Load		< 500 RT	≥ 500 RT	<u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant	0.85 kW/RT	0.75 kW/RT
Baseline	Building Cooling Load								
	< 500 RT	≥ 500 RT							
<u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant	0.85 kW/RT	0.75 kW/RT							

Propeller and axial fan cooling tower:

With heat rejected from every 3.23 L/s of condenser water per 1 kW of fan power rating:

$$\begin{aligned} \text{Cooling tower performance} &\leq 1\text{ kW} / 3.23 \text{ L/s} \\ &\leq 0.310 \text{ kW} / \text{L/s} \end{aligned}$$

Centrifugal fan cooling tower:

With heat rejected from every 1.7L/s of condenser water per 1kW of fan power rating:

$$\begin{aligned} \text{Cooling tower performance} &\leq 1\text{ kW} / 1.7 \text{ L/s} \\ &\leq 0.588 \text{ kW} / \text{L/s} \end{aligned}$$

OR

1-2(b) Air-Cooled Chilled-Water Plant / Unitary Air-Conditioners

Baseline	Building Cooling Load	
	< 500 RT	≥ 500 RT
<u>Prerequisite Requirements</u>		
Minimum system efficiency of air cooled chilled water plant or unitary conditioners	1.1 kW/RT	1.0 kW/RT

- Air-cooled chilled water plant - Refer Table 23 of MS 1525:2014 to calculate its Coefficient of Performance (COP).
- Unitary Air-Conditioners / Condensing Units – Refer Table 21 of MS 1525:2014.

Note: If the specific type of air conditioned is not found in MS 1525:2014, please refer to SS 530 to make the calculation on COP. Priority given to MS 1525:2014.

1-2(c) Air Distribution System – Refer to Clause 7.11.5 in CP 13

- For fan systems which are able to vary system air volume (VAV) automatically as a function of load, the power required by the motors for the combined fan system at the design conditions shall not exceed 2.4 kW/m³/s of supply air
- For Constant Air Volume (CAV), the motors for fan system shall not exceed 1.7 kW/m³/s of supply air.

Allowable nameplate motor power	
Constant volume	Variable volume
1.7 kW/m ³ /s	2.4 kW/m ³ /s

1-2(d) Provision of permanent measuring instruments to monitor water-cooled and air-cooled chilled water plant

- The instrumentation installed in the system shall have capability to calculate resultant plant efficiency within $\pm 5\%$ of its true value – Refer ASHRAE Guide 22 and AHRI 550/590.
- The following instrumentation accuracy as follow can be considered for monitoring central water-cooled chilled plant efficiency.

Description	Measurement error
<u>Temperature sensors</u> - 10K/30K Thermistor - Platinum Resistance Thermometers	$\pm 0.03 - 0.05$ °C at 0°C
<u>Flow Sensor Meter</u> - Ultrasonic - Full bore magnetic	$\pm 0.5 - 1.0$ % over entire measurement range
Power meter	ANSI C12.1-2008, Class 1 $\pm 1\%$

1-2(e) Verification of central chilled water plant instrumentation – Heat Balance substantiating test

- Substantiating test shall be conducted as accordance to AHRI 550/590
- The heat balance shall be conducted over entire normal operating hours with more than 80% of the computed balance within $\pm 5\%$ over the audit period

Heat balance is denoted by below equation:

$$q_{\text{condenser}} = q_{\text{evaporator}} + W_{\text{input}}$$

Where;

$q_{\text{condenser}}$ = heat rejected (in kW or RT)

$q_{\text{evaporator}}$ = cooling load (in kW or RT)

W_{input} = measured electrical power input to compressor

1-2(f) Provisioning of variable speed controls for chiller plant equipment

1-2(g) Provisioning of automatic control devices or sensors to regulate outdoor air flow rate to maintain the concentration of Carbon Dioxide at acceptable range ≤ 700 ppm above outdoor concentration.

Requirements	<p><u>1-2(a) Air-Conditioned Plant (Up to 20 credits)</u></p> <ul style="list-style-type: none"> • Building cooling load \geq 500RT : <p>14 credits for achieving plant efficiency of 0.75 kW/ton</p> <p>0.35 credit for every percentage improvement in the chiller plant efficiency better than 0.75 kW/ton</p> <p>Credit scored = 0.35 x (% improvement)</p> <ul style="list-style-type: none"> • Building cooling load $<$ 500RT: <p>14 credits for achieving plant efficiency of 0.85 kW/ton</p> <p>0.3 credit for every percentage improvement in the chiller plant efficiency better than 0.85 kW/ton</p> <p>Credit scored = 0.3 x (% improvement)</p> <p style="text-align: center;">(up to 20 credits)</p> <p style="text-align: center;">OR</p> <p><u>1-2(b) Air-Conditioned Plant (Up to 20 credits)</u></p> <ul style="list-style-type: none"> • Building cooling load \geq 500RT : <p>14 credits for achieving plant efficiency of 1.0 kW/ton</p> <p>0.25 credit for every percentage improvement in the chiller plant efficiency better than 1.0 kW/ton</p> <p>Credit scored = 0.25 x (% improvement)</p> <ul style="list-style-type: none"> • Building cooling load $<$ 500RT: <p>14 credits for achieving plant efficiency of 1.1 kW/ton</p> <p>0.2 credit for every percentage improvement in the chiller plant efficiency better than 1.1 kW/ton</p> <p>Credit scored = 0.2 x (% improvement)</p> <p style="text-align: center;">(up to 20 credits)</p>
---------------------	--

	<p><u>1-2 (c) Air Distribution System (Up to 8 credits)</u></p> <p>0.15 credits for every percentage improvement in the air distribution system efficiency above the baseline.</p> <p>Credits scored = 0.15 x (% improvement)</p> <p>Note (1): For building using district cooling system, there is no need to compute the plant efficiency under item ENRB 1-2(a). The credit obtained will be pro-rated based on the air distribution system efficiency under ENRB 1-2(c).</p> <p>1-2 (d) 1 credit can be scored for the provision of permanent measuring instruments for monitoring of water cooled chilled-water plant and air-cooled chilled water plant efficiency</p> <p>1-2 (e) 1 credit can be scored for verification of central water cooled chilled-water plant instrumentation: Heat Balance – substantiating test for water cooled chilled-water plant to be computed in accordance with AHRI 550/590. The operating system efficiency and heat balance to be submitted to GreenRE upon commissioning.</p> <p>1-2(f) 1 credit can be scored if variable speed controls for chiller plant equipment such as chilled-water pumps and cooling tower fans are provided to ensure better part-load plant efficiency.</p> <p>1-2(g) 1 credit can be scored if sensors or similar automatic control devices are used to regulate outdoor air flow rate to maintain the concentration of carbon dioxide (CO₂) ≤ 700 ppm above outdoor.</p>
<p>Documentary Evidences</p>	<p><u>For 1-2 (a), 1-2 (b) and 1-2 (c)</u></p> <ul style="list-style-type: none"> • Detailed calculations of the overall uncertainty of measurement of the resultant chiller plant efficiency in kW/RT to be within ± 5% of the true value based on instrumentation specifications. • Detailed calculations of the overall improvement in equipment/system efficiency of the air-conditioning plants/ units and air distribution system in the tabulated formats showing the design cooling system capacity and the system efficiency (including individual equipment efficiency). • Calculation and technical data of the designed system efficiency of chillers at <u>part load condition</u>; and • Technical product information of all air-conditioning and system.

For 1-2 (d)

- Instruments' calibration certificates from accredited laboratory or batch calibration certificates from manufacturer.
- Summary of instruments, standard and measurement accuracy to be presented in the following format:

Instruments	Instruments calibration standard	Quantity	Measurement Error (% of reading)	Resultant Error (% kW/RT)	Type/Brand/ Model
Temperature/Sensors					
Flow meter/Sensors					
Power Meter					

For 1-2 (e)

- The computation of the percent heat balance that is the total heat gain and total heat rejected must be within $\pm 5\%$ for 80% of the sampled credits over the normal building operations hours.

For 1-2 (f) and 1-2 (g)

- Technical product information or catalogue of the control device used (If applicable)
- Plan layouts showing the locations and the types of control devices used to regulate fresh air intake.

References

- (a) MS 1525:2014 – Energy efficient and use of renewable energy for non-residential building – Code of Practice
- (b) SS 530 – Code of Practice for Energy Efficiency Standard for Building Services and Equipment.
- (c) SS CP 13 – Code of Practice for Mechanical Ventilation and Air-Conditioning in Buildings.

Worked Example

Case: District Cooling Plant (DCP)

For 1-2(a) (ii)

An air-conditioned building equipped only AHU and FCU. Whilst its chiller, cooling tower and pumps are placed outside the building. The AHU performance system is 8 %.

0.5 credit for AHU improvement; $0.5 \times 8\% = 4$ credits

For 1-2(a) (i).

The pro-rate calculation shall be;

$\frac{4 \text{ credits}}{5 \text{ credits}} \times 20 \text{ credits} = 16 \text{ credits}$


5 credits

Total credits scored for part 1-2(a)(i) and 1-2(a)(ii) = $4 + 16 = 20$ credits

ENRB 1-3 NATURAL VENTILATION/ MECHANICAL VENTILATION


Objectives	Encourage building that facilitates good natural ventilation. Encourage energy efficient mechanical ventilation system as the preferred ventilation mode to air-conditioning in buildings.						
Applicability	Applicable to Non Air-Conditioned Building Areas (with an aggregate non air-conditioned areas > 10% of total floor area excluding carparks and common areas) for Natural Ventilation.						
Baseline Standard	<p>Fan power limitation in mechanical ventilation systems:</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th colspan="2" style="text-align: center;">Allowable nameplate motor power</th> </tr> <tr> <th style="text-align: center;">Constant volume</th> <th style="text-align: center;">Variable volume</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">1.7 kW/m³/s</td> <td style="text-align: center;">2.4 kW/m³/s</td> </tr> </tbody> </table>	Allowable nameplate motor power		Constant volume	Variable volume	1.7 kW/m ³ /s	2.4 kW/m ³ /s
Allowable nameplate motor power							
Constant volume	Variable volume						
1.7 kW/m ³ /s	2.4 kW/m ³ /s						
Requirements	<p><u>1-3(a) Natural Ventilation</u></p> <p>Up to 32 credits will be awarded for natural ventilation in the building.</p> <p>20 base credits will be awarded for use of natural ventilation,</p> <p>Up to 12 credits can be scored for building design that utilises prevailing wind conditions to achieve adequate cross ventilation.</p> <p>1.2 credits for every (10% of units/ rooms with window openings facing north and south directions)</p> <p style="text-align: center;">Credits scored = 1.2 x (% of units / 10)</p> <p>Note: In Malaysia, the prevailing wind comes from two predominant directions; that is the north to north-east during the Northeast monsoon season and south to south-east during the South-west monsoon season. Hence, buildings designed with window openings facing the north and south directions have the advantages of the prevailing wind conditions which would enhance indoor thermal comfort. Meteorological data on the more precise wind direction and velocity of the site location can also be used as the basis for the design.</p> <p>It is not necessary for the window openings to be located perpendicularly to the prevailing wind direction. An oblique angle is considered acceptable (see illustrations as shown in the next page).</p>						

Illustration 1-3.1: Orientation of facade facing North and South

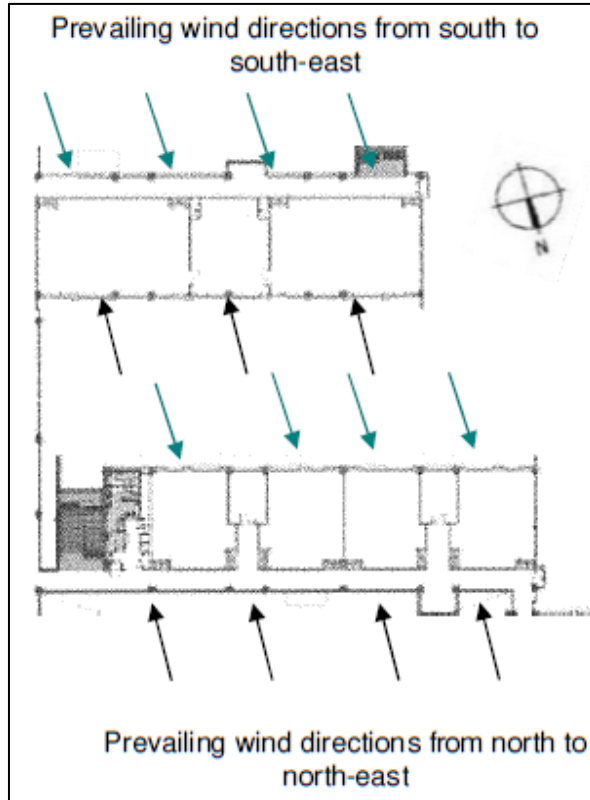

Building layout shows all rooms with window openings facing the North and South directions.

Illustration 1-3.2: Orientation of facade facing North and South

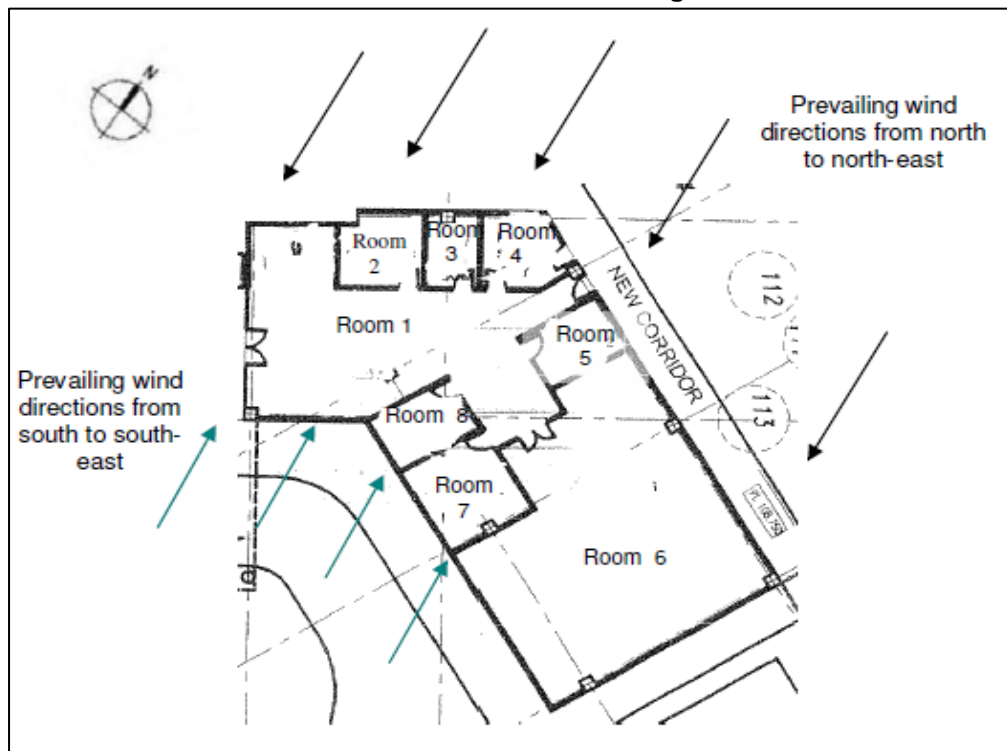

Building layout shows not all rooms with window facing the north and south directions. Room 2 to Room 5 would only have prevailing wind in one direction. Only Room 1 and 6 can be considered meeting requirement 1-3(a).

	<p><u>1-3(b) Mechanical Ventilation</u></p> <p>Up to 32 credits for the use of mechanical system in order to promote adequate ventilation between indoor and outdoor air.</p> <p>0.6 credits for every subsequent 1% improvement in the baseline.</p>																						
<p>Documentary Evidences</p>	<p><u>1-3(a) Natural Ventilation</u></p> <ul style="list-style-type: none"> Architectural plan layouts showing the units / rooms of all blocks with highlights of those with window openings in the N-S direction and / or with air-conditioned systems; Calculation showing the percentage of units or rooms with window openings facing north and south directions in the prescribed formats as shown in the Table 1-4(a). <p>Table 1-3(a) – Percentage of units with window opening in N-S direction</p> <table border="1" data-bbox="384 815 1374 1317"> <thead> <tr> <th>Ref</th> <th>Description</th> <th>Units/Rooms with window opening in the N-S direction (a)</th> <th>Total no. of naturally ventilated units/room (b)</th> <th>% of units/ rooms with window opening in N-S direction</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Classroom Blk A & A1</td> <td></td> <td></td> <td rowspan="4">$\frac{\sum (a)}{\sum (b)} \times 100$</td> </tr> <tr> <td>2</td> <td>Classroom Blk B</td> <td></td> <td></td> </tr> <tr> <td>3</td> <td>Offices, meeting rooms and computer rooms with air-conditioning</td> <td></td> <td></td> </tr> <tr> <td colspan="2">Total:</td> <td></td> <td></td> </tr> </tbody> </table> <p style="text-align: center;"> Credits scored = $1.2 \times (\% \text{ of units} / 10)$ = $1.2 \times [(\sum (a) / \sum (b) \times 100) / 10] + 20$ (for use of NV) </p> <p><u>1-3(b) Mechanical Ventilation</u></p> <ul style="list-style-type: none"> The design and drawing in overall for mechanical ventilation system to make up the required outdoor air quantity into the building at desire fan power limit. Detail calculations showing the percentage of energy reduction from baseline. Technical product information of the fan power used. (If applicable) 	Ref	Description	Units/Rooms with window opening in the N-S direction (a)	Total no. of naturally ventilated units/room (b)	% of units/ rooms with window opening in N-S direction	1	Classroom Blk A & A1			$\frac{\sum (a)}{\sum (b)} \times 100$	2	Classroom Blk B			3	Offices, meeting rooms and computer rooms with air-conditioning			Total:			
Ref	Description	Units/Rooms with window opening in the N-S direction (a)	Total no. of naturally ventilated units/room (b)	% of units/ rooms with window opening in N-S direction																			
1	Classroom Blk A & A1			$\frac{\sum (a)}{\sum (b)} \times 100$																			
2	Classroom Blk B																						
3	Offices, meeting rooms and computer rooms with air-conditioning																						
Total:																							
<p>References</p>	<p>SS CP 13 – Code of Practice for Mechanical Ventilation and Air-Conditioning in Buildings</p>																						

ENRB 1-4 ARTIFICIAL LIGHTING

Objectives	Encourage the use of energy efficient lighting to minimize energy consumption from lighting usage while maintaining proper lighting level
Applicability	Applicable to lighting provisions that designed in accordance to the luminance level as recommended in MS 1525: 2014.
Baseline Standard	Luminance level stated in MS 1525:2014 – Energy Efficient and use of renewable energy for non-residential building – Code of Practice.
Requirements	<p>Up to 13 credits if tenants’ light is provided OR up to 5 credits if tenants’ light is excluded for the improvement in the lighting power consumption.</p> <p>0.3 credit for every percentage improvement in the lighting provisions over the baseline standard. That is:</p> <p>Credits scored = 0.3 x (% improvement)</p> <p>Display lighting and specialised lighting are to be included in the calculation of lighting power budget.</p> <p>The design service illuminance, lamp efficiencies and the light output ratios of luminaries shall be in accordance with in MS 1525:2014 – Energy Efficiency and use of renewable energy for non-residential building – Code of Practice.</p>
Documentary Evidences	<ul style="list-style-type: none"> • Lighting layout plan; • Lighting schedules showing the numbers, location and types of lighting luminaries used; • Calculation of the proposed lighting power budget and the percentage; improvement in the tabulated format showing the areas, light fitting type, power consumption per fitting, ballast loss, no. of fittings, individual and total design and reference (based on MS1525:2014) power consumption and power budget according to the fitting type; and • Technical product information of the lighting luminaries used. (If applicable)
References	MS 1525:2014 – Energy Efficiency and use of renewable energy for non-residential building – Code of Practice.

ENRB 1-5 VENTILATION IN CARPARKS

Objectives	Encourage the use of energy efficiency design and control of ventilation systems in carpark.
Applicability	Applicable to all carpark spaces in the development.
Baseline Standard	-
Requirements	<p>1-5(a) 4 credits can be scored if the carpark spaces that are fully naturally</p> <p>1-5(b) For carpark that have to be mechanically ventilated, credits can be scored for the use of carbon monoxide (CO) sensors in regulating such demand based on the mode of mechanical ventilation (MV) used; 2.5 credits for carpark using fume extract system and 2 credits for those with MV with or without supply.</p> <p>Note: Where there is a combination of different ventilation mode adopted for carpark design, the credits scored under this requirement will be prorated accordingly.</p>
Documentary Evidences	<p><u>For 1-5 (a) and (b)</u></p> <ul style="list-style-type: none"> • Plan layouts showing all carpark provisions for the development with highlights of the carpark spaces that are designed to be naturally ventilated and/or mechanical ventilated; • Plan layouts indicating the locations of CO sensors and the mode of ventilation adopted for the design; • Technical product information of the CO sensors used (If applicable); and • Calculation showing the credits allocation if there is a combination of different ventilation modes adopted for the carpark design.
References	-

ENRB 1-6 VENTILATION IN COMMON AREAS

Objectives	Encourage the use of energy efficient of ventilation systems in common areas
Applicability	Applicable to the following common areas of the development. <ul style="list-style-type: none"> <li style="display: inline-block; width: 45%;">• Toilets <li style="display: inline-block; width: 45%;">• Lift Lobbies <li style="display: inline-block; width: 45%;">• Staircases <li style="display: inline-block; width: 45%;">• Atriums <li style="display: inline-block; width: 45%;">• Corridors
Baseline Standard	-
Requirements	<p>Up to 5 credits can be scored for the use of natural ventilation as an effective passive cooling design strategy to reduce the energy used by air-conditioning systems in these common areas.</p> <p>Extent of coverage: At least 90% of each applicable area (by numbers).</p> <p>Credits are scored based on the mode of ventilation provided in these applicable areas.</p> <p>Natural ventilation – 1.5 credits for each area</p> <p>Mechanical ventilation – 0.5 credit for each area</p>
Documentary Evidences	<ul style="list-style-type: none"> • Plan layouts showing the applicable areas and the respective modes of ventilation; and • Schedules showing the numbers, locations of the applicable areas and the modes of ventilation used.
References	-

ENRB 1-7 LIFTS AND ESCALATORS

Objectives	Encourage the use of energy efficient lifts and escalator.
Applicability	Applicable to <u>ALL</u> lifts and/or escalators in the development.
Baseline Standard	-
Requirements	<p>1 credit can be scored for the use of lifts with energy efficient features such as AC variable voltage and variable frequency (VVVF) motor drive or equivalent.</p> <p>1 credit can be scored for the use if lifts with sleep mode features.</p> <p>1 credit can be scored for the use of escalators with motion sensors to regulate usage.</p>
Documentary Evidences	Technical product specification of the lifts and escalators used in the development highlighting the energy efficient features. (if applicable)
References	-
Worked Example 1-7	<p>Proposed development has the following provision :</p> <p>Two lift types : Type L1 with VVVF motor drive and sleep mode features Type L2 with VVVF motor drive and sleep mode features</p> <p>Two escalator types : Type E1 with VVVF motor drive and motion sensors Type E2 without VVVF motor drive and motion sensors</p> <p>1 credit for the use of lifts with VVVF motor drive; and</p> <p>1 credit for the use of lifts with sleep mode features</p> <p>No credits for escalators as not all escalators are designed with motion sensors</p> <p>Credits scored for 1-7 = 2 credits (out of 3 credits)</p>

ENRB 1-8 ENERGY EFFICIENT PRACTICES & FEATURES

Objectives	Encourage the use of energy efficient practices and features which are innovative and/or have positive environmental impact.
Applicability	Applicable to practices and features that are not listed in the requirements under Part 1 – Energy Efficiency.
Baseline Standard	-
Requirements	<p>1-8(a) 1 credit can be scored for the practice of using Energy Efficient Index (EEI) as a building performance indicator to measure the building’s unit area energy consumption for future monitoring and improvements.</p> <p><u>Calculation of EEI:</u></p> $EEI = [(TBEC - DCEC) / (GFA - DCA)] \times (NF/OH)$ <p>Where:</p> <p>(a) TBEC : Total building energy consumption (kWh/year) (b) DCEC : Data centre energy consumption (kWh/year) (c) GFA : Gross Floor Area (exclude car park area)(m²) (d) DCA : Data centre area (m²) (e) NF : Normalising factor based on a typical weekly operating hour that is <u>55hr/week</u> (f) OH : Weighted weekly operating hours (hrs/week)</p> <p>Note: (1) EEI is based on 100% occupancy rate for consistency. (2) All major energy consumption equipments are to be included in the estimation of total building energy consumption. (3) For industrial buildings, process load should be excluded.</p> <p>1-8(b) 0.5 credits can be scored for each equipment type used up to 2 credits. Examples include:</p> <ul style="list-style-type: none"> • Re-generative lift • Heat recovery system • Motion sensors • Sun pipes • Light shelves • Photocell sensors to maximize the use of Daylight • Heat pumps, etc. <p>1.8(c) Up to 9 credits can be scored for this section. 2 credits for every 1% energy saving over the total building energy consumption.</p> <p>Notes: For features that are not listed ENRB 1-8(b) above, the QP is required to submit the details showing the positive environmental impacts and potential energy savings of the proposed features to GreenRE assessment.</p>

<p>Documentary Evidences</p>	<p><u>For 1-8(a)</u></p> <ul style="list-style-type: none"> • Calculation of the Energy Efficiency Index (EEI) based on the actual electricity consumption showing the daily usage pattern; load (kW) and the average energy consumption per day (kWh/day). • Electricity bills showing the tariff of the electric for the year. <p><u>For 1-8(b)</u></p> <ul style="list-style-type: none"> • Technical product information on the energy efficient features used (If applicable). • Plan layouts showing the location of the EEI features. <p><u>For 1-8(c)</u></p> <ul style="list-style-type: none"> • Calculation of the potential energy savings that could be reaped from the use of these features.
<p>References</p>	<p>-</p>

ENRB 1-9 ENERGY POLICY & MANAGEMENT

Objectives	Encourage new strategies and plans in the future save and minimise the use of energy.
Applicability	Applicable to building that uses energy
Baseline Standard	-
Requirements	<p>0.5 credits for energy policy, energy targets and regular review with top management's commitment as part of an environmental strategy.</p> <p>0.5 credits to show intent, measures and implementation strategies of energy efficiency improvement plans to achieve energy target set over the next three years. Committed energy savings accrued from proposed measures should be quantified</p>
Documentary Evidences	<ul style="list-style-type: none">• Documents or plans related to energy saving commitments or energy targets from the top management.• Improvement plans showing the calculation of energy saving that can be achieved over the next three years.
References	-

ENRB 1-10 RENEWABLE ENERGY

Objectives	Encourage the application of renewable energy sources in buildings.											
Applicability	Includes all renewable energy sources.											
Baseline Standard	-											
Requirements	<p>Up to 15 credits can be scored for the use of renewable energy. Credit scored based on the expected energy efficiency index (EEI) and % replacement of electricity by renewable energy source</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th rowspan="2" style="text-align: center;">Energy Efficiency Index (EEI)</th> <th colspan="2" style="text-align: center;">Every 1% replacement of electricity (based on total electricity consumption) by renewable energy source</th> </tr> <tr> <th style="text-align: center;">Include tenant's usage</th> <th style="text-align: center;">Exclude tenant's usage</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">≥ 50 kWh/m²/yr</td> <td style="text-align: center;">5 credits</td> <td style="text-align: center;">3 credits</td> </tr> <tr> <td style="text-align: center;">< 50 kWh/m²/yr</td> <td style="text-align: center;">3 credits</td> <td style="text-align: center;">1.5 credits</td> </tr> </tbody> </table>	Energy Efficiency Index (EEI)	Every 1% replacement of electricity (based on total electricity consumption) by renewable energy source		Include tenant's usage	Exclude tenant's usage	≥ 50 kWh/m ² /yr	5 credits	3 credits	< 50 kWh/m ² /yr	3 credits	1.5 credits
Energy Efficiency Index (EEI)	Every 1% replacement of electricity (based on total electricity consumption) by renewable energy source											
	Include tenant's usage	Exclude tenant's usage										
≥ 50 kWh/m ² /yr	5 credits	3 credits										
< 50 kWh/m ² /yr	3 credits	1.5 credits										
Documentary Evidences	<ul style="list-style-type: none"> • Plan layout showing the location of the installed PV panels; (If applicable) • Technical product information on the salient features of the renewable energy system and the expected renewable energy generated; (If applicable) and • Calculation of the percentage replacement of electricity and the total annual electricity consumption of the development. 											
References	-											

(II) Other Green Requirements

Part 2 – Water Efficiency

ENRB 2-1 Water Usage and Leak Detection

ENRB 2-2 Water Efficient Fittings

ENRB 2-3 Alternative Water Sources

ENRB 2-4 Water Efficiency Improvement Plans

ENRB 2-5 Irrigation System and Landscaping

ENRB 2-6 Water Consumption of Cooling Towers

ENRB 2-1 WATER USAGE AND LEAK DETECTION SYSTEM

Objectives	Promote the use of sub-metering and leak detection system for better control and monitoring of water usage
Applicability	Applicable to sub-metering provisions for major water uses of the building developments.
Baseline Standard	-
Requirements	<p>(a) 1 credit can be scored by monitoring the water consumption on a monthly basis.</p> <p>(b) 1 credit can be scored for the provision of private-meters for major water uses (e.g. Cooling tower, water features, irrigation, swimming pools and tenant usage)</p> <p>(c) Up to 2 credits can be scored for the provision of automated/smart metering for monitoring and leakage detection.</p>
Documentary Evidences	<ul style="list-style-type: none"> • Schematic drawings of cold water distribution system showing the location of the sub-metering provided. • Plan layout of the portion showing the location of the sub-meters.
References	-

ENRB 2-2 WATER EFFICIENT FITTINGS

Objectives	Encourage the use of water efficient fittings under Water Efficient Product Labelling Scheme (WELPS) or Water Efficiency Labelling Scheme (WELS)									
Applicability	<p>Applicable to all water fittings covered by the WEPLS or WELS as follows:</p> <ul style="list-style-type: none"> <li style="display: inline-block; width: 45%;">• Basin taps and mixers <li style="display: inline-block; width: 45%;">• Showerheads <li style="display: inline-block; width: 45%;">• Sink/taps and mixers <li style="display: inline-block; width: 45%;">• Shower taps and mixers <li style="display: inline-block; width: 45%;">• Dual Flush Low Capacity Flushing Cisterns <li style="display: inline-block; width: 45%;">• Urinals and Flush Valves 									
Baseline Standard	As specified under Water Efficiency Products Labelling Scheme (WEPLS) or Water Efficiency Labelling Scheme (WELS).									
Requirements	<p>Up to 12 credits can be scored based on the number and water efficiency rating of the fitting type used.</p> <table border="1" style="margin-left: auto; margin-right: auto; text-align: center;"> <thead> <tr> <th colspan="3">Weightage Based on Water Efficiency Products Labelling Scheme (WEPLS)</th> </tr> <tr> <th>Efficient *</th> <th>Highly Efficient **</th> <th>Most Efficient ***</th> </tr> </thead> <tbody> <tr> <td>6</td> <td>9</td> <td>12</td> </tr> </tbody> </table>	Weightage Based on Water Efficiency Products Labelling Scheme (WEPLS)			Efficient *	Highly Efficient **	Most Efficient ***	6	9	12
Weightage Based on Water Efficiency Products Labelling Scheme (WEPLS)										
Efficient *	Highly Efficient **	Most Efficient ***								
6	9	12								
Documentary Evidences	<ul style="list-style-type: none"> • Water fitting schedules showing the numbers, types and the approved rating of the proposed fittings. • Calculation showing the percentage of proposed water fittings that are approved under WEPLS as shown in Table 2-2.1. 									
References	<p>For more information about WEPLS, refer to http://www.span.gov.my/index.php?option=com_content&view=article&id=580%3Aabout-us1&catid=175%3Awepls&Itemid=457&lang=en</p> <p>Or WELS, refer to (http://www.pub.gov.sg/wels/Pages/default.aspx)</p>									

Worked Example 2-2

Example of a water fitting schedule showing the numbers, types and the approve rating of the proposed fitting for a residential development (including common facilities such as clubhouse toilets).

Table 2-2.1 – Computation of the percentage of water fittings under WEPLS

Ref.	Water Fitting Type	WEPLS rating			Not Rated	Total
		Efficient	Highly Efficient	Most Efficient		
1	Shower taps and mixers	0	45	0	0	45
2	Basin taps and mixers	0	0	55	0	55
3	Sink/bib taps and mixers	0	70	0	0	70
4	Flushing cisterns	0	0	50	0	50
5	Others - Urinals for club house	0	0	0	5	5
Total no. based on rating (A)		0	115	105	5	$\Sigma A = 225$
Weightage (B)		6	9	12	0	
Total (AxB)		0	1035	1260	0	$\Sigma(AxB) = 2295$

$$\begin{aligned} \text{Credits scored} &= \Sigma(AxB) / \Sigma A \\ &= 2295 / 225 \\ &= 10.2 \text{ credits} \end{aligned}$$

$$\text{Percentage of fittings with water efficiency rating} = 220/225 = 97.7\%$$

ENRB 2-3 ALTERNATIVE WATER SOURCES

Objectives	Encourage the use of suitable systems that utilize alternative water sources for non-potable uses : irrigation, washing, water features, toilet flushing, etc						
Applicability	Generally applicable to building that uses alternative water sources.						
Baseline Standard	-						
Requirements	<p>Up to 3 credits will be awarded based on the % reduction in total potable water usage of the applicable uses</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <td style="text-align: center;">> 50 %</td> <td style="text-align: center;">3 credits</td> </tr> <tr> <td style="text-align: center;">≥ 10 % to 50 %</td> <td style="text-align: center;">2 credits</td> </tr> <tr> <td style="text-align: center;">< 10 %</td> <td style="text-align: center;">1 credit</td> </tr> </table>	> 50 %	3 credits	≥ 10 % to 50 %	2 credits	< 10 %	1 credit
> 50 %	3 credits						
≥ 10 % to 50 %	2 credits						
< 10 %	1 credit						
Documentary Evidences	<ul style="list-style-type: none"> • Plan layout showing the location of the alternative water source implemented. (If applicable). • Product information or related catalogues on the alternative water sources used (If applicable). • Calculation on the % of water reduction that can be achieved by using this alternative source. 						
References	-						

ENRB 2-4 WATER EFFICIENCY IMPROVEMENT PLANS

Objectives	To show intent, measures and implementation strategies of water efficiency improvement plans over the next three years
Applicability	Generally applicable for water consumption and its cycle for non-domestic used
Baseline Standard	-
Requirements	1 credit can be scored for the commitment to plan water savings accrued from proposed measures
Documentary Evidences	<ul style="list-style-type: none">• Improvement plans showing the calculation of water saving that can be achieved. (Optional)• Water efficiency management plan report
References	-

ENRB 2-5 IRRIGATION SYSTEM AND LANDSCAPING

Objectives	Reduce potable water consumption by provision of suitable systems that utilise rainwater or recycled water for landscape irrigation.
Applicability	Applicable to development with landscaping provision.
Baseline Standard	-
Requirements	<p>2-5(a) 1 credit can be scored for the use of non-potable water including rainwater for landscape irrigation.</p> <p>2-5(b) 1 credit can be scored if more than 50% of the landscape areas are served by water efficient irrigation system with features such as automatic sub-soil drip irrigation system with rain sensor control.</p> <p>2-5(c) 1 credit can be scored if at least 80% of the landscape areas consist of drought tolerant plants or plants that require minimal irrigation.</p>
Documentary Evidences	<p><u>For 2-5(a)</u></p> <ul style="list-style-type: none"> • Relevant documents showing how the non-potable water source is to be provided; • Relevant drawings showing the location and design of the non-potable water source; and <p><u>For 2-5(b)</u></p> <ul style="list-style-type: none"> • Relevant documents showing the provision and details of water efficient irrigation system; • Relevant layout plans showing the overall landscape areas and the areas that would be served using the system; and • Calculation showing the percentage of the landscape areas that would be served using the system. <p><u>For 2-5(c)</u></p> <ul style="list-style-type: none"> • Relevant layout plans showing the overall landscape areas and the areas that use drought tolerant plants or plants that require minimal irrigation; and • Calculation showing the percentage of the landscape areas that use drought tolerant plants or plants that require minimal irrigation.
References	-

ENRB 2-6 WATER CONSUMPTION OF COOLING TOWERS

Objectives	Reduce potable water consumption for cooling purpose.
Applicability	Applicable to building development with water-cooled central chillers systems and water cooled package units.
Baseline Standard	-
Requirements	<p>2-6(a) 1 credit can be scored for the use of cooling tower water treatment system which can achieve 7 or better cycles of concentration at acceptable water quality.</p> <p>2-6(b) 1 credit can be scored for the use of recycled water from approved sources to meet the water demand for cooling purpose.</p>
Documentary Evidences	<p><u>For 2-6(a)</u></p> <ul style="list-style-type: none"> • Relevant documents showing design details on how the cooling towers have been designed to achieve at least seven cycles of concentration; • Calculations showing the cycles of concentration based on the data. • Relevant drawings or plan layouts showing the location of the cooling towers and other supporting systems that are required to achieve the designed concentration. <p><u>For 2-6(b)</u></p> <ul style="list-style-type: none"> • Relevant documents showing how the recycled water source is to be provided.
References	-

(II) Other Green Requirements

Part 3 – Sustainable Operation
& Management

ENRB 3-1 Building Operation & Maintenance

ENRB 3-2 Post Occupancy Evaluation

ENRB 3-3 Waste Management

ENRB 3-4 Sustainable Products

ENRB 3-5 Greenery Provision

ENRB 3-6 Environmental Protection

ENRB 3-7 Green Transport

ENRB 3-1 BUILDING OPERATION & MAINTENANCE

Objectives	Encourage the adoption of environmental friendly practices during construction and building operation.
Applicability	Generally applicable to all building developments.
Baseline Standard	-
Requirements	<p>3-1(a) 1 credit can be scored if the environmental policy that reflects the sustainable goals set.</p> <p>3-1(b) 1 credit for the provision of a green guide to the occupants of the building.</p> <p>3-1(c) Up to 1 credit where 0.5 credits can be scored if the team comprises of 1 GreenRE manager/ Green Mark manager or 1 credit can be scored if the team has 1 certified GreenRE Professional/ Green Mark Professional.</p> <p>3-1(d) Up to 1 credit if the environmental management system of the building is ISO 14000 or ISO 50001 certified.</p>
Documentary Evidences	<p><u>For 3-1(a)</u></p> <ul style="list-style-type: none"> • Documentation related to the building environmental policy. <p><u>For 3-1(b)</u></p> <ul style="list-style-type: none"> • Green guide book for the occupants where it contains best practises to reduce energy use, water use, maintain a good indoor environment. This guide should also demonstrate evidences of occupant involvement in environmental sustainability. <p><u>For 3-1(c)</u></p> <ul style="list-style-type: none"> • A certified true copy of the certificate of GreenRE Manager/Green Mark Manager or GreenRE Professional/Green Mark Professional where applicable and a confirmation of their involvement in the project. <p><u>For 3-1(d)</u></p> <ul style="list-style-type: none"> • A certified true copy of the ISO 14000 and ISO 50001 certificate from the facilities management team.
References	-

ENRB 3-2 POST OCCUPANCY EVALUATION

Objectives	To receive feedback from occupants of the building
Applicability	Generally applicable to all building developments.
Baseline Standard	-
Requirements	<p>3-2(a) 2 credits for the conduct of post occupancy survey for occupants satisfaction on energy and environmental practices.</p> <p>Required number of people surveyed shall be:</p> <ul style="list-style-type: none"> • 10% of total occupancy and up to 100 maximum. • Minimum 5 people shall be surveyed if total occupancy is less than 50. <p>3-2(b) 1 credit can be scored for the list of corrective actions taken following the post evaluation.</p>
Documentary Evidences	<p><u>For 3-2(a)</u></p> <ul style="list-style-type: none"> • Sample list of feedback given by the occupants. • Statistics or tabulation of the feedbacks by the occupants. <p><u>For 3-2(b)</u></p> <ul style="list-style-type: none"> • Evidence from past feedback that improvements were implemented or justification of measures to be taken to improve the current situation.
References	-

ENRB 3-3 WASTE MANAGEMENT

Objectives	To promote and encourage recycling and waste minimisation within the occupants of the building.
Applicability	Generally applicable to all building developments.
Baseline Standard	-
Requirements	<p>3-3(a) 2 credits for the provision of facilities or recycling bins for collection and storage for different recyclable waste such as paper, glass, plastic, food waste, etc.</p> <p>3-3(b) 2 credits for promoting and encouraging minimization and recycling among occupants, tenants and visitors through various avenues.</p> <p>3-3(c) 1 credit for providing proper storage area for recyclable waste.</p> <p>3-3(d) 2 credit for quantifying and monitoring the recycling programme for continuous improvement.</p>
Documentary Evidences	<p><u>For 3-3(a)</u></p> <ul style="list-style-type: none"> Plan layout showing the location for the collection and storage for the different recyclable waste. <p><u>For 3-3(b)</u></p> <ul style="list-style-type: none"> Quantified evidence on the promotion and encouragement of minimization and recycling among occupants. <p><u>For 3-3(c)</u></p> <ul style="list-style-type: none"> Plan layout showing the location of the storage area for recyclable waste. <p><u>For 3-3(d)</u></p> <ul style="list-style-type: none"> Relevant evidence regarding the monitoring of the current recycling programme.
References	-

ENRB 3-4 SUSTAINABLE PRODUCTS

Objectives	To promote use of environmentally friendly products that are certified by approved local certification body and are applicable to non-structural and architectural related building components.								
Applicability	Generally applicable to all building developments.								
Baseline Standard	-								
Requirements	<p>Up to 8 credits are allocated to encourage the use of appropriate environmentally friendly products that are certified by approved local/international certification body. The products used should have considerably contributions in the overall environmental sustainability standard of the development. Credits scored will be based on the weightage, extent of coverage and impact.</p> <p>The weightage given will be based on the extent of environmental friendliness as determined by the approved local certification body and are subject to GreenRE's evaluation.</p> <table border="1" data-bbox="437 936 1318 1196"> <thead> <tr> <th data-bbox="437 936 876 1039">Extent of Environmental Friendliness of Product</th> <th data-bbox="876 936 1318 1039">Weightage for Credit Allocation</th> </tr> </thead> <tbody> <tr> <td data-bbox="437 1039 876 1093">Good</td> <td data-bbox="876 1039 1318 1093">1</td> </tr> <tr> <td data-bbox="437 1093 876 1146">Very Good</td> <td data-bbox="876 1093 1318 1146">1.5</td> </tr> <tr> <td data-bbox="437 1146 876 1196">Excellent</td> <td data-bbox="876 1146 1318 1196">2</td> </tr> </tbody> </table> <p>The use of environmental friendly products or recycled materials used for all area of the development will be considered as <u>high impact</u> (1 credit). Items that are used for all common areas, external works and communal facilities are considered as <u>low impact</u> (0.5 credits).</p> <p>Note: The credit allocated for low volatile organic compound (VOC) paints and adhesives certified by approved local certification body can be found in ENRB 4-2 and hence shall not be included in the scoring for ENRB 3-4.</p>	Extent of Environmental Friendliness of Product	Weightage for Credit Allocation	Good	1	Very Good	1.5	Excellent	2
Extent of Environmental Friendliness of Product	Weightage for Credit Allocation								
Good	1								
Very Good	1.5								
Excellent	2								
Documentary Evidences	<ul style="list-style-type: none"> • Plan layout or pictures showing the location of the implementation of the sustainable product in the building (If applicable); • Relevant documents regarding the use of the sustainable product. (If applicable), • Tabulation of sustainable product used with calculations of impact and weightage. • Certification details from approved local/international certification body such as the material certification standards, rating and details; and • Product technical information. 								





References	<p>For more info on product certification, refer to;</p> <ol style="list-style-type: none"> 1. http://www.sirim-gas.com.my/index.php/zh/our-services/product-certification/eco-labelling-scheme 2. http://www.sec.org.sg/sqgs/
Worked Example 3-4	<ol style="list-style-type: none"> 1. Determine if the environmental friendly products selected are certified with approved local/international certification body. 2. Check if the products used are meant for main building elements or functional spaces and can be considered <u>high impact</u>. Examples are internal drywall partitions in every functional space unit, carpets for office spaces, compact fluorescent lighting etc. Products that are meant for common areas and external works such as toilets, lobbies and landscaping areas are considered as <u>low impact</u>. 3. If the selected products are potential high impact items, then determine the quantities used for these products as compared to the total quantities required for the same intended purpose. If the quantities of the products are more than 50% of the total requirement, it is considered as <u>high impact</u>. If it less than 50% of the total requirement then it should be considered as <u>low impact</u>. <p>Note: Certain products can have more environmentally friendly features than others. Other than recycled materials, they may have features like low VOC assembly or manufactured with resource efficient processes, durability etc that will render the products more environmental friendly than others. If the certified products selected are more environmental friendly and are given a better rating by the approved local/international certification body, a higher weightage can be considered in credit scoring.</p> <p>Example of a proposed development with the following provisions:</p> <ol style="list-style-type: none"> (a) Use of carpets for all office spaces. Product is not certified. (b) Use of panel boards as internal partitions for more than 50% of the office spaces and the product is rated to be 'Very Good' by the approved certification body (c) Precast concrete road kerbs. Product is rated as 'Good' by approved local certification body. (d) Use of roof waterproofing coating. Product is rated as 'Very Good' by approved local certification body. (e) Use of wooden doors for all areas. Product is rate as 'Excellent' by approved local certification body.


Table 3-4.1: Calculation for sustainable products

Products and Extent of coverage		With approved certification	Credits allocated based on impact (A)	Weightage based on rating (B)	Credits scored (AxB)
(a)	Carpets for all office spaces	No	N/A	N/A	0
(b)	Panel boards as internal partition for more than 50% of office spaces	Yes	1	1.5	1.5
(c)	Precast road kerbs	Yes	0.5	1	0.5
(d)	Roof waterproofing	Yes	0.5	1.5	0.75
(e)	Wooden doors for all areas	Yes	1	2	2

Therefore, credits scored for 3-4 = $1.5 + 0.5 + 0.75 + 2 = 4.75$ credits

ENRB 3-5 GREENERY PROVISION

Objectives	Encourage greater use of greenery and restoration of existing trees reduce heat island effect.																													
Applicability	Applicable to building developments with landscaping areas.																													
Baseline Standard	-																													
Requirements	<p>3-5(a) Up to 6 credits can be scored for the provision of greenery within the developments including roof top/ sky garden and green roof.</p> <p style="text-align: center;">Greenery Plot Ratio (GnPR) is calculated by considering the 3D volume covered by plants using the following Leaf Area Index(LAI) :</p> <table border="1" style="width: 100%; border-collapse: collapse; margin: 10px 0;"> <thead> <tr> <th style="width: 10%;">Plant group</th> <th style="width: 30%;">Trees</th> <th style="width: 20%;">Palms</th> <th style="width: 20%;">Shrubs & Groundcover</th> <th style="width: 10%;">Turf</th> </tr> </thead> <tbody> <tr> <td>LAI</td> <td>Canopy: Open = 2.5 Intermediate = 3.0 Dense = 4.0</td> <td>Solitary = 2.5 Cluster = 4.0</td> <td>Monocot = 3.5 Dicot = 4.5</td> <td>Turf = 2.0</td> </tr> <tr> <td>Area</td> <td>All = 60 m²</td> <td>Solitary = 20m² Cluster = 17m²</td> <td>Planted area</td> <td>Planted area</td> </tr> </tbody> </table> <div style="display: flex; justify-content: space-around; align-items: flex-start;"> <div style="text-align: center;"> <p>TREES</p>  <p>open canopy intermediate canopy dense canopy</p> </div> <div style="text-align: center;"> <p>PALMS</p>  <p>solitary cluster</p> </div> </div> <div style="display: flex; justify-content: space-around; align-items: flex-start; margin-top: 10px;"> <div style="text-align: center;"> <p>SHRUBS & GROUNDCOVER</p>  <p>monocot dicot</p> </div> <div style="text-align: center;"> <p>TURF</p>  <p>Zoyisia matrella</p> </div> </div> <table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th style="width: 50%;">GnPR</th> <th style="width: 50%;">Credits Allocation</th> </tr> </thead> <tbody> <tr> <td>1.0 to < 2.0</td> <td style="text-align: center;">1</td> </tr> <tr> <td>2.0 to < 3.0</td> <td style="text-align: center;">2</td> </tr> <tr> <td>3.0 to < 4.0</td> <td style="text-align: center;">3</td> </tr> <tr> <td>4.0 to < 5.0</td> <td style="text-align: center;">4</td> </tr> <tr> <td>5.0 to < 6.0</td> <td style="text-align: center;">5</td> </tr> <tr> <td>≥ 6.0</td> <td style="text-align: center;">6</td> </tr> </tbody> </table> <p style="text-align: center; margin-top: 10px;">Green Plot Ratio(GnPR) = Total leaf area index / site area</p> <p>3-5 (b) 1 credit for restoration of trees on-site, conservation or relocation of existing trees on site.</p> <p>3-5 (c) 1 credit for the use of compost recycled from horticulture waste.</p>	Plant group	Trees	Palms	Shrubs & Groundcover	Turf	LAI	Canopy: Open = 2.5 Intermediate = 3.0 Dense = 4.0	Solitary = 2.5 Cluster = 4.0	Monocot = 3.5 Dicot = 4.5	Turf = 2.0	Area	All = 60 m ²	Solitary = 20m ² Cluster = 17m ²	Planted area	Planted area	GnPR	Credits Allocation	1.0 to < 2.0	1	2.0 to < 3.0	2	3.0 to < 4.0	3	4.0 to < 5.0	4	5.0 to < 6.0	5	≥ 6.0	6
Plant group	Trees	Palms	Shrubs & Groundcover	Turf																										
LAI	Canopy: Open = 2.5 Intermediate = 3.0 Dense = 4.0	Solitary = 2.5 Cluster = 4.0	Monocot = 3.5 Dicot = 4.5	Turf = 2.0																										
Area	All = 60 m ²	Solitary = 20m ² Cluster = 17m ²	Planted area	Planted area																										
GnPR	Credits Allocation																													
1.0 to < 2.0	1																													
2.0 to < 3.0	2																													
3.0 to < 4.0	3																													
4.0 to < 5.0	4																													
5.0 to < 6.0	5																													
≥ 6.0	6																													
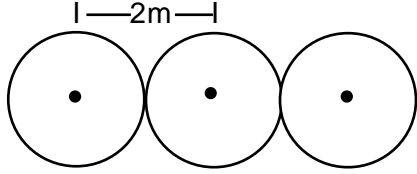
<p>Documentary Evidences</p>	<p><u>For 3-5(a)</u></p> <ul style="list-style-type: none"> Plan layouts showing the site area as well as the greenery that is provided within the development (including a listing of the number of trees, palms, shrubs, turf and the respective sub category and LAI values; and Calculation showing the extent of the greenery provision in the prescribed tabulated format formats as in worked example 3-5(a). <p><u>For 3-5 (b)</u></p> <ul style="list-style-type: none"> Site layouts showing the existing and final locations (where applicable) and number of the trees to be restored or conserved or relocated. <p><u>For 3-5 (c)</u></p> <ul style="list-style-type: none"> Extracts of the tender specification showing the requirements to use compost recycled from horticulture waste.
<p>Exceptions</p>	<p>TREES AND PALMS SPACING (CENTRE-TO-CENTRE)</p> <p>(a) If the selected trees and palms are to be planted at $\leq 2\text{m}$ from trunk-to-trunk as illustrated below, the leaf area shall be calculated as the product of LAI value and planted area (in m^2).</p>  <p>OLUMNAR TREES</p> <p>(b) For trees that have tight, columnar crowns, the canopy area of 12m^2 is to be adopted for calculation of leaf area. These species include, but not limited to the following:</p> <ul style="list-style-type: none"> Garciniacymosa forma pendula Garciniasubelliptica Polyalthialongifolia Carallia brachiate Gnetumgnemon
<p>References</p>	<p>The plant species, its sub categories and LAI values may be obtained from the online website: http://florafauaweb.nparks.gov.sg</p>

Worked Example 3-5(a)

- (1) Determine the number of trees, palms and the trees for shrubs and turfs and other greenery area.
- (2) The Leaf Area Index (LAI) of the individual plant species and its canopy area are predetermined design parameters applicable for all developments.
- (3) The plant species sub categories and its LAI values can be obtained from the online website: <http://florafaunaweb.nparks.gov.sg/> (see example below) by searching the common / scientific names of the plants.
- (4) Compute the green areas as shown in the Table 3-5 (a) below

Table 3-5(a) – Calculation of the Green Plot Ratio

Category	Sub category	(A)	(B)	(C)	(A)x(B)x(C)
		LAI value	Canopy area	Qty/Planted Area	Leaf Area
Trees (no.)	Open Canopy	2.5	60 m ²	0 no.	0
	Intermediate Canopy	3.0	60 m ²	8 no.	1440
	Dense Canopy	4.0	60 m ²	12 no.	2880
	Intermediate columnar canopy*	3.0	12 m ²	4 no.	144
Palms (no.)	Solitary	2.5	30 m ²	10 no.	750
	Solitary (trunk-to-trunk)	2.5	NA	20 m ²	50
	Cluster	4.0	17 m ²	10 no.	680
Shrubs (m ²)	Monocot	3.5	NA	0 m ²	0
	Dicot	4.5	NA	20 m ²	90
Turf(m ²)	Turf	2.0	NA	90 m ²	180
Vertical Greenery (m ²)	-	2.0	NA	10 m ²	20
Total Leaf Area:					6234

Note: Green roof landscaping would be calculated as per illustrated above

Assume site area is 2000 m²

$$\text{Green Plot Ratio (GnPR)} = \text{total leaf area} / \text{site area}$$

$$= 6234 / 2000 = 3.117 < 4.0$$

Where GnPR = 3.0 to < 4.0

Therefore, credits scored for 3-5(a) = 3 credit

ENRB 3-6 ENVIRONMENTAL PROTECTION

Objectives	To adopt a sustainable and environmental-friendly procurement and purchasing policy in the operation and maintenance of the building. To reduce the potential damage to the ozone layer and the increase in global warming.
Applicability	Generally applicable to all building developments.
Baseline Standard	-
Requirements	<p><u>For 3-6(a)</u></p> <ul style="list-style-type: none"> • 1 credit can be allocated for the adoption of sustainable and environmental-friendly procurement and purchasing policy in the operation and maintenance of the building. <p><u>For 3-6(b)</u></p> <ul style="list-style-type: none"> • 1 credit can be scored for the use of refrigerants with ozone depleting potential (ODP) of zero or with global warming potential (GWP) of less than 100. • 1 credit can be scored for the use of refrigerant leak detection system at critical areas of plant rooms containing chillers and other equipment with refrigerants.
Documentary Evidences	<p><u>For 3-6(a)</u></p> <ul style="list-style-type: none"> • Building's current green procurement policy documents to demonstrate environmental preferable services (operation and maintenance) <p><u>For 3-6(b)</u></p> <ul style="list-style-type: none"> • Technical information of the current refrigerants incorporated in the building showing the ODP and GWP values. (If available) • Layout plan showing how the refrigerant leak detection system works and a description of the plan.
References	-

ENRB 3-7 GREEN TRANSPORT

Objectives	Promote environmental friendly transport options and facilities to reduce pollution from individual car use.
Applicability	Generally applicable to all building developments.
Baseline Standard	-
Requirements	<p>3-7(a) 1 credit can be scored for design that provides good access (< 800m walking distance) to public transport networks such as MRT/LRT stations and bus stops.</p> <p>3-7(b) 1 credit can be scored for provision of covered walkway to facilitate connectivity and the use of public transport.</p> <p>3-7(c) 1 credit can be scored for provision of electric vehicle charging stations and priority parking lots for electricity vehicle within the development.</p> <p>3-7(d) Up to 1 credit can be scored for the provision of covered/ sheltered bicycles parking lots. Minimum 10 numbers and maximum 50 numbers of bicycle parking lots.</p>
Documentary Evidences	<p><u>For 3-7(a)</u></p> <ul style="list-style-type: none"> • Site layout plan in the context of the surrounding area showing the location of the development site and the location of the MRT/LRT stations and bus stops. <p><u>For 3-7(b)</u></p> <ul style="list-style-type: none"> • Plans layout outside the building showing the walkway to facilitate connectivity. • Other relevant documents (Optional). <p><u>For 3-7(c)</u></p> <ul style="list-style-type: none"> • Plans layout showing the location of parking lots for electricity vehicle. • Other relevant documents (Optional). <p><u>For 3-7(d)</u></p> <ul style="list-style-type: none"> • Plans layout showing the bicycles parking lots for the development. • Calculation of the bicycle lots allocated in the development. (If applicable) • Other relevant documents (Optional).

(II) Other Green Requirements

Part 4 – Indoor Environment Quality

ENRB 4-1 Indoor Air Quality Performance

ENRB 4-2 Indoor Air Pollutants

ENRB 4-3 Lighting Quality

ENRB 4-4 Thermal Comfort

ENRB 4-5 Internal Noise Level

ENRB 4-1 INDOOR AIR QUALITY PERFORMANCE

Objectives	To promote a healthy indoor environment for occupant																																																																					
Applicability	Generally applicable to all building developments.																																																																					
Baseline Standard	<p>Indoor Air Contaminants Parameters:</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="width: 60%;">Physical Parameters</th> <th colspan="3">Acceptable Range</th> </tr> </thead> <tbody> <tr> <td>Air Temperature</td> <td colspan="3" style="text-align: center;">23-26 °C</td> </tr> <tr> <td>Relative Humidity</td> <td colspan="3" style="text-align: center;">50-70%</td> </tr> <tr> <td>Air Movement</td> <td colspan="3" style="text-align: center;">0.15-0.5 m/s</td> </tr> <tr> <th rowspan="2">Chemical Contaminants</th> <th colspan="3">Acceptable Limits</th> </tr> <tr> <th>ppm</th> <th>mg/m³</th> <th>Cfu/m³</th> </tr> <tr> <td>Carbon Monoxide</td> <td style="text-align: center;">10</td> <td style="text-align: center;">-</td> <td style="text-align: center;">-</td> </tr> <tr> <td>Formaldehyde</td> <td style="text-align: center;">0.1</td> <td style="text-align: center;">-</td> <td style="text-align: center;">-</td> </tr> <tr> <td>Ozone</td> <td style="text-align: center;">0.05</td> <td style="text-align: center;">-</td> <td style="text-align: center;">-</td> </tr> <tr> <td>Respirable particulates</td> <td style="text-align: center;">-</td> <td style="text-align: center;">0.15</td> <td style="text-align: center;">-</td> </tr> <tr> <td>Total volatile organic compounds (TVOC)</td> <td style="text-align: center;">3</td> <td style="text-align: center;">-</td> <td style="text-align: center;">-</td> </tr> <tr> <th rowspan="2">Biological Contaminants</th> <th colspan="3">Acceptable Limits</th> </tr> <tr> <th>ppm</th> <th>mg/m³</th> <th>Cfu/m³</th> </tr> <tr> <td>Total Bacteria Counts</td> <td style="text-align: center;">-</td> <td style="text-align: center;">-</td> <td style="text-align: center;">500</td> </tr> <tr> <td>Total Fungal Counts</td> <td style="text-align: center;">-</td> <td style="text-align: center;">-</td> <td style="text-align: center;">1000</td> </tr> <tr> <th rowspan="2">Ventilation Performance Indicator</th> <th colspan="3">Acceptable Limits</th> </tr> <tr> <th>ppm</th> <th>mg/m³</th> <th>Cfu/m³</th> </tr> <tr> <td>Carbon Dioxide</td> <td style="text-align: center;">C1000</td> <td style="text-align: center;">-</td> <td style="text-align: center;">-</td> </tr> </tbody> </table> <p>Notes:</p> <ul style="list-style-type: none"> • For chemical contaminants, the limits are eight-hour time-weighted average airborne concentrations. • mg/m³ is milligrams per cubic meter of air at 25° Celsius and one atmosphere pressure. • ppm is parts of vapour or gas per million parts of contaminated air by volume. • cfu/m³ is colony forming units per cubic meter. • C is the ceiling limit that shall not be exceeded at any time. Readings above 1000ppm are indication of inadequate ventilation. • Excess of bacterial counts does not necessarily imply health risk but serve as an indicator for further investigation. 	Physical Parameters	Acceptable Range			Air Temperature	23-26 °C			Relative Humidity	50-70%			Air Movement	0.15-0.5 m/s			Chemical Contaminants	Acceptable Limits			ppm	mg/m ³	Cfu/m ³	Carbon Monoxide	10	-	-	Formaldehyde	0.1	-	-	Ozone	0.05	-	-	Respirable particulates	-	0.15	-	Total volatile organic compounds (TVOC)	3	-	-	Biological Contaminants	Acceptable Limits			ppm	mg/m ³	Cfu/m ³	Total Bacteria Counts	-	-	500	Total Fungal Counts	-	-	1000	Ventilation Performance Indicator	Acceptable Limits			ppm	mg/m ³	Cfu/m ³	Carbon Dioxide	C1000	-	-
Physical Parameters	Acceptable Range																																																																					
Air Temperature	23-26 °C																																																																					
Relative Humidity	50-70%																																																																					
Air Movement	0.15-0.5 m/s																																																																					
Chemical Contaminants	Acceptable Limits																																																																					
	ppm	mg/m ³	Cfu/m ³																																																																			
Carbon Monoxide	10	-	-																																																																			
Formaldehyde	0.1	-	-																																																																			
Ozone	0.05	-	-																																																																			
Respirable particulates	-	0.15	-																																																																			
Total volatile organic compounds (TVOC)	3	-	-																																																																			
Biological Contaminants	Acceptable Limits																																																																					
	ppm	mg/m ³	Cfu/m ³																																																																			
Total Bacteria Counts	-	-	500																																																																			
Total Fungal Counts	-	-	1000																																																																			
Ventilation Performance Indicator	Acceptable Limits																																																																					
	ppm	mg/m ³	Cfu/m ³																																																																			
Carbon Dioxide	C1000	-	-																																																																			
Requirements	<p>4-1(a) Up to 4 credits will be given for conducting a full IAQ audit once every 3 years to comply with the Code of Practice on Indoor Air Quality Department of Occupational Safety and Health, Ministry of Human Resources Malaysia (2005).</p> <p>4-1(b) 1 credit for the implementation of effective IAQ management plan to ensure building ventilation systems are frequently maintained.</p> <p>4-1(c) 1 credit for the use of high efficient filter (at least MERV 13) in AHU to reduce indoor contaminations and provide good protection for cooling coil and reducing frequency or eliminating duct cleaning</p> <p>4-1(d) 1 credit for providing room temperature display (at least 1 unit per floor)</p> <p>4-1(e) 1 credit for additional carbon dioxide sensor display (at least 1 unit per Floor).</p>																																																																					

Prerequisite	To conduct a full IAQ audit once every 3 years to comply with the Code of Practice on Indoor Air Quality Department of Occupational Safety and Health, Ministry of Human Resources Malaysia (2005).
Documentary Evidences	<p><u>For 4-1(a):</u></p> <ul style="list-style-type: none"> • Most recent IAQ audit report highlighting the parameters that contributes to indoor air quality performance • Most recent IAQ assessment report with the results of the building air quality <p><u>For 4-1(b):</u></p> <ul style="list-style-type: none"> • Provision of IAQ Management Plan which evaluates overall building ventilation system using checklist and any comparable methods <p><u>For 4-1(c):</u></p> <ul style="list-style-type: none"> • Technical product specification of the filter that is implemented in the AHU. • Layout plan to show the location of the AHU in the building. <p><u>For 4-1(d):</u></p> <ul style="list-style-type: none"> • Layout plan for every floor showing the location of the room temperature of the building. <p><u>For 4-1(e):</u></p> <ul style="list-style-type: none"> • Layout plan for every floor showing the location of the carbon dioxide sensor display of the building. • Technical Product specification for that CO₂ sensor.
References	Code of Practice on Indoor Air Quality Department of Occupational Safety and Health, Ministry of Human Resources Malaysia

ENRB 4-2 INDOOR AIR POLLUTANTS

Objectives	Minimise airborne contaminants, mainly from inside sources to promote a healthy indoor environment.
Applicability	Generally applicable to all building developments.
Baseline Standard	-
Requirements	<p>4-2(a) 1 credit can be scored for the use of low volatile organic compounds (VOC) paints certified under local/international certification body for at least 90% of the internal wall areas.</p> <p>4-2(b) 1 credit can be scored for the use adhesives certified under local/international certification body in all composite wood products used for the development.</p>
Documentary Evidences	<p><u>For 4-2(a)</u></p> <ul style="list-style-type: none"> • Most recent IAQ report showing the level of VOC measured at the sampling point. <p><u>For 4-2(b)</u></p> <ul style="list-style-type: none"> • Most recent IAQ report showing the level of formaldehyde measured at the sampling point.
References	-

ENRB 4-3 LIGHTING QUALITY

Objectives	To encourage good workplace lighting quality to promote productivity and occupants comfort												
Applicability	Generally applicable to all building developments.												
Baseline Standard	Luminance level stated in MS 1525:2014 – Energy Efficient and use of renewable energy for non-residential buildings – Code of Practice.												
Requirements	<p><u>4-3(a) Lighting level to comply with MS 1525:2014</u></p> <ul style="list-style-type: none"> 1 credit will be provided if the lighting level comply with MS 1525:2014. <p><u>4-3(b) Controllability of the lighting system</u></p> <ul style="list-style-type: none"> Up to 2 credits will be given if at least 90% of the occupants are able to adjust lighting to suit their need and preference. <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <td>Controlled by light switches</td> <td>1 credit</td> </tr> <tr> <td>Controlled by task lights</td> <td>2 credits</td> </tr> </table> <p><u>4-3(c) High Frequency Ballast</u></p> <p>Up to 2 credits will be given if all applicable areas in the entire building are served with fluorescent tubes using high frequency ballast.</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <tr> <td>20% to < 40%</td> <td>0.5 credit</td> </tr> <tr> <td>40% to < 60%</td> <td>1 credit</td> </tr> <tr> <td>60% to < 80%</td> <td>1.5 credits</td> </tr> <tr> <td>80% and above</td> <td>2 credits</td> </tr> </table>	Controlled by light switches	1 credit	Controlled by task lights	2 credits	20% to < 40%	0.5 credit	40% to < 60%	1 credit	60% to < 80%	1.5 credits	80% and above	2 credits
Controlled by light switches	1 credit												
Controlled by task lights	2 credits												
20% to < 40%	0.5 credit												
40% to < 60%	1 credit												
60% to < 80%	1.5 credits												
80% and above	2 credits												
Documentary Evidences	<p><u>For 4-3(a):</u></p> <ul style="list-style-type: none"> Schedule showing the current lighting levels on the building areas. Technical product specification of the lights used in the building. <p><u>For 4-3(b):</u></p> <ul style="list-style-type: none"> Electrical Schematic drawings showing the locations of the controllable switches/task lights. Layout plan/floor plan of the building showing the building lighting areas. <p><u>For 4-3(c):</u></p> <ul style="list-style-type: none"> A summary sheet listing all fluorescent luminaries used for the developments and those with high frequency ballasts; and Technical Product information on the fluorescent luminaries used in the building. (If applicable) 												
References	Luminance level stated in MS 1525:2014 - Energy Efficient and use of renewable energy for non-residential buildings – Code of Practice.												

ENRB 4-4 THERMAL COMFORT

Objectives	Recognise buildings that are designed with good thermal comfort.
Applicability	Generally applicable to all building developments with air-conditioning systems.
Baseline Standard	<ul style="list-style-type: none"> • Indoor dry-bulb temperature within 23°C to 26°C • Relative humidity between 50% to 70%
Requirements	<p>4-4(a) 1 credit can be scored by ensuring the consistent indoor conditions for thermal comfort:</p> <p>4-4(b) 1 credit can be scored by giving the flexibility of temperature controllability.</p>
Documentary Evidences	<p><u>For 4-4(a)</u></p> <ul style="list-style-type: none"> • Latest IAQ report highlighting the average indoor dry-bulb temperature and relative humidity from time to time. <p><u>For 4-4(b)</u></p> <ul style="list-style-type: none"> • Layout plan showing the location of the temperature control equipment. • Technical product specification of the temperature control device.
References	“Code of Practice on Indoor Air Quality”(2005), Department of Occupational Safety and Health, Ministry of Human Resources Malaysia

ENRB 4-5 INTERNAL NOISE LEVEL

Objectives	Recognise buildings that are designed to control and keep the background noise in occupied spaces at levels appropriate to the intended use of the spaces.
Applicability	Generally applicable to all building developments.
Baseline Standard	“The Planning Guidelines for Environmental Noise Limits and Control “ – Department of Environmental Malaysia, Ministry of Natural Resource and Environmental Malaysia.
Requirements	1 credit can be scored by ensuring internal noise levels are maintained at an appropriate level and to comply with The Planning Guidelines for Environmental Noise Limits and Controls (Department of Environmental Malaysia).
Documentary Evidences	<ul style="list-style-type: none">• Detailed analysis and/or measurements to ensure that internal noise level are maintained.• Audit report highlighting the internal noise level of the building.
References	“The Planning Guidelines for Environmental Noise Limits and Control “ – Department of Environmental Malaysia, Ministry of Natural Resource and Environmental Malaysia

(II) Other Green Requirement

Part 5 – Other Green Features

ENRB 5-1 GREEN FEATURES & INNOVATIONS

Objectives	Encourage the use of green features which are innovative and have positive environmental impact on water efficiency, environmental protection and indoor environmental quality of the buildings.
Applicability	Generally applicable to all building developments.
Baseline Standard	-
Requirements	<p>Up to 10 credits are awarded for the use of the following green features depending on their potential environmental benefits or reduced environmental impacts.</p> <p><u>Water efficiency</u></p> <ul style="list-style-type: none"> i. Use of self cleaning façade system <ul style="list-style-type: none"> • 2 credits for more than 75% of the external walls. • 1 credit for more than 50% of the external walls. • 0.5 credit for at least 25% of the external walls. ii. Use of grey water recycling system <ul style="list-style-type: none"> • 2 credits for all blocks of the development. • 1 credit for at least one block of the development. iii. Recycling of AHU condensate <ul style="list-style-type: none"> • 1 credit for more than 75% of the AHU condensate • 0.5 credit for at least of 50% of the AHU condensate iv. 0.5 credit for the use of non-chemical water treatment for cooling tower. <p><u>Environmental Protection</u></p> <ul style="list-style-type: none"> i. Provision of green roof and roof top garden <ul style="list-style-type: none"> • 1 credit for more than 50% of the roof areas • 0.5 credit for at least 25% of the roof areas ii. Provision of vertical greening <ul style="list-style-type: none"> • 1 credit for more than 50% of the external wall areas • 0.5 credit for at least 25% of the roof areas iii. 1 credit for the provision of double refuse shuts for separating recyclable from non-recyclable waste iv. 0.5 credit for the use of non-chemical treatment system such as termite baiting system, anti-termite mesh.

	<p><u>Indoor Air Quality</u></p> <ul style="list-style-type: none"> i. Use of Titanium Dioxide solutions to remove odour in toilets: <ul style="list-style-type: none"> • 1 credit for more than 50% of all toilets • 0.5 credit for at least 25% of all toilets ii. 1 credit for the use of pneumatic waste collection system. iii. 0.5 credit for the use of Ultraviolet light-C band (UV) emitters in all air handling units (AHUs) to improve indoor air quality. <p><u>Others</u></p> <ul style="list-style-type: none"> i. Provision of landscape drainage and infiltration trenches: <ul style="list-style-type: none"> • 1 credit for at least 25% of the green areas • 0.5 credit for less than 25% of the green areas ii. Provision of system to recycle surface runoff from the vertical green wall and sky garden: <ul style="list-style-type: none"> • 1 credit for at least 25% of green areas • 0.5 credit for less than 25% green areas iii. 0.5 credit for the use of siphonic rainwater discharge system at roof. iv. 0.5 credit for the provision of eco-pond. v. 0.5 credit for the provision of carpark guidance system. <p>Note: For features that are not listed above, the QP is required to submit the details showing the positive environmental impacts, possible savings and benefits of the proposed features to GreenRE for assessment.</p>
<p>Documentary Evidences</p>	<ul style="list-style-type: none"> • Plan Layout of the other green features used where applicable; • Technical product information (including drawings and supporting documents) of the green features; • A summary sheet listing the breakdown and the extent of implementation as well as the total requirements for the same intended purpose for the specific green features used. • Quantified evidence on the potential environmental benefits that the features that can bring to the development.
<p>References</p>	<p>-</p>

(II) Other Green Requirement

Part 6 – Carbon Emission of Development

ENRB 6-1 CARBON EMISSION OF DEVELOPMENT

Objectives	To calculate the carbon emission resulted from the associated energy used during operational phase of a development.																																									
Applicability	Generally applicable to all building development.																																									
Baseline Standard	-																																									
Requirements	Up to 4 credits can be scored for the calculation of the carbon footprint report of the building comprising of energy and water consumption savings with comparison of the baseline parameters. Credits scored = 0.1 x (% improvement)																																									
Documentary Evidences	<ul style="list-style-type: none"> • Electricity bill of the development for the year • Water bill of the development for the year • Carbon footprint calculation 																																									
References	-																																									
Worked Example 6-1	<p>Energy Consumption</p> <table border="1" style="margin-left: 40px;"> <thead> <tr> <th style="border: none;">Type of usage</th> <th style="border: none;">Design (kWh/yr)</th> <th style="border: none;">Baseline (kWh/yr)</th> </tr> </thead> <tbody> <tr> <td>Lighting</td> <td>819,498</td> <td>1,151,575</td> </tr> <tr> <td>Air-Conditioning</td> <td>860,589</td> <td>1,406,899</td> </tr> <tr> <td>M/V System</td> <td>25,550</td> <td>25,550</td> </tr> <tr> <td>Total Energy Usage</td> <td>1,705,637</td> <td>2,584,024</td> </tr> </tbody> </table> <p>Water Consumption</p> <table border="1" style="margin-left: 40px;"> <thead> <tr> <th style="border: none;">Type of fixtures</th> <th style="border: none;">Design (m³/yr)</th> <th style="border: none;">Baseline (m³/yr)</th> </tr> </thead> <tbody> <tr> <td>Flow Fixtures</td> <td>2,402</td> <td>6,899</td> </tr> <tr> <td>Flush Fixtures</td> <td>5,366</td> <td>5,161</td> </tr> <tr> <td>Total Water Usage</td> <td>7,768</td> <td>12,060</td> </tr> </tbody> </table> <p>Carbon Footprint</p> <table border="1" style="margin-left: 40px;"> <thead> <tr> <th style="border: none;">Type of usage</th> <th style="border: none;">Design kgCO₂e/yr</th> <th style="border: none;">Baseline kgCO₂e/yr</th> </tr> </thead> <tbody> <tr> <td>Energy</td> <td>1,226,619</td> <td>1,860,497</td> </tr> <tr> <td>Water</td> <td>155,344</td> <td>241,192</td> </tr> <tr> <td>Total Annual Carbon Footprint</td> <td>1,381,963</td> <td>2,101,689</td> </tr> </tbody> </table> <p>*CO₂ conversion factor for energy = 0.72, water = 0.02. Please use up-to-date CO₂ conversion factor for both energy and water.</p> <p>Percentage savings = (2,101,689 - 1,381,963) / 2,101,689 = 34.25%</p> <p>Credits scored for 6-1 (a) = 0.1 x 34.25% = 3.43 credits</p>			Type of usage	Design (kWh/yr)	Baseline (kWh/yr)	Lighting	819,498	1,151,575	Air-Conditioning	860,589	1,406,899	M/V System	25,550	25,550	Total Energy Usage	1,705,637	2,584,024	Type of fixtures	Design (m ³ /yr)	Baseline (m ³ /yr)	Flow Fixtures	2,402	6,899	Flush Fixtures	5,366	5,161	Total Water Usage	7,768	12,060	Type of usage	Design kgCO ₂ e/yr	Baseline kgCO ₂ e/yr	Energy	1,226,619	1,860,497	Water	155,344	241,192	Total Annual Carbon Footprint	1,381,963	2,101,689
Type of usage	Design (kWh/yr)	Baseline (kWh/yr)																																								
Lighting	819,498	1,151,575																																								
Air-Conditioning	860,589	1,406,899																																								
M/V System	25,550	25,550																																								
Total Energy Usage	1,705,637	2,584,024																																								
Type of fixtures	Design (m ³ /yr)	Baseline (m ³ /yr)																																								
Flow Fixtures	2,402	6,899																																								
Flush Fixtures	5,366	5,161																																								
Total Water Usage	7,768	12,060																																								
Type of usage	Design kgCO ₂ e/yr	Baseline kgCO ₂ e/yr																																								
Energy	1,226,619	1,860,497																																								
Water	155,344	241,192																																								
Total Annual Carbon Footprint	1,381,963	2,101,689																																								

4. Documentation Requirements

All documents submitted for the REHDA GreenRE Assessment should be duly verified and signed by the Qualified Person (QP) and appropriate practitioners where applicable.

The documentation required for ventilation simulation and energy modelling should also be endorsed by the QP and appropriate practitioners as part of the documentary evidences for certification.

Table: Summary Checklist and the Corresponding Signatories for GreenRE Existing Non-Residential Criteria

GreenRE Criteria	Required Signatories
Part 1 – Energy Efficiency	
ENRB 1-1 Thermal Performance of Building Envelope-OTTV	PA
ENRB 1-2 Air-Conditioning System	PE
ENRB 1-3 Natural Ventilation/ Mechanical Ventilation	PA/PE
ENRB 1-4 Artificial Lighting	PE
ENRB 1-5 Ventilation in Carparks	PA
ENRB 1-6 Ventilation in Common Areas	PA
ENRB 1-7 Lifts and Escalators	PE
ENRB 1-8 Energy Efficient Practices & Features <ul style="list-style-type: none"> • Heat Recovery Devices • Motion Sensors/ Photo Sensors • Others 	PE PE S
ENRB 1-9 Energy Policy & Management	FM
ENRB 1-10 Renewable Energy	S
Part 2 – Water Efficiency	
ENRB 2-1 Water Usage and Leak Detection	PE/FM
ENRB 2-2 Water Efficient Fittings	PA/FM
ENRB 2-3 Alternative Water Sources	PE
ENRB 2-4 Water Efficiency Improvement Plans	FM
ENRB 2-5 Irrigation System and Landscaping	PE
ENRB 2-6 Water Consumption of Cooling towers	PE
Part 3 – Sustainable Operation & Management	
ENRB 3-1 Building Operation & Maintenance	FM
ENRB 3-2 Post Occupancy Evaluation	FM
ENRB 3-3 Waste Management	FM
ENRB 3-4 Sustainable Products	PA/FM
ENRB 3-5 Greenery Provision	PA
ENRB 3-6 Environmental Protection	PE
ENRB 3-7 Green Transport	PA
Part 4 – Indoor Environmental Quality	
ENRB 4-1 Indoor Air Quality Performance	S
ENRB 4-2 Indoor Air Pollutants	S
ENRB 4-3 Lighting Quality	PE
ENRB 4-4 Thermal Comfort	S
ENRB 4-5 Internal Noise Level	S
Part 5 – Other Green Features	
ENRB 5-1 Green Features & Innovations	S
Part 6 – Carbon Emission of Development	
ENRB 6-1 Carbon Emission of Development	S

1. PA refers to Professional Architect, Landscape Architect
2. PE refers to Professional Engineer, Planner and Quantity Surveyor (QS)
3. FM refers to Facility Manager.
4. S refers to Specialist which includes Facilitator, Project Manager, Energy or Sustainable consultant and Commissioning Specialist.