



# **DESIGN REFERENCE GUIDE**

## **Industrial Facilities**

Version 1.1

January 2024

# Contents

<b>1. About GreenRE</b> .....	<b>1</b>
<b>2. Introduction</b> .....	<b>2</b>
<b>3. Revision Log</b> .....	<b>2</b>
<b>4. GreenRE Assessment Stages</b> .....	<b>3</b>
<b>5. GreenRE Industrial Facilities Rating System</b> .....	<b>4</b>
<b>6. GreenRE Industrial Facilities Rating System Scoring</b> .....	<b>7</b>
<b>7. GreenRE Industrial Facilities Rating System Criteria</b> .....	<b>8</b>

## 1. About GreenRE

GreenRE Sdn Bhd is a wholly owned subsidiary of the Real Estate and Housing Development Association (REHDA). The GreenRE rating tool has been developed for the purposes as mentioned herein and may be subject to updating and/or modification in the future.

Any sale, modification, reproduction, display or distribution of GreenRE criteria or any copies thereof is not allowed without GreenRE Sdn Bhd's prior written consent. This may be obtained in writing to the following address or via email to [info@greenre.org](mailto:info@greenre.org)

GreenRE Sdn Bhd  
Wisma Rehda,  
No.2C, Jalan SS5/6D,  
47301 Petaling Jaya,  
Selangor, Malaysia

## 2. Introduction

The GreenRE assessment scheme was established in 2013 and is a recognized green building rating system tailored for the tropical climate. GreenRE sets parameters and establishes indicators to guide the design, construction and operation of buildings towards increased energy effectiveness and enhanced environmental performance.

The intent of this Design Reference Guide for Industrial Facilities (referred to as “this Guideline”) is to establish environmentally friendly practices for the planning, design and construction of buildings, which would help to mitigate the environmental impact of built structures.


This Guideline is not intended to abridge safety, health, environmental or related requirements contained in other applicable laws, codes or policies administered by relevant authorities. Where there is a conflict between a requirement of this Guideline and such other regulations affecting the design, construction and operation of the project, the building regulations shall take precedence.

## 3. Revision Log

Revision	Description	Date Effective
1.0	Issued for Implementation	22 <sup>nd</sup> November 2018
1.1	Issued for Implementation	June 2023
1.1	Revised for Implementation	January 2024

## 4. GreenRE Assessment Stages

The GreenRE Industrial Facilities certification process is as follows:

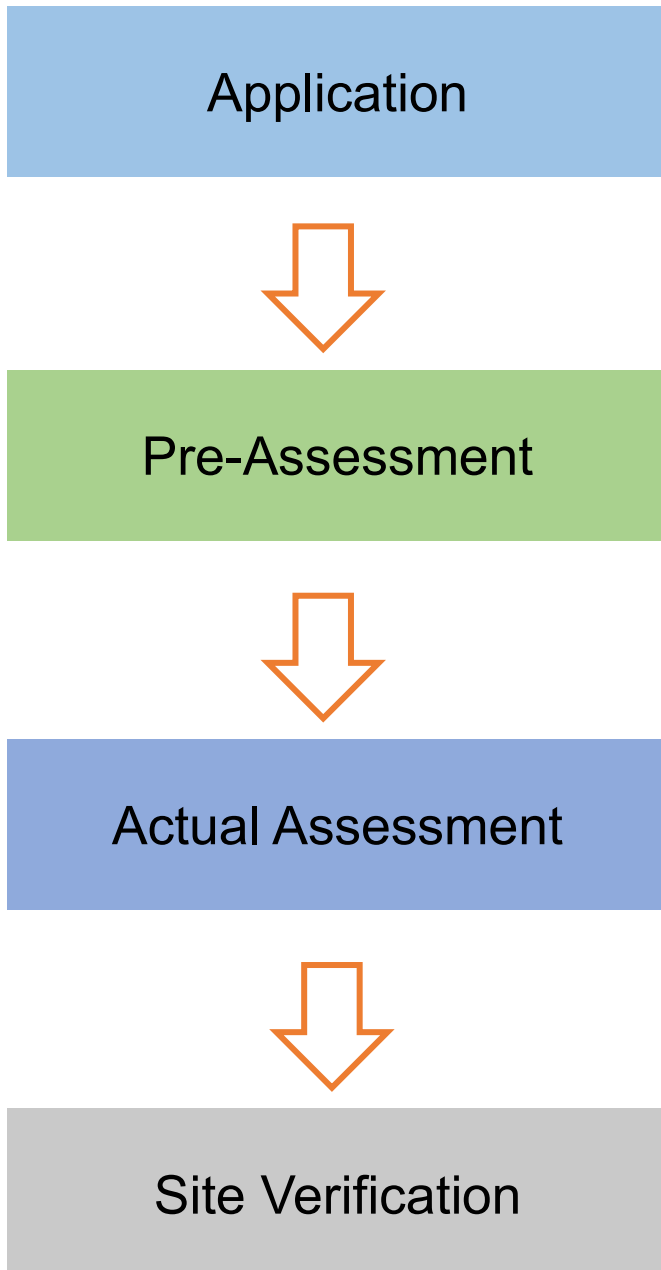

Submittal of application with relevant supporting documents for certification upon strategic inception of infrastructure project.

A pre-assessment can be conducted (optional) to give the project team a better understanding of the criteria and evaluation of the certification level sought. This should be performed upon selection of suitable design option to allow teams to identify and maximise opportunities at the earliest stages of the project.

Actual assessment to be conducted once the design and documentary evidences (e.g. approved plan) are ready. After the actual assessment, our assessors will review the documents submitted.

Assessment process includes design and documentary reviews to verify if the building project meets:

- (i) The intents of the criteria
- (ii) The pre-requisite requirement for GreenRE Bronze, Silver, Gold and Platinum rating where applicable.

Provisional Certificate will be issued upon completion of this stage.

Site verification to be conducted upon project completion.

Final Certificate will be issued upon completion of this stage.

## 5. GreenRE Industrial Facilities Rating System

### Overview:

This design guide is to be read in conjunction with Non-Residential Building toolkit (NRBv3.1). The GreenRE industrial facilities rating system is divided into six (6) sections as follows:

Part 1 - Energy Efficiency: This category focuses on the approach that can be used in the building design and system selection to optimise the energy efficiency of buildings.

Part 2 - Water Efficiency: This category focuses on the selection of fittings and strategies enabling water use efficiency during construction and building operation.

Part 3 – Environmental Protection: This category focuses on the design, practices and selection of materials and resources that would reduce the environmental impacts of built structures.

Part 4 - Indoor Environmental Quality: This category focuses on the design strategies that would enhance the indoor environmental quality which include air quality, thermal comfort, acoustic control and daylighting.

Part 5 - Other Green Features: This category focuses on the adoption of green practices and new technologies that are innovative and have potential environmental benefits.

Part 6 - Carbon Emission of Development: This category focuses on the use of carbon calculator to calculate the carbon emission of the development.


These environment impact categories are broadly classified under two main groups namely (I) Energy Related Requirements and (II) Other Green Requirements.

Energy Related Requirements consist of Part 1- Energy Efficiency where credits are allocated for the various energy efficient designs, practices and features used. A minimum of 30 credits must be obtained from this group to be eligible for certification. The number of credits achievable for this group is capped at 50 credits (exclude 15 bonus credits that are obtainable under IND 1-14 – On-site Energy Generation).

Other Green Requirements consist of Part 2 - Water Efficiency; Part 3 - Environmental Protection; Part 4 - Indoor Environmental Quality; Part 5 - Other Green Features and Part 6 - Carbon Emission of Development. Credits are allocated for the water efficient features, environmentally friendly design practices, innovative green features used and carbon emission of development. A minimum of 20 credits must be obtained from this group to be eligible for certification. The number of credits achievable for this group is also capped at 50 credits.

The maximum GreenRE score achievable for a project is capped at 100 credits and this does not include 15 bonus credits that are obtainable under Energy Related Requirements if a project uses on-site energy generation sources.

Framework:

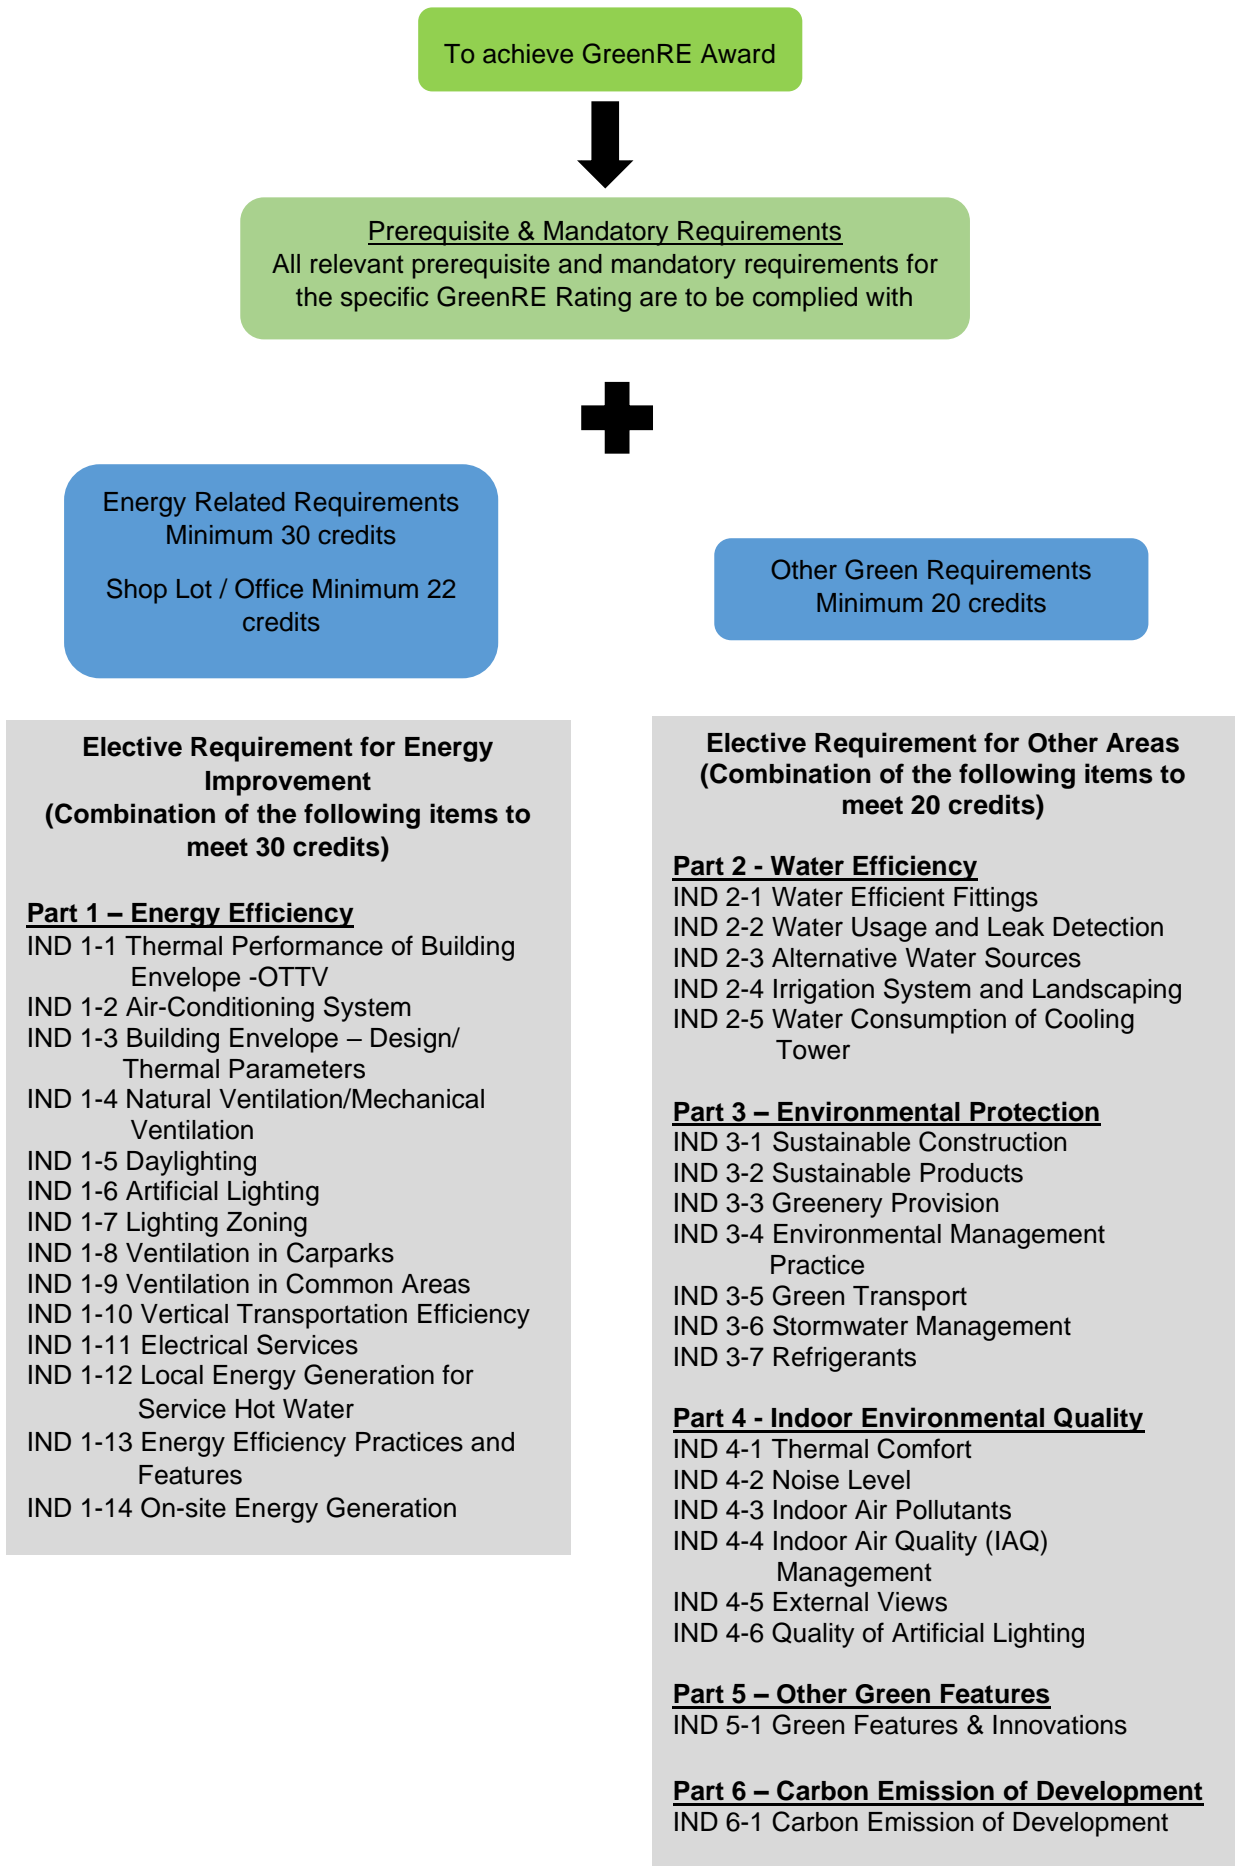

Category		Credits Allocation	
<b>(I) Energy Related Requirements</b>			
Minimum 30 credits	<b>Part 1: Energy Efficiency</b>		
	IND 1-1 Thermal Performance of Building Envelope – OTTV	Section (A) Applicable to air-cond. areas	10
	IND 1-2 Air – Conditioning System		33
	<b>Sub -Total (A) – IND 1-1 to 1-2</b>		<b>43</b>
	IND 1-3 Building Envelope – Design/ Thermal Parameters	Section (B) Applicable to non air- cond. areas	30
	IND 1-4 Natural Ventilation/Mechanical Ventilation		15
	<b>Sub – Total (B) – IND 1-3 to 1-4</b>		<b>45</b>
	IND 1-5 Daylighting	Section(C) Applicable to all areas	6
	IND 1-6 Artificial Lighting		10
	IND 1-7 Lighting Zoning		3
	IND 1-8 Ventilation in Carparks		2
	IND 1-9 Ventilation in Common Areas		5
	IND 1-10 Vertical Transportation Efficiency		1
	IND 1-11 Electrical Services		7
IND 1-12 Local Energy Generation for Service Hot Water	6		
IND 1-13 Energy Efficiency Practices and Features	10		
IND 1-14 On-site Energy Generation	16		
<b>Sub – Total (C) – IND 1-5 to 1-14</b>		<b>66</b>	
<b>Category Score for Part 1 – Energy Efficiency [Prorate Subtotal (A) + Prorate Subtotal (B)] + Subtotal (C)</b>		<b>111 (MAX)</b>	
<b>(II) Other Green Requirements</b>			
Minimum 20 credits	<b>Part 2: Water Efficiency</b>		
	IND 2-1 Water Efficient Fittings		6
	IND 2-2 Water Usage and Leak Detection		2
	IND 2-3 Alternative Water Sources		3
	IND 2-4 Irrigation System and Landscaping		3
	IND 2-5 Water Consumption of Cooling Tower		2
	<b>Category Score for Part 2 – Water Efficiency</b>		<b>16</b>
	<b>Part 3: Environmental Protection</b>		
	IND 3-1 Sustainable Construction		10
	IND 3-2 Sustainable Products		8
	IND 3-3 Greenery Provision		8
	IND 3-4 Environmental Management Practice		10
	IND 3-5 Green Transport		5
	IND 3-6 Stormwater Management		3
	IND 3-7 Refrigerants		2
	<b>Category Score for Part 3 – Environmental Protection</b>		<b>46</b>
	<b>Part 4: Indoor Environmental Quality</b>		
	IND 4-1 Thermal Comfort		2
	IND 4-2 Noise Level		2
	IND 4-3 Indoor Air pollutants		2
IND 4-4 Indoor Air Quality (IAQ) Management		2	
IND 4-5 External Views		1	
IND 4-6 Quality of Artificial Lighting		2	
<b>Category Score for Part 4: Indoor Environmental Quality</b>		<b>11</b>	
<b>Part 5: Other Green Features</b>			
IND 5-1 Green Features & Innovations		9	
<b>Category Score for Part 5: Other Green Features</b>		<b>9</b>	
<b>Part 6: Carbon Emission of Development</b>			
IND 6-1 Carbon Emission of Development		3	
<b>Category Score for Part 6: Carbon Emission of Development</b>		<b>3</b>	
<b>Category Score for Part 2 to Part 6 – Other Green Requirements</b>		<b>85</b>	
<b>GreenRE Non-Residential Building Score:</b>		<b>196 (MAX)</b>	



## 6. GreenRE Industrial Facilities Rating System Scoring

Score	Rating
91 and above	GreenRE Platinum
86 to < 90	GreenRE Gold
76 to < 85	GreenRE Silver
50 to < 75	GreenRE Bronze

## 7. GreenRE Industrial Facilities Rating System Criteria

### Pre-requisites:

#### 1. GENERAL

- Minimum score under IND 3-1 Sustainable Construction  
GreenRE Gold  $\geq 3$  credits  
GreenRE Platinum  $\geq 5$  credits
- Minimum score under IND 3-2 Sustainable Products  
GreenRE Gold  $\geq 3$  credits  
GreenRE Platinum  $\geq 4$  credits
- To be eligible for GreenRE Platinum Rating, roof of entire facility to be solar panel installation ready. Appropriate roof pitch (5-30 degrees tilt from horizontal), static loads, mounting system, and roof access to be considered.

#### 2. ENERGY EFFICIENCY COMPLIANCE

Projects shall demonstrate the stipulated performance through either option listed below:

##### Option 1 - Minimum System Efficiency (Fixed Metrics)

Minimum Design System Efficiency/Operating System Efficiency (DSE/OSE)

(i) For buildings using Water-Cooled Chilled Water Plant

GreenRE Rating	Building Cooling Load (RT)	
	< 500	$\geq 500$
	Efficiency (kW/RT)	
Bronze	0.85	0.75
Silver	0.80	0.70
Gold	0.75	0.68
Platinum	0.70	0.65

(ii) For buildings using Air-Cooled Chilled Water Plant or Unitary Air-Conditioner

GreenRE Rating	Building Cooling Load (RT)	
	< 500	$\geq 500$
	Efficiency (kW/RT)	
Bronze	1.1	1.0
Silver	1.0	1.0
Gold	0.85	Case by case(i)
Platinum	0.78	

For building with building cooling load of more than 500RT, the use of air cooled central chilled water plant or other unitary air-conditioners are not encouraged for Gold and Platinum ratings. In general, the system efficiency of the air cooled central chilled-water plant and other unitary air-conditioners are to be comparable with the stipulated efficiency for water-cooled central chilled-water plant. Buildings that are designed with air cooled systems and for higher GreenRE rating will be assessed on a case-by-case basis.

Note: The performance of the overall air-conditioning system for the building is based on the Operating System Efficiency (OSE) of the system during normal building operating hours.

### Option 2 – Energy Savings

To demonstrate the stipulated energy savings over its reference model using an energy modelling for Gold & Platinum / calculation for Bronze & Silver as follow;

Energy Savings (including process load):

GreenRE Rating	Energy Saving Required (%)
Bronze	5
Silver	15
Gold	25
Platinum	30

Energy Savings (excluding process load):

GreenRE Rating	Energy Saving Required (%)
Bronze	15
Silver	25
Gold	45
Platinum	50

### **3. CHILLER PLANT M&V INSTRUMENTATION**

- Provision of permanent measuring instruments for monitoring of water-cooled chilled-water system and air-cooled chilled water system operating system efficiency. The installed instrumentation shall have the capability to calculate resultant plant operating system efficiency (i.e. kW/RT) within 5% of its true value and in accordance with ASHRAE Guide 22 and AHRI 550/590. Heat balance test for water-cooled chilled water system is required for verification of the accuracy of the Measurement and Verification (M&V) instrumentation.

#### **4. NON-AIR-CONDITIONED BUILDINGS**

- To be eligible for GreenRE Platinum Rating, ventilation simulation must be carried out to identify the most effective building design and layout. The simulation results and the recommendations derived are to be implemented to ensure good natural ventilation. Details and submission requirements on ventilation simulation can be found in Appendix B of this Guideline.
- To be eligible for GreenRE Platinum Rating, roof of entire facility to be solar panel installation ready. Appropriate roof pitch (5-30 degrees tilt from horizontal), static loads, mounting system and roof access to be considered.

Mandatory Requirements:

**1. Building Envelope – OTTV**

- The OTTV of the building envelope for a building, having a **total air-conditioned area exceeding 1000 m<sup>2</sup> and above should not exceed 50 W/m<sup>2</sup>.**

**2. Roof**

- In the **case of an air-conditioned building**, the concept of Roof Thermal Transfer Value (RTTV) is applied if the roof is provided with skylight and the entire enclosure below is fully air-conditioned.
- For roofs with skylight, the maximum required RTTV is 25 W/m<sup>2</sup>.

**3. Roof – U-Value**

- **The roof of a conditioned space** shall not have a thermal transmittance (U-Value) greater than that tabulated in Table 2-1.

**Table 2-1 Maximum U-Value for Roof (W/m<sup>2</sup>K)**

Roof Weight Group	Maximum U-Value (W/m <sup>2</sup> K)
Light (Under 50 kg/m <sup>2</sup> )	0.4
Heavy (Above 50 kg/m <sup>2</sup> )	0.6

- **The roof of a non-airconditioned** space shall either comply to Table 2-1 or the ceiling surface should be low-e (emissivity 0.1 or lower) facing down.

**4. EMS System**

- To install Energy Management System where air-conditioned space is greater than 4000m<sup>2</sup>.

Part 1 - Energy Efficiency	GreenRE Credits								
<b>(A) Applicable to Air-Conditioned Building Area (with an aggregate air-conditioned areas &gt; 1000m<sup>2</sup>)</b>									
<p><b><u>IND 1-1 THERMAL PERFORMANCE OF BUILDING ENVELOPE - OTTV</u></b></p> <p>Enhance overall thermal performance of building envelope to minimise heat gain thus reducing the overall cooling load requirement.</p> <p><u>Baseline:</u> Maximum permissible OTTV = 50 W/m<sup>2</sup></p>	<p>2 credits for every reduction of 1 W/m<sup>2</sup> in OTTV from the baseline.</p> <p>Credits scored = <math>100 - [2 \times (\text{OTTV})]</math> where <math>\text{OTTV} \leq 50 \text{ W/m}^2</math></p> <p>(Up to 10 credits)</p>								
<p><b><u>IND 1-2 AIR-CONDITIONING SYSTEM</u></b></p> <p>Applicable to Air-conditioned Building Areas (with an aggregate air-conditioned areas &gt; 1000m<sup>2</sup>)</p> <p>Encourage the use of better efficiency air-conditioned equipment to minimize the energy consumption. (System efficiency in kW/ton)</p> <p><u>(a) Water-Cooled Chilled-Water Plant:</u></p> <ol style="list-style-type: none"> <li>i. Water-Cooled Chiller</li> <li>ii. Chilled water pump</li> <li>iii. Condenser water pump</li> <li>iv. Cooling tower</li> </ol> <table border="1" data-bbox="209 1480 783 1832"> <thead> <tr> <th rowspan="2">Baseline</th> <th colspan="2">Building Cooling Load</th> </tr> <tr> <th>&lt; 500 RT</th> <th>≥ 500 RT</th> </tr> </thead> <tbody> <tr> <td><u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant</td> <td>0.85 kW/RT</td> <td>0.75 kW/RT</td> </tr> </tbody> </table> <p style="text-align: center;"><b>OR</b></p>	Baseline	Building Cooling Load		< 500 RT	≥ 500 RT	<u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant	0.85 kW/RT	0.75 kW/RT	<p><u>(a) Water-Cooled Chilled-Water Plant:</u></p> <div style="border: 1px solid black; padding: 5px; text-align: center; margin: 10px auto; width: fit-content;"> <b>Building cooling load &lt; 500RT</b> </div> <p>14 credits for achieving plant efficiency of 0.85 kW/ton</p> <p>0.3 credit for every percentage improvement in the chiller plant efficiency better than 0.85 kW/ton</p> <p>Credit scored = <math>0.3 \times (\% \text{ improvement})</math></p> <div style="border: 1px solid black; padding: 5px; text-align: center; margin: 10px auto; width: fit-content;"> <b>Building cooling load ≥ 500RT</b> </div> <p>14 credits for achieving plant efficiency of 0.75 kW/ton</p> <p>0.35 credit for every percentage improvement in the chiller plant efficiency better than 0.75 kW/ton</p> <p>Credit scored = <math>0.35 \times (\% \text{ improvement})</math></p> <p>(up to 20 credits)</p> <p style="text-align: center;"><b>OR</b></p>
Baseline		Building Cooling Load							
	< 500 RT	≥ 500 RT							
<u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant	0.85 kW/RT	0.75 kW/RT							

(b) Air Cooled Chilled-Water Plant / Unitary Air-Conditioners:

Air cooled Chilled-Water Plant:

- Air-Cooled Chiller
- Chilled Water Pump

Unitary Air-Conditioners:

- Variable Refrigerant Flow (VRF) System
- Water-Cooled Package Unit
- Single-Split Unit
- Multi-Split Unit

Baseline	Building Cooling Load	
	< 500 RT	≥ 500 RT
<u>Prerequisite Requirements</u> Minimum system efficiency of air cooled chilled water plant or unitary conditioners	1.1 kW/RT	1.0 kW/RT

Note(1): Where there is a combination of centralised air-con system with unitary air-conditioned system, the computation for the credits scored will only be based on the air-conditioning system with a larger aggregate capacity.

(c) Air Distribution system:

- Air Handling units (AHUs)
- Fan Coil Units (FCUs)

Baseline – Fan power limitation in air conditioning system

Allowable nameplate motor power	
Constant volume	Variable volume
1.7 kW/m <sup>3</sup> /s	2.4 kW/m <sup>3</sup> /s

Note (2): For buildings using district cooling system, there is no need to compute the plant efficiency under Part 1-2 (a) and (b). The credits obtained will be pro-rated based on the air distribution system efficiency under Part 1-2(c).

(b) Air Cooled Chilled-Water Plant / Unitary Air-Conditioners:

**Building cooling load < 500RT**

14 credits for achieving plant efficiency of 1.1 kW/ton

0.2 credit for every percentage improvement in the chiller plant efficiency better than 1.1 kW/ton

Credit scored = 0.2 x (% improvement)

**Building cooling load ≥ 500RT**

14 credits for achieving plant efficiency of 1.0 kW/ton

0.25 credit for every percentage improvement in the chiller plant efficiency better than 1.0 kW/ton

Credit scored = 0.25 x (% improvement)

(up to 20 credits)

(c) Air Distribution system:

0.15 credits for every percentage improvement in the air distribution system efficiency over the baseline

Credit scored = 0.15 x (% improvement)

(up to 8 credits)

(d) *Prerequisite requirements:* Provision of permanent measuring instruments for monitoring of water-cooled chilled water plant and air-cooled chilled water plant efficiency. The installed instrumentation shall have the capability to calculate resultant plant efficiency (i.e. kW/RT) within 5% of its true value and in accordance with ASHRAE Guide 22 and AHRI 550/590. The following instrumentation and installation are also required to be complied:

- Location and installation of the measuring devices to meet the manufacturer's recommendation.
- Data acquisition system to have a minimum resolution of 16 bit.
- All data logging with capability to trend at 1minute sampling time interval.
- Dedicated digital power meters shall be provided for the following groups of equipment: chiller(s), chilled water pump(s), condenser water pump(s) and cooling tower(s).
- Flow meters to be provided for chilled-water and condenser water loop and shall be of ultrasonic / full bore magnetic type or equivalent.
- Temperature sensors are to be provided for chilled water and condenser water loop and shall have an end-to-end measurement uncertainty not exceeding  $\pm 0.05^{\circ}\text{C}$  over entire measurement or calibration range. All thermo-wells shall be installed in a manner that ensures that the sensors can be in direct contact with fluid flow. Provisions shall be made for each temperature measurement location to have two spare thermo-wells located at both side of the temperature sensor for verification of measurement accuracy.

(e) *Prerequisite requirements:* Verification of central water cooled chilled-water plant instrumentation: Heat Balance – substantiating test for water cooled chilled-water plant to be computed in accordance with AHRI 550/590. The operating system efficiency and heat balance to be submitted to GreenRE upon commissioning.

Applicable only to buildings with provision of water-cooled chilled water plants

2 credits

1 credit



<p>(f) Provision of variable speed controls for chiller plant equipment such as chilled-water pumps and cooling tower fans to ensure better part-load plant efficiency.</p> <p>(g) Sensors or similar automatic control devices are used to regulate outdoor air flow rate to maintain the concentration of carbon dioxide. Indoor carbon dioxide acceptable range <math>\leq 700</math> ppm above outdoor concentration.</p>	<p>1 credit</p> <p>1 credit</p>
<p style="text-align: right;"><b>Sub-Total (A):</b></p>	<p>Sum of GreenRE credits obtained from IND 1-1 to 1-2</p>
<p style="text-align: center;"><b>Part 1-Energy Efficiency</b></p>	<p style="text-align: center;"><b>GreenRE Credits</b></p>
<p><b>(B) Applicable to Non Air-Conditioned Building Areas (with an aggregate non air-conditioned areas &gt; 10% of total floor area excluding car parks and common areas)</b></p>	
<p><b><u>IND 1-3 BUILDING ENVELOPE – DESIGN/THERMAL PARAMETERS</u></b></p>	
<p>Enhance the overall thermal performance of building envelope to minimise heat gain which would improve indoor thermal comfort and encourage natural ventilation or mechanical ventilation.</p> <p>(a) Minimum direct west facing façade through building design orientation.</p> <p>Note (3): Orientation of façade that falls within the range of 22.5° N of W and 22.5° S of W will be defined as west facing façade. Core walls for lift or staircases and toilets that are located within this range are exempted in computation.</p> <p>(b)(i) Minimum west facing window opening.</p> <p>(b)(ii) Effective sun shading provision for windows on the west façade with minimum shading of 30%.</p>	<p>Credits scored = <math>10 - [0.2 \times (\% \text{ of west facing façade areas over total façade areas})]</math></p> <p style="text-align: center;">(Up to 10 credits)</p> <p>Where there is no west facing façade, the total credits scored for this item will be <u>25 credits</u>; the IND 1-3 b (i), b (ii) and (c) as listed below will not be applicable.</p> <p>Credits scored = <math>10 - [0.1 \times (\% \text{ of west facing window areas over total west facing façade areas})]</math></p> <p>Credits scored = <math>0.1 \times (\% \text{ of west facing window areas with sun shading devices over</math></p>

<p>(c) Better thermal transmittance (U-value) of external west facing walls.</p> <p>The U-value of external west facing wall should be equal or less than 2W/m<sup>2</sup>K</p> <p>(d) Better thermal transmittance (U-value) of roof.</p> <p>Baseline: U-value for roof stated below depending on the weight range of roof structure:</p> <table border="1" data-bbox="240 936 759 1111"> <thead> <tr> <th>Roof Weight Group (kg/m<sup>2</sup>)</th> <th>Maximum U-value (W/m<sup>2</sup>K)</th> </tr> </thead> <tbody> <tr> <td>Light (Under 50)</td> <td>0.4</td> </tr> <tr> <td>Heavy (Over 50)</td> <td>0.6</td> </tr> </tbody> </table>	Roof Weight Group (kg/m <sup>2</sup> )	Maximum U-value (W/m <sup>2</sup> K)	Light (Under 50)	0.4	Heavy (Over 50)	0.6	<p>total west facing façade areas)</p> <p>(Up to 10 credits for IND 1-3(b)(i) &amp;(b)(ii))</p> <p>Credits scored = 0.05 x (% of the external west facing walls areas with U-value of 2 W/m<sup>2</sup>K or less over the total west facing façade areas)</p> <p>(Up to 5 credits)</p> <p>2 credits for every 0.1 W/m<sup>2</sup>K reduction (Up to 5 credits)</p>
Roof Weight Group (kg/m <sup>2</sup> )	Maximum U-value (W/m <sup>2</sup> K)						
Light (Under 50)	0.4						
Heavy (Over 50)	0.6						
<p><b><u>IND 1-4 NATURAL VENTILATION / MECHANICAL VENTILATION</u></b></p> <p>(a) <u>Natural Ventilation</u> Encourage building that facilitates good natural ventilation.</p> <p>(i) Proper design of building layout that utilises prevailing wind conditions to achieve adequate cross ventilation.</p> <p>(ii) Use of ventilation simulation modelling and analysis or wind tunnel testing to identify the most effective building design and layout to ensure good natural ventilation.</p> <p style="text-align: center;"><b>OR</b></p>	<p>1 credit for every 10% of NV areas with window openings facing north and south directions and cross ventilation Credits scored = 1 x (% units/10) (Up to 10 credits)</p> <p>5 credits</p> <p style="text-align: center;"><b>OR</b></p>						

<p>(b) <u>Mechanical Ventilation</u> Encourage energy efficient mechanical ventilation system as the preferred ventilation mode to non-air-conditioning in buildings.</p> <p>Baseline: Fan power limitation in mechanical ventilation systems:</p> <table border="1" data-bbox="210 405 762 524"> <thead> <tr> <th colspan="2">Allowable nameplate motor power</th> </tr> <tr> <th>Constant volume</th> <th>Variable volume</th> </tr> </thead> <tbody> <tr> <td>1.7 kW/m<sup>3</sup>/s</td> <td>2.4 kW/m<sup>3</sup>/s</td> </tr> </tbody> </table> <p>Note (3): Where there is a combination of naturally ventilated and mechanical ventilated spaces, the credits scored will only be based on the predominant ventilation modes of normally occupied spaces.</p>	Allowable nameplate motor power		Constant volume	Variable volume	1.7 kW/m <sup>3</sup> /s	2.4 kW/m <sup>3</sup> /s	<p>0.6 credit for every subsequent 1% improvement from the baseline Credits scored = 0.6 x (% improvement)</p> <p>(Up to 15 credits)</p>		
Allowable nameplate motor power									
Constant volume	Variable volume								
1.7 kW/m <sup>3</sup> /s	2.4 kW/m <sup>3</sup> /s								
<b>Sub-Total (B):</b>	Sum of GreenRE credits obtained from IND 1-3 to 1-4								
<b>Part 1 – Energy Efficiency</b>	<b>GreenRE Credits</b>								
<b>(C) General</b>									
<p><b><u>IND 1-5 DAYLIGHTING</u></b></p> <p>Encourage design that optimises the use of effective day lighting to reduce energy use for artificial lighting.</p> <p>a) Use of daylight simulation analysis or any relevant calculation to verify that 50% or more of all normally occupied areas achieve adequate daylight illuminance levels as specified in MS 1525:2014. Areas with illuminance levels below or above the range do not comply.</p> <p>b) Daylighting in the following common areas:</p> <ul style="list-style-type: none"> <li>i. Lift lobbies and corridors</li> <li>ii. Staircases</li> <li>iii. Carparks</li> </ul>	<table border="1" data-bbox="876 1081 1329 1368"> <thead> <tr> <th>Percentage of Occupied Spaces with Adequate Ambient Lighting Level</th> <th>Credits Allocation</th> </tr> </thead> <tbody> <tr> <td>50% - 75%</td> <td>1</td> </tr> <tr> <td>76% - 90%</td> <td>2</td> </tr> <tr> <td>&gt;90%</td> <td>3</td> </tr> </tbody> </table> <p>(Up to 3 credits)</p> <p style="text-align: right;">1 credit 1 credit 1 credit</p>	Percentage of Occupied Spaces with Adequate Ambient Lighting Level	Credits Allocation	50% - 75%	1	76% - 90%	2	>90%	3
Percentage of Occupied Spaces with Adequate Ambient Lighting Level	Credits Allocation								
50% - 75%	1								
76% - 90%	2								
>90%	3								
<p><b><u>IND 1-6 ARTIFICIAL LIGHTING</u></b></p> <p>Encourage the use of better efficient lighting to minimise energy consumption from lighting usage while maintaining proper lighting level. <u>Baseline:</u> Luminance level stated in MS 1525:2014</p>	<p>0.20 credit for every percentage improvement in the lighting power budget Credits scored = 0.20 x (% improvement)</p> <p>(Up to 10 credits)</p>								

<p><b><u>IND 1-7 LIGHTING ZONING</u></b></p> <p>Lighting zones to not exceed 100m<sup>2</sup> for 90% of the occupied areas with controls clearly labelled and accessible for occupants</p> <p>To use photocell and / or motion sensors in the following areas (&gt;90% of spaces):</p> <p>Circulation areas (staircases and corridors)</p> <p>Transient spaces (lift lobbies, atrium, toilets)</p>	<p>1 credit</p> <p>1 credit</p> <p>1 credit</p>
<p><b><u>IND 1-8 VENTILATION IN CARPARKS</u></b></p> <p>Encourage the use energy efficient design and control of ventilation systems on carparks.</p> <p>(a) Carparks designed with natural ventilation.</p> <p>(b) CO sensors are used to regulate the demand for mechanical ventilation (MV).</p> <p>Note (4): Where there is a combination of different ventilation mode adopted for car park design, the credits scored under this requirement will be prorated accordingly.</p>	<p>Naturally ventilated carparks (covered and sheltered) – 2 credits</p> <p>Credits scored based on the mode of mechanical ventilation provided</p> <p>Fume extract- 1 credit</p> <p>MV with or without supply – 1 credits</p> <p>(Up to 2 credits)</p>
<p><b><u>IND 1-9 VENTILATION IN COMMON AREAS</u></b></p> <p>Encourage the use of energy efficient design and control of ventilation systems in the following common areas:</p> <ul style="list-style-type: none"> <li>• Toilets</li> <li>• Staircases</li> <li>• Lift Lobbies</li> <li>• Corridors</li> <li>• Atriums</li> </ul>	<p>Credits scored based on the mode of ventilation provided in the applicable areas.</p> <p>Natural vent. – 1.5 credits for each area</p> <p>Mechanical vent. – 0.5 credit for each area</p> <p>(Up to 5 credits)</p>
<p><b><u>IND 1-10 VERTICAL TRANSPORTATION EFFICIENCY</u></b></p> <p>Lifts and escalators shall be equipped with AC variable voltage and variable frequency (VVVF) motor drive and sleep mode features.</p>	<p>Extent of Coverage: All lifts and/or escalators</p> <p>1 credit</p>

**IND 1-11 Electrical Services**

Encourage the provision of better energy efficient service transformers, UPS and related controls of energy monitoring

(a) Energy Use and Sub-metering

Promote energy use monitoring with sub-metering to facilitate building operations, and to allow engagement of building occupants.

- I) Separately meter either
  - i. Substantial energy uses such as space cooling, domestic hot water, ventilation, lighting and plug loads

**OR**

- ii. High energy load and process areas
- II) And link all energy sub-meters to BMS, EMS or other automated system

(b) Provision of low-loss service transformers

Efficiency of service transformers to meet the requirements of MS-1525.

2 credits

2 credits

(c) Provision of energy-efficient UPS (uninterrupted power supply)

All UPS operating in the following systems must meet the minimum efficiency: -

i. Double conversion on-line mode

	UPS Range (kVA)				
	≥5 to <10	10 to <20	20 - <40	40 - <200	≥200
25% load	82.5%	86.5%	87.5%	89.0%	90.0%
50% load	85.0%	91.0%	91.5%	92.0%	92.5%
75% load	87.0%	92.0%	92.5%	93.0%	93.5%
100% load	87.0%	92.0%	92.5%	93.0%	93.5%

ii. Line interactive or ECO mode

	UPS Range (kVA)				
	≥5 to <10	10 to <20	20 - <40	40 - <200	≥200
25% load	85.5%	90%	91%	91.5%	93%
50% load	91.5%	93%	93.5%	94%	95.5%
75% load	92.5%	93.5%	94%	94.5%	96%
100% load	92.5%	93.5%	94%	94.5%	96%

iii. Stand-by mode

	UPS Range (kVA)				
	≥5 to <10	10 to <20	20 - <40	40 - <200	≥200
25% load	90%	94%	94.5%	95%	95.5%
50% load	93%	96%	96.5%	97%	97.5%
75% load	94%	96.5%	97%	97.5%	98%
100% load	94%	96.5%	97%	97.5%	98%

The credits awarded will be based on the aggregated kVA meeting the minimum efficiency as a proportion to the total installed kVA for UPS rated ≥ 5 kVA

(Up to 3 credits for IND 1-11 (c))

**IND 1-12 Local Energy Generation for Centralised Service Hot Water Heating**

Promote local energy generation from renewable sources or waterside energy recovery to meet service hot water heating demand in industrial facilities:

(a) Solar Thermal Hot Water System

The solar thermal hot water system must meet minimum Solar Fraction (SF) of 0.5 or Solar Energy Factor (SEF) of 2.

(b) Heat Pumps

The heat pump meeting minimum heating COP of 3.5 under the standard testing conditions as follows: -

- Heating water from 15°C to 55°C
- Air source heat of 20°C dry bulb/15°C wet bulb for air-to-water heat pump
- Water source heat of 15°C for water-to- water heat pump

(c) Combined Heat and Power (CHP) System

The CHP system such as co-generation or tri- generation must meet the minimum Effective Electrical Efficiency as follows: -

Type of CHP	Effective Electrical Efficiency
Combustion turbine-based CHP	0.50
Reciprocating engine-based CHP	0.70

(d) Photovoltaic Thermal (PV/T) or other low and zero carbon technology hot water systems

2 credits for every 30% of service hot water needs catered by local energy generation.

(up to 6 credits)

**IND 1-13 ENERGY EFFICIENT PRACTICES & FEATURES**

Encourage the use of energy efficient practices and features which are innovative and have positive environmental impact

- (a) To create an energy breakdown of entire facility to indicate major energy consumers within the facility and to calculate energy efficiency index (EEI).

1 credit

<p>(b) To benchmark process loads within the facility against industry norms and demonstrate savings.</p> <table border="1" data-bbox="304 282 724 1137"> <tr> <td data-bbox="304 282 724 360" style="text-align: center;"><u>Process load within the facility</u></td> </tr> <tr> <td data-bbox="304 360 724 439" style="text-align: center;"><u>Percentage savings compared to industry norms</u></td> </tr> <tr> <td data-bbox="304 439 724 689"> <p>For process loads &lt; 25% of TBEC  <u>10% - 1 credit</u>  <u>20% - 2 credits</u>  <u>&gt;30% - 3 credits</u></p> </td> </tr> <tr> <td data-bbox="304 689 724 918"> <p>For process loads &lt; 50% of TBEC  <u>10% - 2 credit</u>  <u>20% - 4 credits</u>  <u>&gt;30% - 6 credits</u></p> </td> </tr> <tr> <td data-bbox="304 918 724 1137"> <p>For process loads ≥ 50% of TBEC  <u>10% - 3 credit</u>  <u>20% - 6 credits</u>  <u>&gt;30% - 9 credits</u></p> </td> </tr> </table>	<u>Process load within the facility</u>	<u>Percentage savings compared to industry norms</u>	<p>For process loads &lt; 25% of TBEC  <u>10% - 1 credit</u>  <u>20% - 2 credits</u>  <u>&gt;30% - 3 credits</u></p>	<p>For process loads &lt; 50% of TBEC  <u>10% - 2 credit</u>  <u>20% - 4 credits</u>  <u>&gt;30% - 6 credits</u></p>	<p>For process loads ≥ 50% of TBEC  <u>10% - 3 credit</u>  <u>20% - 6 credits</u>  <u>&gt;30% - 9 credits</u></p>	<p>Up to 9 credits</p>
<u>Process load within the facility</u>						
<u>Percentage savings compared to industry norms</u>						
<p>For process loads &lt; 25% of TBEC  <u>10% - 1 credit</u>  <u>20% - 2 credits</u>  <u>&gt;30% - 3 credits</u></p>						
<p>For process loads &lt; 50% of TBEC  <u>10% - 2 credit</u>  <u>20% - 4 credits</u>  <u>&gt;30% - 6 credits</u></p>						
<p>For process loads ≥ 50% of TBEC  <u>10% - 3 credit</u>  <u>20% - 6 credits</u>  <u>&gt;30% - 9 credits</u></p>						
<p><b><u>IND 1-14 ON-SITE ENERGY GENERATION</u></b></p> <p>Encourage on-site energy generation through renewable energy or energy recovery / regeneration:</p> <p>For facilities where solar panels are not installed, provide solar panel installation ready roof. Appropriate roof pitch, static loads, mounting system and roof access to be considered.</p>	<p>5 credits for every 1% replacement of electricity (based on total electricity consumption)</p> <p style="text-align: center;">OR</p> <p>2 credits for every 10% of roof area used for solar panels.</p> <p style="text-align: center;">(Up to 15 credits)</p> <p style="text-align: center;">1 credit</p>					
<p><b>Sub-Total (C):</b></p>	<p>Sum of GreenRE credits obtained from IND 1-5 to 1-14</p>					



**PART 1 – ENERGY EFFICIENCY  
CATEGORY SCORE:**

$$\begin{aligned} & \text{Sub-Total (A) X } \frac{\text{Air-Conditioned Building Floor Area}}{\text{Total Floor Area}} \\ & + \\ & \text{Sub-Total (B) X } \frac{\text{Non Air-Conditioned Building Floor Area}}{\text{Total Floor Area}} \\ & + \\ & \text{Sub-Total (C)} \end{aligned}$$

Where :

Sub-Total (A) = Sum of GreenRE Credits obtained Under Section (A) that is IND 1-1 to 1-2

Sub-Total (B) = Sum of GreenRE Credits obtained Under Section (B) that is IND 1-3 to 1-4

Sub-Total (C) = Sum of GreenRE Credits obtained Under Section (C) that is IND 1-5 to 1-14

If either Section (A) or Section (B) is not applicable, no pro-rating of areas is required for the score computation.

Total floor area includes air-conditioned area and non air-conditioned area but excluding car park and common area.

Part 2 – Water Efficiency	GreenRE Credits									
<p><b><u>IND 2-1 WATER EFFICIENT FITTINGS</u></b></p> <p>Encourage the use of water efficient fittings that are certified under the Water Efficiency Products Labelling Scheme (WEPLS).</p> <p>a) Basin taps and mixers  b) Flushing cistern  c) Shower taps and mixers or showerheads  d) Sink/bib taps and mixers  e) Urinals and urinal flush valve</p>	<table border="1" data-bbox="810 250 1382 454"> <thead> <tr> <th colspan="3" data-bbox="810 250 1382 327">Rating Based on Water Efficiency Products Labelling Scheme (WEPLS)</th> </tr> <tr> <th data-bbox="810 329 1002 405">Efficient *</th> <th data-bbox="1003 329 1195 405">Highly Efficient **</th> <th data-bbox="1197 329 1382 405">Most Efficient ***</th> </tr> </thead> <tbody> <tr> <td data-bbox="810 407 1002 454"><b>2 credits</b></td> <td data-bbox="1003 407 1195 454"><b>4 credits</b></td> <td data-bbox="1197 407 1382 454"><b>6 credits</b></td> </tr> </tbody> </table> <p>Credits can be scored based on the number and water efficiency rating of the fitting type used.</p> <p>(Up to 6 credits)</p>	Rating Based on Water Efficiency Products Labelling Scheme (WEPLS)			Efficient *	Highly Efficient **	Most Efficient ***	<b>2 credits</b>	<b>4 credits</b>	<b>6 credits</b>
Rating Based on Water Efficiency Products Labelling Scheme (WEPLS)										
Efficient *	Highly Efficient **	Most Efficient ***								
<b>2 credits</b>	<b>4 credits</b>	<b>6 credits</b>								
<p><b><u>IND 2-2 WATER USAGE AND LEAK DETECTION</u></b></p> <p>Promote the use of sub-metering and leak detection system for better control and monitoring</p> <p>(a) Provision of sub-meters for major water uses which includes irrigation, cooling towers etc</p> <p>(b) Linking all sub-meters to Building Management System (BMS) for leak detection.</p>	<p>1 credit</p> <p>1 credit</p>									
<p><b><u>IND 2-3 ALTERNATIVE WATER SOURCES</u></b></p> <p>Use of suitable systems that utilize alternative water sources for <b>non-potable uses</b>: irrigation, washing, water features, toilet flushing, etc (excluding cooling tower make up water) to reduce use of potable water.</p> <p>Alternative sources can include rainwater, greywater (for toilet flushing only), AHU condensate and wastewater recycling.</p>	<p>Credits awarded based on % reduction in total potable water usage of the applicable uses</p> <table border="1" data-bbox="810 1579 1382 1697"> <tbody> <tr> <td data-bbox="810 1579 1098 1617">&gt; 50 %</td> <td data-bbox="1099 1579 1382 1617">3 credits</td> </tr> <tr> <td data-bbox="810 1619 1098 1657">≥ 10 % to 50 %</td> <td data-bbox="1099 1619 1382 1657">2 credits</td> </tr> <tr> <td data-bbox="810 1659 1098 1697">&lt; 10 %</td> <td data-bbox="1099 1659 1382 1697">1 credit</td> </tr> </tbody> </table> <p>(Up to 3 credits)</p>	> 50 %	3 credits	≥ 10 % to 50 %	2 credits	< 10 %	1 credit			
> 50 %	3 credits									
≥ 10 % to 50 %	2 credits									
< 10 %	1 credit									

<p><b><u>IND 2-4 IRRIGATION SYSTEM AND LANDSCAPING</u></b></p> <p>Reduce potable water consumption for irrigation and landscaping.</p> <p>(a) Use of non-potable water including rainwater for landscape irrigation</p> <p>(b) Use of automatic water efficient irrigation system with rain sensor, soil moisture sensor or equivalent control system.</p> <p>(c) Use of drought tolerant plants that require minimal irrigation.</p>	<p>1 credit</p> <p>Extent of Coverage: At least 50% of the landscape areas are served by the system 1 credit</p> <p>Extent of Coverage: At least 80% of the landscape areas 1 credit</p>
<p><b><u>IND 2-5 WATER CONSUMPTION OF COOLING TOWER</u></b></p> <p>Reduce potable water consumption for cooling purpose.</p> <p>(a) Use of cooling tower water treatment system which can achieve 6 or better cycles of concentration at acceptable water quality</p> <p>(b) Use of recycled water from approved sources for cooling purpose</p>	<p>1 credit</p> <p>1 credit</p>
<p><b>PART 2 – WATER EFFICIENCY CATEGORY SCORE:</b></p>	<p>Sum of GreenRE credits obtained from IND 2-1 to 2-5</p>

Part 3 – Environmental Protection	GreenRE Credits																								
<p><b><u>IND 3-1 SUSTAINABLE CONSTRUCTION</u></b></p> <p>Encourage recycling and the adoption of building designs, construction practices and materials that are environmentally friendly and sustainable.</p> <p>(a) Use of sustainable and recycled materials;</p> <p>Green Cements with approved industrial by-product (such as Ground Granulated Blast furnace Slag (GGBS), silica fume, fly ash) to replace Ordinary Portland Cement (OPC).</p> <p>(b) Concrete Usage Index (CUI)</p> <p>Encourage more efficient concrete usage for building components.</p> <p><i>Prerequisite Requirement:</i>  <i>Minimum score under IND 3-1:</i>  <i>GreenRE Gold ≥ 3 credits</i>  <i>GreenRE Platinum ≥ 5 credits</i></p>	<table border="1" data-bbox="810 434 1382 752"> <thead> <tr> <th data-bbox="810 434 1189 551">% Replacement of OPC by approved industrial by-products</th> <th data-bbox="1190 434 1382 551">Credits Allocation</th> </tr> </thead> <tbody> <tr> <td data-bbox="810 553 1189 589">10</td> <td data-bbox="1190 553 1382 589">1</td> </tr> <tr> <td data-bbox="810 591 1189 627">20</td> <td data-bbox="1190 591 1382 627">2</td> </tr> <tr> <td data-bbox="810 629 1189 665">30</td> <td data-bbox="1190 629 1382 665">3</td> </tr> <tr> <td data-bbox="810 667 1189 703">40</td> <td data-bbox="1190 667 1382 703">4</td> </tr> <tr> <td data-bbox="810 705 1189 741">&gt;50</td> <td data-bbox="1190 705 1382 741">5</td> </tr> </tbody> </table> <p data-bbox="991 786 1203 822">(Up to 5 credits)</p> <table border="1" data-bbox="810 889 1382 1247"> <thead> <tr> <th data-bbox="810 889 1099 981">Project CUI (m<sup>3</sup>/m<sup>2</sup>)</th> <th data-bbox="1101 889 1382 981">Credits Allocation</th> </tr> </thead> <tbody> <tr> <td data-bbox="810 983 1099 1032">≤ 0.50</td> <td data-bbox="1101 983 1382 1032">1</td> </tr> <tr> <td data-bbox="810 1034 1099 1084">≤ 0.45</td> <td data-bbox="1101 1034 1382 1084">2</td> </tr> <tr> <td data-bbox="810 1086 1099 1135">≤ 0.40</td> <td data-bbox="1101 1086 1382 1135">3</td> </tr> <tr> <td data-bbox="810 1137 1099 1187">≤ 0.35</td> <td data-bbox="1101 1137 1382 1187">4</td> </tr> <tr> <td data-bbox="810 1189 1099 1238">≤ 0.30</td> <td data-bbox="1101 1189 1382 1238">5</td> </tr> </tbody> </table> <p data-bbox="991 1305 1203 1341">(Up to 5 credits)</p>	% Replacement of OPC by approved industrial by-products	Credits Allocation	10	1	20	2	30	3	40	4	>50	5	Project CUI (m <sup>3</sup> /m <sup>2</sup> )	Credits Allocation	≤ 0.50	1	≤ 0.45	2	≤ 0.40	3	≤ 0.35	4	≤ 0.30	5
% Replacement of OPC by approved industrial by-products	Credits Allocation																								
10	1																								
20	2																								
30	3																								
40	4																								
>50	5																								
Project CUI (m <sup>3</sup> /m <sup>2</sup> )	Credits Allocation																								
≤ 0.50	1																								
≤ 0.45	2																								
≤ 0.40	3																								
≤ 0.35	4																								
≤ 0.30	5																								
<p><b><u>IND 3-2 SUSTAINABLE PRODUCTS</u></b></p> <p>Encourage the use of products that are environmentally friendly and sustainable.</p> <p><i>Prerequisite Requirement:</i>  <i>Minimum score under IND 3-1:</i>  <i>GreenRE Gold ≥ 3 credits</i>  <i>GreenRE Platinum ≥ 5 credits</i></p>	<table border="1" data-bbox="813 1442 1378 1729"> <thead> <tr> <th data-bbox="813 1442 1155 1559">Extent of use of environmentally friendly product</th> <th data-bbox="1157 1442 1378 1559">Weightage for Credit Allocation</th> </tr> </thead> <tbody> <tr> <td data-bbox="813 1561 1155 1619">Low Impact</td> <td data-bbox="1157 1561 1378 1619">0.5</td> </tr> <tr> <td data-bbox="813 1621 1155 1680">Medium impact</td> <td data-bbox="1157 1621 1378 1680">1</td> </tr> <tr> <td data-bbox="813 1682 1155 1729">High Impact</td> <td data-bbox="1157 1682 1378 1729">2</td> </tr> </tbody> </table> <p data-bbox="823 1798 1372 1868">Credits scored will be based on the extent of use of environmentally friendly product.</p> <p data-bbox="984 1908 1198 1944">(Up to 8 credits)</p>	Extent of use of environmentally friendly product	Weightage for Credit Allocation	Low Impact	0.5	Medium impact	1	High Impact	2																
Extent of use of environmentally friendly product	Weightage for Credit Allocation																								
Low Impact	0.5																								
Medium impact	1																								
High Impact	2																								

**IND 3-3 GREENERY PROVISION**

Encourage greater use of greenery and restoration of existing trees to reduce heat island effect.

(a) Green Plot Ratio (GnPR) is calculated by considering the 3D volume covered by plants using the Leaf Area Index (LAI).

GnPR	Credits Allocation
1.0 to < 2.0	1
2.0 to < 3.0	2
3.0 to < 4.0	3
4.0 to < 5.0	4
5.0 to < 6.0	5
≥ 6.0	6

(b) Restoration of trees on site, conserving or relocating of existing trees on site. (at least 20%)

1 credit

(c) Use of compost recycled from horticulture waste.

1 credit

**IND 3-4 ENVIRONMENTAL MANAGEMENT PRACTICE**

Encourage the adoption of environmental friendly practices during construction and building operation.

(a) Implement effective environmental friendly programmes including monitoring and setting targets to minimise energy use, water use and construction waste.

1 credit

(b) Main builder that has good track records in the adoption of sustainable, environmental friendly and considerate practices during construction.

1 credit

(c) Building quality is assessed under the Quality Assessment System in Construction (QLASSIC) or Construction Quality Assessment System (CONQUAS).

1 credit

(d) To performs IBS content scoring based on CIDB IBS scoring scheme.

1 credit for IBS score ≥ 50%  
2 credits for IBS score ≥ 70%

(e) Developer, main builder, M&E consultant and architect are ISO 14000 certified.

0.25 credit for each firm  
(Up to 1 credit)

(f) Project team comprises one Certified GreenRE/Green Mark Manager (GM)

1 credit for certified GRM/GMM

<p>(g) Energy policy, energy targets and regular review with top management's commitment as part of an environmental strategy</p> <p>(h) Targets to improve building water performance against own building water performance baseline should be set. To show intent, measures and implementation strategies of water efficiency improvement plans over the next three years.</p> <p>(i) Provision of facilities or recycling bins for collection and storage of different recyclable waste such as paper, glass, plastic etc.</p>	<p>1 credit</p> <p>1 credit</p> <p>1 credit</p>
<p><b><u>IND 3-5 GREEN TRANSPORT</u></b></p> <p>Promote environmental friendly transport options and facilities to reduce pollution from individual car use.</p> <p>(a) Good access (&lt;800m walking distance) to public transport networks such as train stations or bus stops.</p> <p>(b) Shuttle service for facility employees.</p> <p>(c) Project is accessible from major highway outlets and / or within close proximity to major cargo services (i.e airport, seaport, railway stations). Project to be within 10km of these facilities.</p> <p>(d) Provision of hybrid/electric vehicle charging stations and priority parking lots within the development.</p> <p>(e) Provision of covered / sheltered bicycles parking lots (i.e with rack / bar) and adequate shower and changing facilities.</p>	<p>1 credit</p> <p>1 credit</p> <p>1 credit</p> <p>Extent of coverage: Minimum 1 number priority parking bays for every 100 carpark lots. EV chargers – 1 for every 200 parking bays. (Cap at 3) (1 credit)</p> <p>Extent of Coverage : Minimum 10 number and maximum 50 numbers of bicycle parking lots (1 credit)</p>
<p><b><u>IND 3-6 STORMWATER MANAGEMENT</u></b></p> <p>Encourage the treatment of stormwater runoff through provision of infiltration or design features before discharge to public drains.</p>	<p>Reduce post development stormwater peak discharge rate and quantity from exceeding pre-development peak discharge rate and quantity:</p>

<p>Provision of infiltration features or design features for new development and redevelopment in accordance with MSMA.</p>	<p>5 - 15% - 1 credit  16 - 25% - 2 credits  &gt; 25% - 3 credits  (Up to 3 credits)</p>
<p><b><u>IND 3-7 REFRIGERANTS</u></b></p> <p>Reduce the potential damage to the ozone layer and the increase in global warming through the release of ozone depleting substances and greenhouse gases.</p> <p>(a) Refrigerants with ozone depleting potential (ODP) of zero <b>OR</b> with global warming potential (GWP) of less than 100.</p> <p>(b) Use of refrigerant leak detection system at critical areas of plant rooms containing chillers and other equipment with refrigerants.</p>	<p>1 credit</p> <p>1 credit</p>
<p><b>PART 3–ENVIRONMENTAL PROTECTION CATEGORY SCORE:</b></p>	<p>Sum of GreenRE credits obtained from IND 3-1 to 3-7</p>

Part 4 – Indoor Environmental Quality	GreenRE Credits						
<p><b><u>IND 4-1 THERMAL COMFORT</u></b></p> <p><u>For office areas:</u> Air-conditioning system is designed to allow for cooling load variations due to fluctuations in ambient air temperature to ensure consistent indoor conditions for thermal comfort.</p> <p>Indoor temperature between 23°C to 26°C Relative Humidity between 50% to 70%</p> <p>Note: Additional 0.5 credit will be awarded for room temperature and humidity displays in all applicable areas.</p> <p><b>and / or</b></p> <p><u>For process areas:</u> To ensure thermal comfort is maintained at the following levels:</p> <table border="1" data-bbox="209 981 783 1061"> <thead> <tr> <th>PMV Range</th> <th>PPD</th> </tr> </thead> <tbody> <tr> <td>-0.5&lt;PMV&lt;+0.5</td> <td>&lt;10</td> </tr> </tbody> </table>	PMV Range	PPD	-0.5<PMV<+0.5	<10	<p>0.5 credit</p> <p>0.5 credit</p> <p>1 credit</p>		
PMV Range	PPD						
-0.5<PMV<+0.5	<10						
<p><b><u>IND 4-2 NOISE LEVEL</u></b></p> <p><u>For office and process areas:</u> Demonstrate acoustic performance of internal partitions as follows:</p> <table border="1" data-bbox="209 1290 783 1727"> <thead> <tr> <th>Description</th> <th>Sound Transmission Class (STC)</th> </tr> </thead> <tbody> <tr> <td>Separation between functional spaces within dwelling units and in-between adjacent dwelling units.</td> <td>40 - 50</td> </tr> <tr> <td>Spaces between mechanical and equipment spaces and occupied spaces</td> <td>50 - 60</td> </tr> </tbody> </table> <p><b>and / or</b></p> <p><u>For process areas:</u> To make efforts to reduce noise pollution to external environment. Building / plant envelope is designed to reduce noise by NR20dBA in standard operation.</p>	Description	Sound Transmission Class (STC)	Separation between functional spaces within dwelling units and in-between adjacent dwelling units.	40 - 50	Spaces between mechanical and equipment spaces and occupied spaces	50 - 60	<p>1 credit</p> <p>1 credit</p>
Description	Sound Transmission Class (STC)						
Separation between functional spaces within dwelling units and in-between adjacent dwelling units.	40 - 50						
Spaces between mechanical and equipment spaces and occupied spaces	50 - 60						



<p><b><u>IND 4-3 INDOOR AIR POLLUTANTS</u></b></p> <p>Minimise VOCs, mainly from inside sources to promote a healthy indoor environment.</p> <p>a) Use of low volatile organic compounds (VOC) paints certified under local/international certification body.</p> <p>b) Use adhesives certified under local/international certification body for composite wood products.</p>	<p>Extent of Coverage: A at least 90% of the internal wall areas</p> <p>1 credit</p> <p>1 credit</p>
<p><b><u>IND 4-4 INDOOR AIR QUALITY (IAQ) MANAGEMENT</u></b></p> <p>Ensure that building ventilation systems are designed and installed to provide acceptable IAQ under normal operating hours.</p> <p>a) Provision of filtration media and differential pressure monitoring equipment in Air Handling Units (AHUs).</p> <p>b) Implement effective IAQ management plan to ensure that building ventilation systems are clean and free from residuals left over from construction activities.</p>	<p>1 credit</p> <p>1 credit</p>
<p><b><u>IND 4-5 EXTERNAL VIEWS</u></b></p> <p>To show that &gt;50% of occupied spaces have a view of out facility within working heights (i.e 1.2m – 1.7m from floor level).</p>	<p>1 credit</p>
<p><b><u>IND 4-6 QUALITY OF ARTIFICIAL LIGHTING</u></b></p> <p>Improve workplace lighting quality by avoiding low frequency flicker associated with fluorescent lighting with the use of high frequency ballasts in the fluorescent luminaries.</p> <p>Use of driver with output frequency &lt; 200Hz and &lt; 30% flicker for LED lighting.</p>	<p>Extent of Coverage: At least 90% of all applicable areas that are served by fluorescent luminaries</p> <p>1 credit</p> <p>1 credit</p>
<p><b>Part 4 – INDOOR ENVIRONMENTAL QUALITY CATEGORY SCORE:</b></p>	<p>Sum of GreenRE credits obtained from IND 4-1 to 4-6</p>

Part 5 – Other Green Features	GreenRE Credits
<p><b><u>IND 5-1 GREEN FEATURES &amp; INNOVATIONS</u></b></p> <p>Encourage the use of green features which are innovative and have positive environmental impact.</p> <p>Examples:</p> <ul style="list-style-type: none"> <li>• Pneumatic waste collection system</li> <li>• Dual chute system</li> <li>• Self-cleaning façade system</li> <li>• Infiltration trenches</li> <li>• Integrated storm water retention/treatment into landscaping</li> <li>• Heat recovery systems (at least 10% of required capacity)</li> <li>• Etc</li> </ul>	<p>2 credit for high impact item</p> <p>1 credit for medium impact item</p> <p>0.5 credit for low impact item</p> <p>(Up to 9 credits)</p>
<p><b>PART 5 – OTHER GREEN FEATURES CATEGORY SCORE:</b></p>	<p>Sum of GreenRE credits obtained from IND 5-1</p>

Part 6- Carbon Footprint of Development	GreenRE Credits
<p><b><u>IND 6-1 CARBON FOOTPRINT OF DEVELOPMENT</u></b></p> <p>Recognise the carbon emission based on operational carbon footprint computation of the building comprising energy and water consumption</p> <p>To identify carbon debt and quantify environmental impact and embodied energy, as well as allow benchmarking of projects over time using BCA's online embodied carbon calculator.</p>	<p>1 credit</p> <p>1 credit – Carbon footprint calculation of any four (4) building materials listed</p> <p>2 credits – complete carbon footprint calculation for all building materials listed.</p> <p>(up to 2 credits)</p>
<p><b>PART 6- CARBON FOOTPRINT OF DEVELOPMENT</b></p> <p><b>CATEGORY SCORE:</b></p>	<p>Sum of GreenRE credits obtained from IND 6-1</p>
<p><b>GreenRE Score (Industrial Facilities)</b></p> <p>GreenRE Score (IND) = <math>\sum</math>Category score [ (Part 1-Energy Efficiency) + (Part 2-Water Efficiency) + (Part 3-Environmental Protection) + (Part 4-Indoor Environmental Quality) + (Part 5-Other Green Features) + (Part 6-Carbon Emission of Development)]</p> <p>Where :</p> <p>Category Score for Part 1 <math>\geq</math> 30 credits and</p> <p><math>\sum</math>Category score for Part 2 to Part 6 <math>\geq</math> 20 credits</p>	