



DESIGN REFERENCE GUIDE

Non-Residential Building

Version 4.0

January 2024

Contents

1. About GreenRE.....	1
2. Introduction.....	2
3. Revision Log.....	2
4. GreenRE Assessment Stages.....	3
5. GreenRE Non-Residential Building Rating System	4
6. GreenRE Non-Residential Building Rating System Scoring	7
7. GreenRE Non-Residential Building Rating System Criteria.....	9
8. Documentation Requirements.....	113

1. About GreenRE

GreenRE Sdn Bhd is a wholly owned subsidiary of the Real Estate and Housing Development Association (REHDA). The GreenRE rating tool has been developed for the purposes as mentioned herein and may be subject to updating and/or modification in the future.

Any sale, modification, reproduction, display or distribution of GreenRE criteria or any copies thereof is not allowed without GreenRE Sdn Bhd's prior written consent. This may be obtained in writing to the following address or via email to info@greenre.org

GreenRE Sdn Bhd
Wisma Rehda,
No.2C, Jalan SS5/6D,
47301 Petaling Jaya,
Selangor, Malaysia

2. Introduction

The GreenRE assessment scheme was established in 2013 and is a recognized green building rating system tailored for the tropical climate. GreenRE sets parameters and establishes indicators to guide the design, construction and operation of buildings towards increased energy effectiveness and enhanced environmental performance.

The intent of this Design Reference Guide for Non-Residential Buildings (referred to as “this Guideline”) is to establish environmentally friendly practices for the planning, design and construction of buildings, which would help to mitigate the environmental impact of built structures.

This Guideline is not intended to abridge safety, health, environmental or related requirements contained in other applicable laws, codes or policies administered by relevant authorities. Where there is a conflict between a requirement of this Guideline and such other regulations affecting the design, construction and operation of the project, the building regulations shall take precedence.

3. Revision Log

Revision	Description	Date Effective
1.1	Issued for Implementation	1 st June 2013
1.2	Revised version of implementation	1 st June 2014
2.0	Revised version of implementation	1 st June 2015
3.0	Revised version of implementation	1 st October 2015
3.1	Revised version of implementation	15 th March 2018
3.2	Revised version of implementation	15 th February 2021
3.2	Revised version of implementation	3 rd September 2021
4.0	Revised version for implementation	15 th June 2023
4.0	Revised version for Implementation	15 th August 2023
4.0	Revised version for implementation	January 2024

4. GreenRE Assessment Stages

The GreenRE Non-Residential Building certification process is as follows:

Application

Submittal of application with relevant supporting documents for certification upon strategic inception of infrastructure project.



Pre-Assessment

A pre-assessment can be conducted (mandatory) to give the project team a better understanding of the criteria and evaluation of the certification level sought. This should be performed upon selection of suitable design option to allow teams to identify and maximize opportunities at the earliest stages of the project.



Actual Assessment

Actual assessment to be conducted once the design and documentary evidences (e.g. approved plan) are ready. After the actual assessment, our assessors will review the documents submitted.

Assessment process includes design and documentary reviews to verify if the building project meets:

- (i) The intents of the criteria
- (ii) The pre-requisite requirement for GreenRE Bronze, Silver, Gold and Platinum rating where applicable.

Provisional Certificate will be issued upon completion of this stage.



Site Verification

Site verification to be conducted upon project completion.

Final Certificate will be issued upon completion of this stage.

5. GreenRE Non-Residential Building Rating System

Overview:

The GreenRE non-residential building rating system is divided into six (6) sections as follows:

Part 1 - Energy Efficiency: This category focuses on the approach that can be used in the building design and system selection to optimise the energy efficiency of buildings.

Part 2 - Water Efficiency: This category focuses on the selection of fittings and strategies enabling water use efficiency during construction and building operation.

Part 3 – Environmental Protection: This category focuses on the design, practices and selection of materials and resources that would reduce the environmental impacts of built structures.

Part 4 - Indoor Environmental Quality: This category focuses on the design strategies that would enhance the indoor environmental quality which include air quality, thermal comfort, acoustic control and daylighting.

Part 5 - Other Green Features: This category focuses on the adoption of green practices and new technologies that are innovative and have potential environmental benefits.

Part 6 - Carbon Emission of Development: This category focuses on the use of carbon calculator to calculate the carbon emission of the development.

These environment impact categories are broadly classified under two main groups namely (I) Energy Related Requirements and (II) Other Green Requirements.

Energy Related Requirements consist of Part 1- Energy Efficiency where credits are allocated for the various energy efficient designs, practices and features used. A minimum of 30 credits must be obtained from this group to be eligible for certification. For shop lot / office project, minimum 22 credits must be obtained from this group. The number of credits achievable for this group is capped at 50 credits (exclude 20 bonus credits that are obtainable under NRB 1-10 – Renewable Energy).

Other Green Requirements consist of Part 2 - Water Efficiency; Part 3 - Environmental Protection; Part 4 - Indoor Environmental Quality; Part 5 - Other Green Features and Part 6 - Carbon Emission of Development. Credits are allocated for the water efficient features, environmentally friendly design practices, innovative green features used and carbon emission of development. A minimum of 20 credits must be obtained from this group to be eligible for certification. The number of credits achievable for this group is also capped at 50 credits.

The maximum GreenRE score achievable for a project is capped at 100 credits and this does not include 20 bonus credits that are obtainable under Energy Related Requirements if a project uses renewable energy sources. The credit scored for


renewable energy provision shall not result in a double grade jump in GreenRE rating (i.e from GreenRE Bronze or Silver to Gold or Platinum)

Under the non-residential building criteria, the environmental impact category Part 1 – Energy Efficiency applies to both air-conditioned and non-air-conditioned spaces. Where there is a combination of air-conditioned and non-air-conditioned spaces, the credits allocated are to be prorated in accordance with the respective floor areas. For simplicity, credits applicable to air-conditioned areas are accounted only if the aggregate air-conditioned areas exceed 500 m². Similarly, credits applicable to non-air-conditioned areas are accounted only if the aggregate non-air-conditioned areas are more than 10% of the total floor areas excluding carparks and common areas.

Points scoring and fulfilment of pre-requisite for mixed mode ventilated spaces are as follows:

- If more than >90% of space (NLA excluding common areas) utilizes one mode of ventilation, pre-requisite for that form of ventilation only applies.
- Points scoring to be pro-rated based on modes of ventilation provided. (e.g if 90% NV and 10% airconditioned – points for NV scoring to be 90% of available points (NRB 1-3 & NRB 1-4) and 10% from NRB 1-1 & NRB 1-2).
- OTTV <50 w/m² will be applicable for all air-conditioned spaces exceeding 1000m².
- Roof u-value requirements mandatory for all building types.

Framework:

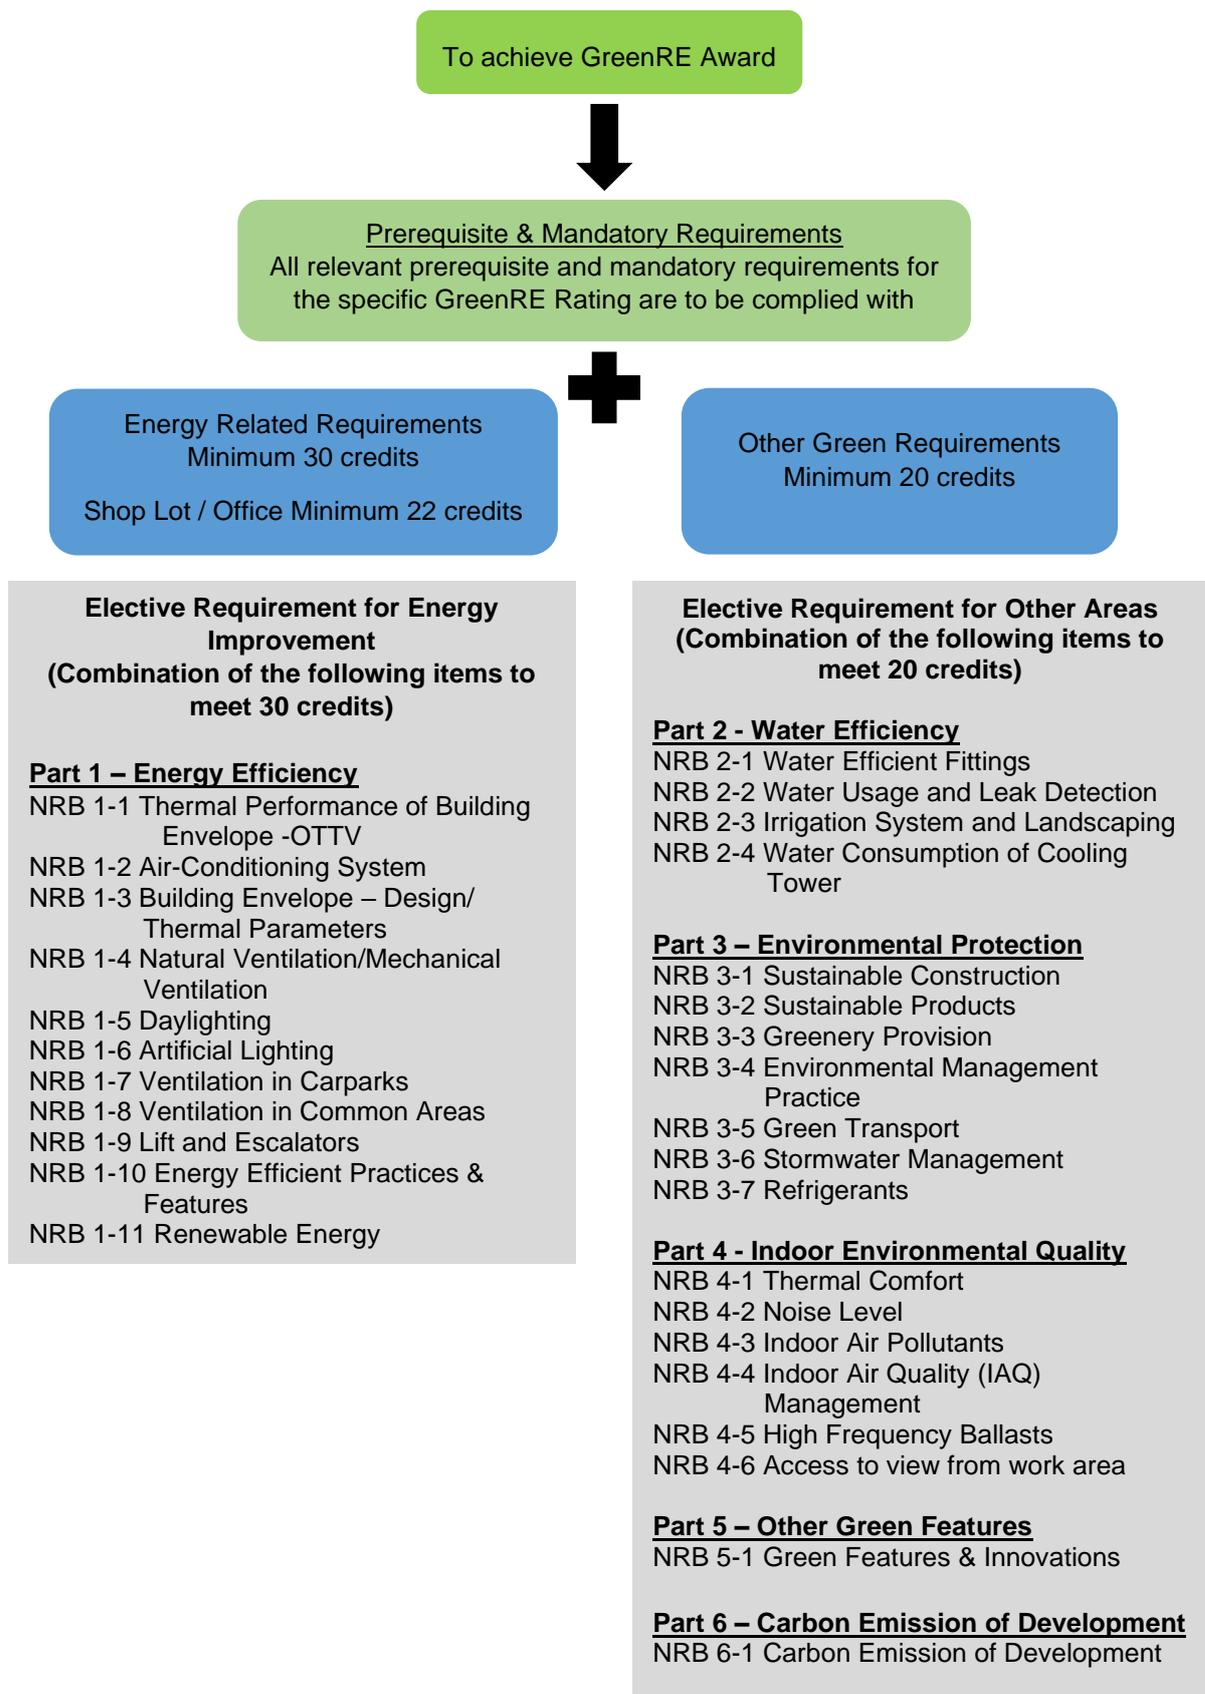

Credit Allocation:

Category			Credits Allocation	
(I) Energy Related Requirements				
Minimum 30 credits	Part 1: Energy Efficiency			
	NRB 1-1 Thermal Performance of Building Envelope – OTTV	Section (A) Applicable to air-cond. areas	15	
	NRB 1-2 Air – Conditioning System		33	
	Sub -Total (A) – NRB 1-1 to 1-2			48
	NRB 1-3 Building Envelope – Design/ Thermal Parameters	Section (B) Applicable to non air- cond. areas	30	
	NRB 1-4 Natural Ventilation/Mechanical Ventilation		20	
	Sub – Total (B) – NRB 1-3 to 1-4			50
	NRB 1-5 Daylighting	Section(C)	6	
	NRB 1-6 Artificial Lighting	Applicable to all areas	12	
	NRB 1-7 Ventilation in Carparks		4	
	NRB 1-8 Ventilation in Common Areas		5	
NRB 1-9 Lifts and Escalators		2		
NRB 1-10 Energy Efficient Practices & Features		12		
NRB 1-11 Renewable Energy		20		
Sub – Total (C) – NRB 1-5 to 1-11			61	
Category Score for Part 1 – Energy Efficiency [Prorate Subtotal (A) + Prorate Subtotal (B)] + Subtotal (C)			111 (MAX)	
(II) Other Green Requirements				
Minimum 20 credits	Part 2: Water Efficiency			
	NRB 2-1 Water Efficient Fittings		8	
	NRB 2-2 Water Usage and Leak Detection		2	
	NRB 2-3 Irrigation System and Landscaping		3	
	NRB 2-4 Water Consumption of Cooling Tower		2	
	Category Score for Part 2 – Water Efficiency			15
	Part 3: Environmental Protection			
	NRB 3-1 Sustainable Construction		10	
	NRB 3-2 Sustainable Products		10	
	NRB 3-3 Greenery Provision		8	
	NRB 3-4 Environmental Management Practice		10	
	NRB 3-5 Green Transport		6	
	NRB 3-6 Stormwater Management		3	
	NRB 3-7 Refrigerants		2	
	Category Score for Part 3 – Environmental Protection			49
	Part 4: Indoor Environmental Quality			
	NRB 4-1 Thermal Comfort		2	
	NRB 4-2 Noise Level		1	
	NRB 4-3 Indoor Air pollutants		2	
	NRB 4-4 Indoor Air Quality (IAQ) Management		2	
NRB 4-5 High Frequency Ballasts		1		
NRB 4-6 Access to view from Work Area		1		
Category Score for Part 4: Indoor Environmental Quality			9	
Part 5: Other Green Features				
NRB 5-1 Green Features & Innovations		7		
Category Score for Part 5: Other Green Features			7	
Part 6: Carbon Emission of Development				
NRB 6-1 Carbon Emission of Development		3		
Category Score for Part 6: Carbon Emission of Development			3	
Category Score for Part 2 to Part 6 – Other Green Requirements			83	
GreenRE Non-Residential Building Score:			194 (MAX)	

*Total score will be rounded to the nearest whole number

6. GreenRE Non-Residential Building Rating System Scoring

Score	Rating
91 and above	GreenRE Platinum
86 to \leq 90	GreenRE Gold
76 to \leq 85	GreenRE Silver
50 to \leq 75	GreenRE Bronze

7. GreenRE Non-Residential Building Rating System Criteria

Pre-requisites:

1. **GENERAL**

- Building envelope design with Overall Thermal Transfer Value (OTTV) computed based on the methodology and guidelines stipulated in the MS1525:2019.
GreenRE Gold – OTTV of 42 W/m² or lower
GreenRE Platinum – OTTV of 40 W/m² or lower
- To demonstrate the 6% energy saving over its reference model using static calculation for GreenRE Bronze and Silver.
- Energy Usage Index (EUI) calculation
- Minimum score under NRB1-6 Artificial Lighting
GreenRE Gold and Platinum ≥ 5 credits
- NRB 2-1 Water Efficient Fittings - To demonstrate reduction of potable water usage by 10%.
- Minimum score under NRB 3-1 Sustainable Construction
GreenRE Gold ≥ 3 credits
GreenRE Platinum ≥ 5 credits
- Minimum score under NRB 3-2 Sustainable Products
GreenRE Gold ≥ 3 credits
GreenRE Platinum ≥ 4 credits
- NRB 3-3 (a) Green Plot Ratio, including site inventory analysis and carbon sequestration calculation.
- NRB 3-4 (a) Environmental Management Plan (EMP) during construction.
- NRB 3-4 (i) Provision of facilities or recycling bins for collection and storage of different recyclable waste such as paper, glass, plastic etc and establish the Waste Management Route and Provide recycler details.
- Provision of Building User Guide and Sustainable Operation Management Guide.
- NRB 4-1 (a) To meet the minimum requirement of ASHRAE 62.1. Ventilation for Acceptable Indoor Air Quality.
- NRB 6-1(a) & (b) & (c) calculation of operational and embodied carbon.

2. MINIMUM SYSTEM EFFICIENCY

- Air-conditioned Buildings

Minimum Design System Efficiency/Operating System Efficiency (DSE/OSE)

- For buildings using Water-Cooled Chilled Water Plant

GreenRE Rating	Building Cooling Load (RT)	
	< 500	≥ 500
	Efficiency (kW/RT)	
Bronze	0.85	0.75
Silver	0.80	0.70
Gold	0.75	0.68
Platinum	0.70	0.65

- For buildings using Air-Cooled Chilled Water Plant or Unitary Air-Conditioner

GreenRE Rating	Building Cooling Load (RT)	
	< 500	≥ 500
	Efficiency (kW/RT)	
Bronze	1.1	1.0
Silver	1.0	1.0
Gold	0.85	Case by case(i)
Platinum	0.78	

For building with building cooling load of more than 500RT, the use of air cooled central chilled water plant or other unitary air-conditioners are not encouraged for Gold and Platinum ratings. In general, the system efficiency of the air cooled central chilled-water plant and other unitary air-conditioners are to be comparable with the stipulated efficiency for water-cooled central chilled-water plant. Buildings that are designed with air cooled systems (e.g stratified and/or multi-block developments) and seeking Gold / Platinum GreenRE rating will be assessed on a case-by-case basis.

Points scoring and fulfilment of pre-requisite for air-conditioning will be allowed in the following scenarios:

- Provided by developer for net lettable area (NLA).
- Not provided by developer but included as part of green lease AND in building user guide.
- Not provided by developer but included as obligation to purchaser AND in building user guide.

Fulfilment of pre-requisite for air-conditioning without point scoring:

- Included in building user guide.
- For gold and platinum projects, savings in energy model to reflect efficiency of air-conditioners proposed in building user guide.

Note: The performance of the overall air-conditioning system for the building is based on the Operating System Efficiency (OSE) of the system during normal building operating hours as defined below:

<u>Office Building</u> Monday to Friday: 9am to 6pm <u>Retail Mall:</u> Monday to Sunday: 10am to 9pm <u>Institutional:</u> Monday to Friday: 9am to 5pm	<u>Hotel and Hospital:</u> 24-hour <u>Industrial and Other Building Types:</u> To be determined based on the operating hours
---	---

- **Non-Air-conditioned Buildings**

To be eligible for GreenRE Platinum Rating, ventilation simulation must be carried out to identify the most effective building design and layout. The simulation results and the recommendations derived are to be implemented to ensure good natural ventilation. Details and submission requirements on ventilation simulation can be found in Appendix B of this Guideline. Assistance from ceiling fans is allowable to improve the thermal comfort of a space whereby ventilation simulation shall prove that unassisted ventilation (NV) complies with the minimum requirement of 0.14 m/s wind velocity.

3. **ENERGY EFFICIENCY COMPLIANCE**

Projects shall demonstrate the stipulated performance through either option listed below (Gold and Platinum projects with air-conditioning system only):

Option 1 – Energy Savings

- To demonstrate the stipulated energy savings over its reference model using an energy modelling framework set out. Details and submission requirements on energy modelling can be found in Appendix A Energy Modelling Guideline. (Baseline – MS1525:2007)

Type of AC System	Energy Saving Required (%)	
	Gold	Platinum
Centralized Air Conditioning system / Unitary system	45	50
District Cooling System	25	30

Option 2 – Energy Usage Intensity (EUI) Benchmarking

- To demonstrate the stipulated Energy Usage Intensity (EUI) using an energy modelling framework set out. Details and submission requirements on energy modelling can be found in Appendix A Energy Modelling Guideline. (Baseline – MS1525:2007)

EUI is derived using the following equation:

$$\text{EUI} = [(\text{TBEC} - \text{CPEC}) / \text{GFA excluding carpark}]$$

Where:

TBEC = Total building energy consumption (kWh/year)

CPEC = Car Park Energy Consumption in (kWh/year)

GFA = Gross Floor Area (exclude car park area) (m²)

Note:

- Design EUI is based on 100% occupancy rate for consistency.
- All major active equipment to be included in the estimation of TBEC.
- During verification stage, if the occupancy rate is low, e.g., only 20% occupancy rate, it needs to be projected to 80% to get the EUI which reflects the actual operation situation

Building Type	Gold (kWh/m ² /year)	Platinum (kWh/m ² /year)
Office Building	135	120
Hotel	240	220
Retail Mall	230	210
School, University and College	110	100
School, University and College (MOE)	38	35
Hospital (Private and General)	375	340
Community Hospitals	230	120
Polyclinics	150	135
Nursing / Youth Homes	90	80

Table 1: Energy Usage Intensity (EUI) Benchmarking

4. M&V SYSTEM REQUIREMENTS (FOR CENTRALIZED AC SYSTEMS ONLY)

Provision of permanent measuring instruments for monitoring of water-cooled chilled-water system and air-cooled chilled water system operating system efficiency. The installed instrumentation shall have the capability to calculate resultant plant operating system efficiency (i.e. kW/RT) within 5% of its true value and in accordance with ASHRAE Guide 22 and AHRI 550/590. Heat balance test for water-cooled chilled water system is required for verification of the accuracy of the Measurement and Verification (M&V) instrumentation.

Mandatory Requirements:

1. Building Envelope – OTTV

- The OTTV of the building envelope for a building, having a **total air-conditioned area exceeding 1000 m² and above should not exceed 50 W/m².**

2. Roof

- In the **case of an air-conditioned building**, the concept of Roof Thermal Transfer Value (RTTV) is applied if the roof is provided with skylight and the entire enclosure below is fully air-conditioned.
- For roofs with skylight, the maximum recommended RTTV is 25 W/m².

3. Roof – U-Value

- **The roof of the building** shall not have a thermal transmittance (U-Value) greater than that tabulated in Table 2-1.

Table 2-1 Maximum U-Value for Roof (W/m²K)

Roof Weight Group	Maximum U-Value (W/m ² K)
Light (Under 50 kg/m ²)	0.4
Heavy (Above 50 kg/m ²)	0.6

4. Energy Management System

To Install Energy Management System where air-conditioned space is greater than 4000 m²

- 5. Provision of differently-able amenities** based on recommended or best practices as UBBL, MS1183 Part-8, MS1184, MS1331 and etc.

Part 1 - Energy Efficiency	GreenRE Credits								
(A) Applicable to Air-Conditioned Building Area (with an aggregate air-conditioned area > 1000m²)									
<p><u>NRB 1-1 THERMAL PERFORMANCE OF BUILDING ENVELOPE - OTTV</u></p> <p>Enhance overall thermal performance of building envelope to minimise heat gain thus reducing the overall cooling load requirement.</p> <p><u>Baseline:</u> Maximum permissible OTTV = 50 W/m²</p> <p><u>Prerequisite Requirement:</u> GreenRE Gold – OTTV of 42 W/m² or lower GreenRE Platinum – OTTV of 40 W/m² or lower</p>	<p>2 credits for every reduction of 1 W/m² in OTTV from the baseline.</p> <p>Credits scored = 100 – [2 x (OTTV)] where OTTV ≤ 50 W/m² (Up to 15 credits)</p>								
<p><u>NRB 1-2 AIR-CONDITIONING SYSTEM</u></p> <p>Applicable to Air-conditioned Building Areas (with an aggregate air-conditioned area > 1000m²)</p> <p>Encourage the use of better efficiency air-conditioned equipment to minimize the energy consumption. (System efficiency in kW/ton)</p> <p><u>(a) Water-Cooled Chilled-Water Plant:</u></p> <ol style="list-style-type: none"> i. Water-Cooled Chiller ii. Chilled water pump iii. Condenser water pump iv. Cooling tower <table border="1" data-bbox="209 1529 783 1883"> <thead> <tr> <th rowspan="2">Baseline</th> <th colspan="2">Building Cooling Load</th> </tr> <tr> <th>< 500 RT</th> <th>≥ 500 RT</th> </tr> </thead> <tbody> <tr> <td><u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant</td> <td>0.85 kW/RT</td> <td>0.75 kW/RT</td> </tr> </tbody> </table>	Baseline	Building Cooling Load		< 500 RT	≥ 500 RT	<u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant	0.85 kW/RT	0.75 kW/RT	<p><u>(a) Water-Cooled Chilled-Water Plant:</u></p> <div style="border: 1px solid black; padding: 5px; text-align: center; margin: 10px 0;">Building cooling load < 500RT</div> <p>14 credits for achieving plant efficiency of 0.85 kW/ton</p> <p>0.3 credit for every percentage improvement in the chiller plant efficiency better than 0.85 kW/ton</p> <p>Credit scored = 0.3 x (% improvement)</p> <div style="border: 1px solid black; padding: 5px; text-align: center; margin: 10px 0;">Building cooling load ≥ 500RT</div> <p>14 credits for achieving plant efficiency of 0.75 kW/ton</p> <p>0.35 credit for every percentage improvement in the chiller plant efficiency better than 0.75 kW/ton</p> <p>Credit scored = 0.35 x (% improvement) (up to 20 credits)</p>
Baseline		Building Cooling Load							
	< 500 RT	≥ 500 RT							
<u>Prerequisite Requirements</u> Minimum system efficiency of central chilled-water plant	0.85 kW/RT	0.75 kW/RT							

OR

(b) Air Cooled Chilled-Water Plant / Unitary Air-Conditioners:

Air cooled Chilled-Water Plant:

- Air-Cooled Chiller
- Chilled Water Pump

Unitary Air-Conditioners:

- Variable Refrigerant Flow (VRF) System
- Water-Cooled Package Unit
- Single-Split Unit
- Multi-Split Unit

Baseline	Building Cooling Load	
	< 500 RT	≥ 500 RT
<u>Prerequisite Requirements</u> Minimum system efficiency of air cooled chilled water plant or unitary conditioners	1.1 kW/RT	1.0 kW/RT

Note(1): Where there is a combination of centralised air-conditioned system with unitary air-conditioned system, the computation for the credits scored will be pro-rated based on the air-conditioning system aggregate capacity.

(c) Air Distribution system:

- Air Handling units (AHUs)
- Fan Coil Units (FCUs)

Fan System Input Power

Baseline: ASHRAE 90.1:2010 Clause 6.5.3.1 and as prescribed below;

OR

(b) Air Cooled Chilled-Water Plant / Unitary Air-Conditioners:

Building cooling load < 500RT

14 credits for achieving plant efficiency of 1.1 kW/ton

0.2 credit for every percentage improvement in the chiller plant efficiency better than 1.1 kW/ton

Credit scored = 0.2 x (% improvement)

Building cooling load ≥ 500RT

14 credits for achieving plant efficiency of 1.0 kW/ton

0.25 credit for every percentage improvement in the chiller plant efficiency better than 1.0 kW/ton

Credit scored = 0.25 x (% improvement)

(up to 20 credits)

(c) Air Distribution system:

0.15 credits for every percentage improvement in the air distribution system efficiency over the baseline

Credit scored = 0.15 x (% improvement)

(up to 8 credits)

Baseline Air Distribution System Type	Allowable Fan System Input Power	
	(kW/m ³ /s)	(W/CMH)
AHUs / FCUs ≥ 4kW (Constant Volume)	1.5	0.42
AHUs ≥ 4kW (Variable Volume)	2.1	0.58
Fan systems with nameplate motor power < 4kW	0.6	0.17

Note (2): For buildings using district cooling system, there is no need to compute the plant efficiency under Part 1-2 (a) and (b). The credits obtained will be pro-rated based on the air distribution system efficiency under Part 1-2(c).

(d) *Prerequisite requirements:* Provision of permanent measuring instruments for monitoring of water-cooled chilled water plant and air-cooled chilled water plant efficiency. The installed instrumentation shall have the capability to calculate resultant plant efficiency (i.e. kW/RT) within 5% of its true value and in accordance with ASHRAE Guide 22 and AHRI 550/590. The following instrumentation and installation are also required to be complied:

- Location and installation of the measuring devices to meet the manufacturer's recommendation.
- Data acquisition system to have a minimum resolution of 16 bit.
- All data logging with capability to trend at 1minute sampling time interval.
- Dedicated digital power meters shall be provided for the following groups of equipment: chiller(s), chilled water pump(s), condenser water pump(s) and cooling tower(s).
- Flow meters to be provided for chilled-water and condenser water loop and shall be of ultrasonic / full bore magnetic type or equivalent.
- Temperature sensors are to be provided for chilled water and condenser water loop

Applicable only to buildings with provision of water-cooled chilled water plants

2 credits

<p>and shall have an end-to-end measurement uncertainty not exceeding $\pm 0.05^{\circ}\text{C}$ over entire measurement or calibration range. All thermo-wells shall be installed in a manner that ensures that the sensors can be in direct contact with fluid flow. Provisions shall be made for each temperature measurement location to have two spare thermo-wells located at both side of the temperature sensor for verification of measurement accuracy.</p> <p>(e) <i>Prerequisite requirements:</i> Verification of central water cooled chilled-water plant instrumentation: Heat Balance – substantiating test for water cooled chilled-water plant to be computed in accordance with AHRI 550/590. The operating system efficiency and heat balance to be submitted to GreenRE upon commissioning.</p> <p>(f) Provision of variable speed controls for chiller plant equipment such as chilled-water pumps and cooling tower fans to ensure better part-load plant efficiency.</p> <p>(g) Sensors or similar automatic control devices are used to regulate outdoor air flow rate to maintain the concentration of carbon dioxide. Indoor carbon dioxide acceptable range ≤ 700 ppm above outdoor concentration.</p>	<p>1 credit</p> <p>1 credit</p> <p>1 credit</p>
<p style="text-align: right;">Sub-Total (A):</p>	<p>Sum of GreenRE credits obtained from NRB1-1 to 1-2</p>

Part 1-Energy Efficiency	GreenRE Credits
(B) Applicable to Non-Air-Conditioned Building Areas (with an aggregate non air-conditioned areas > 10% of total floor area excluding car parks and common areas)	
<p><u>NRB 1-3 BUILDING ENVELOPE – DESIGN/THERMAL PARAMETERS</u></p> <p>Enhance the overall thermal performance of building envelope to minimise heat gain which would improve indoor thermal comfort and encourage natural ventilation or mechanical ventilation.</p> <p>(a) Minimum direct west facing façade through building design orientation.</p> <p>Note (3): Orientation of façade that falls within the range of 22.5° N of W and 22.5° S of W will be defined as west facing façade. Core walls for lift or staircases and toilets that are located within this range are exempted in computation.</p> <p>(b)(i) Minimum west facing window opening.</p> <p>(b)(ii) Effective sun shading provision for windows on the west façade with minimum shading of 30%.</p> <p>(c) Better thermal transmittance (U-value) of external west facing walls.</p> <p>The U-value of external west facing wall should be equal or less than 2W/m²K</p>	<p>Credits scored = $10 - [0.2 \times (\% \text{ of west facing façade areas over total façade areas})]$</p> <p>(Up to 10 credits)</p> <p>Where there is no west facing façade, the total credits scored for this item will be <u>25 credits</u>; the NRB 1-3 b (i), b (ii) and (c) as listed below will not be applicable.</p> <p>Credits scored = $10 - [0.1 \times (\% \text{ of west facing window areas over total west facing façade areas})]$</p> <p>Credits scored = $0.1 \times (\% \text{ of west facing window areas with sun shading devices over total west facing façade areas})$</p> <p>(Up to 10 credits for NRB 1-3(b)(i) &(b)(ii))</p> <p>Credits scored = $0.05 \times (\% \text{ of the external west facing walls areas with U-value of } 2 \text{ W/m}^2\text{K or less over the total west facing façade areas})$</p> <p>(Up to 5 credits)</p>

(d) Better thermal transmittance (U-value) of roof.

Baseline: U-value for roof stated below depending on the weight range of roof structure:

Roof Weight Group (kg/m ²)	Maximum U-value (W/m ² K)
Light (Under 50)	0.4
Heavy (Over 50)	0.6

2 credits for every 0.1 W/m²K reduction
(Up to 5 credits)

NRB 1-4 NATURAL VENTILATION / MECHANICAL VENTILATION

(a) Natural Ventilation

Encourage building that facilitates good natural ventilation.

- (i) Proper design of building layout that utilises prevailing wind conditions to achieve adequate cross ventilation.
- (ii) Use of ventilation simulation modelling and analysis or wind tunnel testing to identify the most effective building design and layout to ensure good natural ventilation.

Note: Assistance from ceiling fan is allowable to improve the thermal comfort of a space whereby ventilation simulation shall prove that unassisted ventilation (NV) complies with the minimum requirement of 0.14 m/s wind velocity.

Prerequisite requirement: GreenRE Platinum: Ventilation simulation modelling and analysis are to be carried out to ensure good natural ventilation with minimum weighted average wind velocity of 0.6m/s within the functional spaces or units.

OR

(b) Mechanical Ventilation

Encourage energy efficient mechanical ventilation system as the preferred ventilation mode to non-air-conditioning in buildings.

Baseline: Fan power limitation in mechanical ventilation systems:

1 credit for every 10% of NV areas with window openings facing north and south directions and cross ventilation
Credits scored = 1 x (% units/10)
(Up to 10 credits)

5 credits
(Additional 5 credits if the recommendations are implemented and meet air-flow requirements – up to 10 credits)

OR

0.6 credit for every subsequent 1% improvement from the baseline
Credits scored = 0.6 x (% improvement)

(Up to 15 credits)

<table border="1" data-bbox="212 174 762 293"> <tr> <th colspan="2" data-bbox="212 174 762 210">Allowable nameplate motor power</th> </tr> <tr> <th data-bbox="212 210 496 246">Constant volume</th> <th data-bbox="496 210 762 246">Variable volume</th> </tr> <tr> <td data-bbox="212 246 496 293">1.7 kW/m³/s</td> <td data-bbox="496 246 762 293">2.4 kW/m³/s</td> </tr> </table> <p data-bbox="204 367 794 539">Note (3): Where there is a combination of naturally ventilated and mechanical ventilated spaces, the credits scored will only be based on the predominant ventilation modes of normally occupied spaces.</p>	Allowable nameplate motor power		Constant volume	Variable volume	1.7 kW/m ³ /s	2.4 kW/m ³ /s	
Allowable nameplate motor power							
Constant volume	Variable volume						
1.7 kW/m ³ /s	2.4 kW/m ³ /s						
Sub-Total (B):	Sum of GreenRE credits obtained from NRB 1-3 to 1-4						

Part 1 – Energy Efficiency	GreenRE Credits										
(C) General											
<p><u>NRB 1-5 DAYLIGHTING</u></p> <p>Encourage design that optimises the use of effective day lighting to reduce energy use for artificial lighting.</p> <p>a) Use of daylight simulation analysis or any relevant calculation to verify that 50% or more of all normally occupied areas achieve adequate daylight illuminance levels as specified in MS 1525:2019. Areas with illuminance levels below or above the range do not comply.</p> <p>b) Daylighting in the following common areas:</p> <ul style="list-style-type: none"> i. Lift lobbies and corridors ii. Staircases iii. Carparks <p>Note:</p> <p>a) Simulation or suitable daylight calculation is necessary for occupied space and common area to achieve the minimum daylight factors required</p> <p>b) For common areas, artificial lighting circuits schematic area necessary as documentary to proof design allows controllability to maximise harvested daylight</p>	<table border="1" data-bbox="876 293 1331 582"> <thead> <tr> <th>Percentage of Habitable Spaces with Adequate Ambient Lighting Level</th> <th>Credits Allocation</th> </tr> </thead> <tbody> <tr> <td>50% - 75%</td> <td>1</td> </tr> <tr> <td>76% - 90%</td> <td>2</td> </tr> <tr> <td>>90%</td> <td>3</td> </tr> </tbody> </table> <p>(Up to 3 credits)</p> <p>1 credit</p> <p>1 credit</p> <p>1 credit</p>	Percentage of Habitable Spaces with Adequate Ambient Lighting Level	Credits Allocation	50% - 75%	1	76% - 90%	2	>90%	3		
Percentage of Habitable Spaces with Adequate Ambient Lighting Level	Credits Allocation										
50% - 75%	1										
76% - 90%	2										
>90%	3										
<p><u>NRB 1-6 ARTIFICIAL LIGHTING</u></p> <p>Encourage the use of better efficient lighting to minimise energy consumption from lighting usage while maintaining proper lighting level. <u>Baseline:</u> Luminance level stated in MS 1525:2019</p> <p>Note: For retail applications, the following lighting power budget baselines shall be used:</p> <table border="1" data-bbox="209 1805 791 2063"> <thead> <tr> <th>Retail type</th> <th>Baseline</th> </tr> </thead> <tbody> <tr> <td>General</td> <td>≤ 15.0 W/m²</td> </tr> <tr> <td>Jewellery</td> <td>≤ 35.0 W/m²</td> </tr> <tr> <td>Furniture, clothing & accessories, cosmetic & art</td> <td>≤ 25.0 W/m²</td> </tr> <tr> <td>Supermarket, vehicle, sporting goods, stationary, & hardware</td> <td>≤ 20.0 W/m²</td> </tr> </tbody> </table>	Retail type	Baseline	General	≤ 15.0 W/m ²	Jewellery	≤ 35.0 W/m ²	Furniture, clothing & accessories, cosmetic & art	≤ 25.0 W/m ²	Supermarket, vehicle, sporting goods, stationary, & hardware	≤ 20.0 W/m ²	<p>0.25 credit for every percentage improvement in the lighting power budget</p> <p>Credits scored = 0.25 x (% improvement) (Including tenant lighting provision) (Up to 12 credits)</p> <p>(Excluding tenant lighting provision) (Up to 5 credits)</p>
Retail type	Baseline										
General	≤ 15.0 W/m ²										
Jewellery	≤ 35.0 W/m ²										
Furniture, clothing & accessories, cosmetic & art	≤ 25.0 W/m ²										
Supermarket, vehicle, sporting goods, stationary, & hardware	≤ 20.0 W/m ²										

<p>Note:</p> <ul style="list-style-type: none"> a) Lux level simulation is required to show compliance per MS1525:2019 b) The lighting circuit also should comply to the following: <ul style="list-style-type: none"> • To install at least 1 light switch with labels for switched zone $\leq 30\text{m}^2$. Zones $\geq 30\text{m}^2$ to be matched accordingly. • Light switches are to be placed near doorways and easily accessed; AND • Separate switches for lights parallel to natural lighting. 	
<p><u>NRB 1-7 VENTILATION IN CARPARKS</u></p> <p>Encourage the use energy efficient design and control of ventilation systems on carparks.</p> <ul style="list-style-type: none"> (a) Carparks designed with natural ventilation. (b) CO sensors are used to regulate the demand for mechanical ventilation (MV). <p>Note (4): Where there is a combination of different ventilation mode adopted for car park design, the credits scored under this requirement will be prorated accordingly.</p>	<p>Naturally ventilated carparks – 4 credits</p> <p>Credits scored based on the mode of mechanical ventilation provided</p> <p style="padding-left: 40px;">Fume extract- 2.5 credit</p> <p style="padding-left: 40px;">MV with or without supply – 2 credits</p> <p style="text-align: center;">(Up to 4 credits)</p>
<p><u>NRB 1-8 VENTILATION IN COMMON AREAS</u></p> <p>Encourage the use of energy efficient design and control of ventilation systems in the following common areas:</p> <ul style="list-style-type: none"> • Toilets • Staircases • Lift • Lobbies • Corridors • Atriums 	<p>Credits scored based on the mode of ventilation provided in the applicable areas.</p> <p>Natural vent. – 1.5 credits for each area</p> <p>Mechanical vent. – 0.5 credit for each area</p> <p style="text-align: center;">(Up to 5 credits)</p>
<p><u>NRB 1-9 LIFTS AND ESCALATORS</u></p> <p>Encourage the use of energy efficient lifts and escalators.</p>	<p>Extent of Coverage: All lifts and/or escalators</p>

<p>(a) Lifts with the following energy efficient features:</p> <ol style="list-style-type: none"> i. AC variable voltage and variable frequency (VVVF) motor drive or equivalent. ii. Sleep mode features or equivalent. <p>(b) Escalators with energy efficient features such as motion sensors.</p>	<p style="text-align: right;">1 credit</p> <p style="text-align: right;">1 credit</p>
<p><u>NRB 1-10 ENERGY EFFICIENT PRACTICES & FEATURES</u></p> <p>Encourage the use of energy efficient practices and features which are innovative and have positive environmental impact</p> <p>a) Computation of energy consumption based on design load in the form of Energy Usage Index (EUI)</p> <p>b) Use of vertical greenery system on east and west facade to reduce heat gain through building envelope.</p> <p>c) Installation of sub meter in switchboard for each service system that is >100kVA of the Total Connected Load (TCL).</p> <p>d) Use of energy efficient features: Examples:</p> <ul style="list-style-type: none"> • Heat recovery system • Ductless fan for basement ventilation • Motion sensors for staircases half landing • Sun pipes • Etc 	<p style="text-align: right;">1 credit</p> <p style="text-align: right;">1 credit for high impact 0.5 credit for low impact</p> <p style="text-align: right;">1 credit</p> <p style="text-align: right;">3 credits for every 1% energy saving over the total building energy consumption per features</p> <p style="text-align: right;">(Up to 9 credits)</p>

NRB 1-11 RENEWABLE ENERGY

Encourage the use of renewable energy sources in buildings

5 credits for every 1% replacement of electricity (based on total electricity consumption) by renewable energy

OR

3 credits for every 1% replacement of electricity (based on the total electricity consumption excluding tenant's usage) by renewable energy

OR

3 credits for every 10% of roof area used for solar panels.

OR

1 credit

For buildings where solar panels are not installed, provide solar panel installation ready roof. Appropriate roof pitch, static loads, mounting system, and roof access to be considered.

Note: The credit scored for renewable energy provision shall not result in a double grade jump in GreenRE rating (i.e from GreenRE Bronze or Silver to Gold or Platinum)

(Up to 20 credits)

Sub-Total (C):

Sum of GreenRE credits obtained from NRB 1-5 to 1-11

<p>PART 1 – ENERGY EFFICIENCY CATEGORY SCORE:</p>	<p>Sub-Total (A) X $\frac{\text{Air-Conditioned Building Floor Area}}{\text{Total Floor Area}}$</p> <p style="text-align: center;">+</p> <p>Sub-Total (B) X $\frac{\text{Non-Air-Conditioned Building Floor Area}}{\text{Total Floor Area}}$</p> <p style="text-align: center;">+</p> <p style="text-align: center;">Sub-Total (C)</p> <p>Where:</p> <p style="padding-left: 40px;">Sub-Total (A) = Sum of GreenRE Credits obtained Under Section (A) that is NRB 1-1 to 1-2</p> <p style="padding-left: 40px;">Sub-Total (B) = Sum of GreenRE Credits obtained Under Section (B) that is NRB 1-3 to 1-4</p> <p style="padding-left: 40px;">Sub-Total (C) = Sum of GreenRE Credits obtained Under Section (C) that is NRB 1-5 to 1-11</p> <p>If either Section (A) or Section (B) is not applicable, no pro-rating of areas is required for the score computation.</p> <p>Total floor area includes air-conditioned area and non-air-conditioned area but excluding car park and common area.</p>
--	---

Part 2 – Water Efficiency	GreenRE Credits									
<p><u>NRB 2-1 WATER EFFICIENT FITTINGS</u></p> <p>Encourage the use of water efficient fittings that are certified under the Water Efficiency Products Labelling Scheme (WEPLS).</p> <p>a) Basin taps and mixers b) Flushing cistern c) Shower taps and mixers or showerheads d) Sink/bib taps and mixers e) Urinals and urinal flush valve</p> <p>Note:</p> <ul style="list-style-type: none"> • Pre-requisite requirement - to demonstrate 10% reduction of potable water consumption using water savings calculator. 	<table border="1" data-bbox="810 250 1366 454"> <thead> <tr> <th colspan="3" data-bbox="810 250 1366 327">Rating Based on Water Efficiency Products Labelling Scheme (WEPLS)</th> </tr> <tr> <th data-bbox="810 329 1002 405">Efficient *</th> <th data-bbox="1003 329 1171 405">Highly Efficient **</th> <th data-bbox="1173 329 1366 405">Most Efficient ***</th> </tr> </thead> <tbody> <tr> <td data-bbox="810 407 1002 454">4 credits</td> <td data-bbox="1003 407 1171 454">6 credits</td> <td data-bbox="1173 407 1366 454">8 credits</td> </tr> </tbody> </table> <p>Credits can be scored based on the number and water efficiency rating of the fitting type used.</p> <p>(Up to 8 credits)</p>	Rating Based on Water Efficiency Products Labelling Scheme (WEPLS)			Efficient *	Highly Efficient **	Most Efficient ***	4 credits	6 credits	8 credits
Rating Based on Water Efficiency Products Labelling Scheme (WEPLS)										
Efficient *	Highly Efficient **	Most Efficient ***								
4 credits	6 credits	8 credits								
<p><u>NRB 2-2 WATER USAGE AND LEAK DETECTION</u></p> <p>Promote the use of sub-metering and leak detection system for better control and monitoring</p> <p>(a) Provision of sub-meters for major water uses which includes irrigation, cooling towers and tenant’s usage</p> <p>(b) Linking all sub-meters to Building Management System (BMS) for leak detection.</p>	<p>1 credit</p> <p>1 credit</p>									

<p><u>NRB 2-3 IRRIGATION SYSTEM AND LANDSCAPING</u></p> <p>Provision of suitable systems that utilise rainwater or recycled water for landscape irrigation to reduce potable water consumption.</p> <p>(a) Use of non-potable water including rainwater for landscape irrigation</p> <p>(b) Use of water efficient irrigation system with rain sensor</p> <p>(c) Use of drought tolerant plants that require minimal irrigation</p>	<p>1 credit</p> <p>Extent of Coverage: At least 50% of the landscape areas are served by the system 1 credit</p> <p>Extent of Coverage: At least 50% of the landscape areas 1 credit</p>
<p><u>NRB 2-4 WATER CONSUMPTION OF COOLING TOWER</u></p> <p>Reduce potable water consumption for cooling purpose.</p> <p>(a) Use of cooling tower water treatment system which can achieve 6 or better cycles of concentration at acceptable water quality</p> <p>(b) Use of recycled water from approved sources for cooling purpose</p>	<p>1 credit</p> <p>1 credit</p>
<p>PART 2 – WATER EFFICIENCY CATEGORY SCORE:</p>	<p>Sum of GreenRE credits obtained from NRB 2-1 to 2-4</p>

Part 3 – Environmental Protection	GreenRE Credits																								
<p><u>NRB 3-1 SUSTAINABLE CONSTRUCTION</u></p> <p>Encourage recycling and the adoption of building designs, construction practices and materials that are environmentally friendly and sustainable.</p> <p>(a) Use of sustainable and recycled materials;</p> <p>Green Cements with approved industrial by-product (such as Ground Granulated Blast furnace Slag (GGBS), silica fume, fly ash) to replace Ordinary Portland Cement (OPC).</p> <p>(b) Concrete Usage Index (CUI)</p> <p>Encourage more efficient concrete usage for building components.</p> <p><i>Prerequisite Requirement:</i> <i>Minimum score under NRB 3-1:</i> <i>GreenRE Gold ≥ 3 credits</i> <i>GreenRE Platinum ≥ 5 credits</i></p>	<table border="1" data-bbox="810 434 1386 752"> <thead> <tr> <th data-bbox="810 434 1190 551">% Replacement of OPC by approved industrial by-products</th> <th data-bbox="1192 434 1386 551">Credits Allocation</th> </tr> </thead> <tbody> <tr> <td data-bbox="810 553 1190 591">10</td> <td data-bbox="1192 553 1386 591">1</td> </tr> <tr> <td data-bbox="810 593 1190 631">20</td> <td data-bbox="1192 593 1386 631">2</td> </tr> <tr> <td data-bbox="810 633 1190 672">30</td> <td data-bbox="1192 633 1386 672">3</td> </tr> <tr> <td data-bbox="810 674 1190 712">40</td> <td data-bbox="1192 674 1386 712">4</td> </tr> <tr> <td data-bbox="810 714 1190 752">>50</td> <td data-bbox="1192 714 1386 752">5</td> </tr> </tbody> </table> <p data-bbox="991 786 1203 819">(Up to 5 credits)</p> <table border="1" data-bbox="810 889 1386 1249"> <thead> <tr> <th data-bbox="810 889 1099 981">Project CUI (m³/m²)</th> <th data-bbox="1101 889 1386 981">Credits Allocation</th> </tr> </thead> <tbody> <tr> <td data-bbox="810 983 1099 1037">≤ 0.70</td> <td data-bbox="1101 983 1386 1037">1</td> </tr> <tr> <td data-bbox="810 1039 1099 1093">≤ 0.60</td> <td data-bbox="1101 1039 1386 1093">2</td> </tr> <tr> <td data-bbox="810 1095 1099 1149">≤ 0.50</td> <td data-bbox="1101 1095 1386 1149">3</td> </tr> <tr> <td data-bbox="810 1151 1099 1205">≤ 0.40</td> <td data-bbox="1101 1151 1386 1205">4</td> </tr> <tr> <td data-bbox="810 1207 1099 1249">≤ 0.35</td> <td data-bbox="1101 1207 1386 1249">5</td> </tr> </tbody> </table> <p data-bbox="991 1305 1203 1339">(Up to 5 credits)</p>	% Replacement of OPC by approved industrial by-products	Credits Allocation	10	1	20	2	30	3	40	4	>50	5	Project CUI (m ³ /m ²)	Credits Allocation	≤ 0.70	1	≤ 0.60	2	≤ 0.50	3	≤ 0.40	4	≤ 0.35	5
% Replacement of OPC by approved industrial by-products	Credits Allocation																								
10	1																								
20	2																								
30	3																								
40	4																								
>50	5																								
Project CUI (m ³ /m ²)	Credits Allocation																								
≤ 0.70	1																								
≤ 0.60	2																								
≤ 0.50	3																								
≤ 0.40	4																								
≤ 0.35	5																								
<p><u>NRB 3-2 SUSTAINABLE PRODUCTS</u></p> <p>a) Encourage the use of products that are environmentally friendly and sustainable as follow:</p> <ul data-bbox="256 1666 786 2045" style="list-style-type: none"> • Eco Label products • Wood products certified by the Forest Stewardship council (FSC) or the Malaysia Certification Council (MTCC) • Agreement of the manufacturer or suppliers for the buyback programmes within the life cycle or at the end of materials life for recycling reuse purpose 	<table border="1" data-bbox="815 1494 1382 1780"> <thead> <tr> <th data-bbox="815 1494 1155 1612">Extent of use of environmentally friendly product</th> <th data-bbox="1157 1494 1382 1612">Weightage for Credit Allocation</th> </tr> </thead> <tbody> <tr> <td data-bbox="815 1615 1155 1668">Low Impact</td> <td data-bbox="1157 1615 1382 1668">0.5</td> </tr> <tr> <td data-bbox="815 1671 1155 1724">Medium impact</td> <td data-bbox="1157 1671 1382 1724">1</td> </tr> <tr> <td data-bbox="815 1727 1155 1780">High Impact</td> <td data-bbox="1157 1727 1382 1780">2</td> </tr> </tbody> </table> <p data-bbox="810 1850 1358 1921">Credits scored will be based on the extent of use of environmentally friendly product.</p> <p data-bbox="986 1957 1198 1991">(Up to 8 credits)</p>	Extent of use of environmentally friendly product	Weightage for Credit Allocation	Low Impact	0.5	Medium impact	1	High Impact	2																
Extent of use of environmentally friendly product	Weightage for Credit Allocation																								
Low Impact	0.5																								
Medium impact	1																								
High Impact	2																								

<p>b) Reuse Salvaged Materials Salvage or reuse construction materials for 2% of building materials based on the total material cost (extracted from the bill of quantities).</p> <p>c) Recycled Content</p> <p>Encourage the utilisation and use of recycled content material so that the total of post-consumer recycled content plus half of the pre-consumer content constitutes at least 10% based on the total material cost.</p> <p><i>Prerequisite Requirement:</i> <i>Minimum score under NRB 3-2:</i> <i>GreenRE Gold ≥ 3 credits</i> <i>GreenRE Platinum ≥ 4 credits</i></p>	<p>1 credit</p> <p>1 credit</p>														
<p><u>NRB 3-3 GREENERY PROVISION</u></p> <p>Encourage greater use of greenery and restoration of existing trees to reduce heat island effect.</p> <p>(a) Green Plot Ratio (GnPR) is calculated by considering the 3D volume covered by plants using the Leaf Area Index (LAI).</p> <p>Note:</p> <ul style="list-style-type: none"> To include site inventory analysis on greenery pre-development and calculation of carbon sequestration of greenery post development. <p>(b) Restoration of trees on site, conserving or relocating of existing trees on site. (at least 20%) a</p> <p>(c) Provision of compost bins to recycle organic waste to meet at least 30% of landscape fertilizer needs.</p>	<table border="1" data-bbox="820 1131 1385 1451"> <thead> <tr> <th>GnPR</th> <th>Credits Allocation</th> </tr> </thead> <tbody> <tr> <td>1.0 to < 2.0</td> <td>1</td> </tr> <tr> <td>2.0 to < 3.0</td> <td>2</td> </tr> <tr> <td>3.0 to < 4.0</td> <td>3</td> </tr> <tr> <td>4.0 to < 5.0</td> <td>4</td> </tr> <tr> <td>5.0 to < 6.0</td> <td>5</td> </tr> <tr> <td>≥ 6.0</td> <td>6</td> </tr> </tbody> </table> <p>1 credit</p> <p>1 credit</p>	GnPR	Credits Allocation	1.0 to < 2.0	1	2.0 to < 3.0	2	3.0 to < 4.0	3	4.0 to < 5.0	4	5.0 to < 6.0	5	≥ 6.0	6
GnPR	Credits Allocation														
1.0 to < 2.0	1														
2.0 to < 3.0	2														
3.0 to < 4.0	3														
4.0 to < 5.0	4														
5.0 to < 6.0	5														
≥ 6.0	6														

**NRB 3-4 ENVIRONMENTAL
MANAGEMENT PRACTICE**

Encourage the adoption of environmentally friendly practices during construction and building operation.

(a) Implement effective environmentally friendly programmes including monitoring and setting targets to minimise energy use, water use and construction waste during construction stage and include the following practices:

- To record the electrical consumption during the construction stage and hence, minimise energy usage by on-site utilities.
- Appointment of safety, health and environment officer.
- To prepare an Environmental Management Plan and conduct a complete Erosion Sedimentation Control Plan (ESCP).
- To prepare a Construction Waste Management Plan.
- To include commitment to recycle and/or salvage 50% of the volume of non-hazardous construction debris.
- Provide at least the minimum level of sanitation/safety facilities for construction workers.
- Use a low-flow flushing system and efficient fitting tap in the construction site office/ showroom.
- Provision of the Rainwater Harvesting System and the strategies of rainwater.
- Develop and implement an IAQ Management plan for Construction.

(b) Main builder that has good track records in the adoption of sustainable, environmentally friendly, and considerate practices during construction.

(c) Building quality is assessed and passed under the Quality Assessment System (QLASSIC) or Construction Quality Assessment System (CONQUAS) or Building Quality Assessment System (BuildQUAS).

(d) To perform IBS content scoring based on CIDB IBS scoring scheme.

1 credit

1 credit

1 credit

1 credit for IBS score \geq 50%
2 credits for IBS score \geq 70%

<p>(e) Developer, main builder, M&E consultant, and architect are ISO 14000 certified.</p> <p>(f) Project team comprises one Certified GreenRE/Green Mark AP/ MyCrest QP</p> <p>(g) Provision of building users' guide including details of the environmentally friendly facilities and features within the building and their uses in achieving the intended environment performance during the building operation.</p> <p>(h) Provision of Sustainable Operation and Management Guideline and briefing to the building management team</p> <p>(i) Provision of facilities or recycling bins for collection and storage of different recyclable waste such as paper, glass, plastic etc and establish the waste management route and provide recycler details.</p>	<p>0.25 credit for each firm (Up to 1 credit)</p> <p>1 credit</p> <p>1 credit</p> <p>1 credit</p> <p>1 credit</p>
<p><u>NRB 3-5 GREEN TRANSPORT</u></p> <p>Promote environmentally friendly transport options and facilities to reduce pollution from individual car use.</p> <p>(a) Good access (<800m walking distance) to public transport networks such as MRT/LRT stations or bus stops.</p> <p>(b) Provision of covered walkway to facilitate connectivity and the use of public transport.</p> <p>(c) Provision of infrastructure for electric charging stations to at least 10% of available parking spaces.</p> <p>(d) Provision of hybrid/electric vehicle charging stations and priority parking lots within the development.</p>	<p>1 credit</p> <p>1 credit</p> <p>1 credit</p> <p>Extent of coverage: Minimum 1 number priority parking bays for every 100 carpark lots. EV chargers – 1 for every 200 parking bays. (Cap at 3)</p> <p>(1 credit)</p>

<p>(e) Provision of covered / sheltered bicycles parking lots (i.e with rack / bar) and adequate shower and changing facilities.</p> <p>(f) Community connectivity. Locate the building within 800m of 5 basic service, not limited to :</p> <ul style="list-style-type: none"> • Place of worship. • Bank. • Pharmacy. • Convenience grocery. • Post office. • Laundry. • Hardware store. • Supermarket. • School. • Library. • Daycare centre. • Senior care facility. • Beauty salon. • Hospital/clinics. • Community centre. • Park. • Night market 	<p>Extent of Coverage:</p> <p>Bicycles parking lot: Minimum 10 number and maximum 50 numbers of bicycle parking lot.</p> <p>Shower Facilities: Minimum 1 number for every 100 regular occupant and additional 1 for every 150 occupants. (Cap at 7) (1 credit)</p> <p>1 credit</p>
<p><u>NRB 3-6 STORMWATER MANAGEMENT</u></p> <p>Encourage the treatment of stormwater runoff through provision of infiltration or design features before discharge to public drains.</p> <p>Provision of infiltration features or design features for new development and redevelopment in accordance with MSMA.</p>	<p>Reduce post development stormwater peak discharge rate and quantity from exceeding pre-development peak discharge rate and quantity:</p> <p>5 - 15% - 1 credit</p> <p>16 - 25% - 2 credits</p> <p>> 25% - 3 credits</p> <p>(Up to 3 credits)</p>

<p><u>NRB 3-7 REFRIGERANTS</u></p> <p>Reduce the potential damage to the ozone layer and the increase in global warming through the release of ozone depleting substances and greenhouse gases.</p> <p>(a) Refrigerants with ozone depleting potential (ODP) of zero OR with global warming potential (GWP) of less than 100.</p> <p>(b) Use of refrigerant leak detection system at critical areas of plant rooms containing chillers and other equipment with refrigerants.</p>	<p>1 credit</p> <p>1 credit</p>
<p>PART 3–ENVIRONMENTAL PROTECTION CATEGORY SCORE:</p>	<p>Sum of GreenRE credits obtained from NRB 3-1 to 3-7</p>

Part 4 – Indoor Environmental Quality	GreenRE Credits
<p><u>NRB 4-1 THERMAL COMFORT</u></p> <p>Air-conditioning system is designed to allow for cooling load variations due to fluctuations in ambient air temperature to ensure consistent indoor conditions for thermal comfort.</p> <p>a) Meet the minimum requirements of Section 4 through 7 of ASHRAE Standard 62.1, Ventilation for Acceptable Indoor Air Quality or any applicable local code, whichever is more stringent and requirement as follow:</p> <ul style="list-style-type: none"> • Indoor temperature between 23°C to 26°C • Relative Humidity between 50% to 70% <p>b) Additional 1 credit will be awarded for room temperature and humidity displays in all applicable areas.</p>	<p>1 credit</p> <p>1 credit</p> <p>(Up to 2 credits)</p>
<p><u>NRB 4-2 NOISE LEVEL</u></p> <p>Building is designed to achieve ambient internal noise level as specified:</p> <ul style="list-style-type: none"> • 55 dB (6am – 10pm) L_{Aeq} • 45 dB (10pm – 6am) L_{Aeq} 	<p>1 credit</p>
<p><u>NRB 4-3 INDOOR AIR POLLUTANTS</u></p> <p>Minimise airborne contaminants, mainly from inside sources to promote a healthy indoor environment.</p> <p>a) Use of low volatile organic compounds (VOC) paints and coatings certified under local/international certification body.</p> <p>b) Use of Low VOC material for the adhesives and sealant certified under local/international certification body for composite wood products.</p>	<p>Extent of Coverage: A at least 90% of the internal wall areas</p> <p>1 credit</p> <p>1 credit</p>

<p><u>NRB 4-4 INDOOR AIR QUALITY (IAQ) MANAGEMENT</u></p> <p>Ensure that building ventilation systems are designed and installed to provide acceptable IAQ under normal operating hours.</p> <p>a) Provision of filtration media and differential pressure monitoring equipment in Air Handling Units (AHUs).</p> <p>b) Implement effective IAQ management plan and Indoor Mould Prevention Guideline to ensure that building ventilation systems are clean and free from residuals left over from construction activities.</p>	<p>1 credit</p> <p>1 credit</p>
<p><u>NRB 4-5 HIGH FREQUENCY BALLASTS / LED DRIVERS</u></p> <p>Improve workplace lighting quality by avoiding low frequency flicker associated with fluorescent lighting with the use of high frequency ballasts in the fluorescent luminaries.</p> <p><i>Or</i></p> <p>Use of driver with output frequency < 200Hz and < 30% flicker for LED lighting.</p>	<p>Extent of Coverage: At least 90% of all applicable areas that are served by fluorescent luminaries</p> <p>1 credit</p>
<p><u>NRB 4-6 Access to view from Work Area</u></p> <p>Design \geq 60% of the occupied building spaces to have a direct line of sight through vision glazing and measured between 0.8 m and 2.3 m above the finished floor plan levels.</p>	<p>1 credit</p>
<p>Part 4 – INDOOR ENVIRONMENTAL QUALITY CATEGORY SCORE:</p>	<p>Sum of GreenRE credits obtained from NRB 4-1 to 4-6</p>

Part 5 – Other Green Features	GreenRE Credits
<p><u>NRB 5-1 GREEN FEATURES & INNOVATIONS</u></p> <p>Encourage the use of green features which are innovative and have positive environmental impact.</p> <p>Examples:</p> <ul style="list-style-type: none"> • Pneumatic waste collection system • Dual chute system • Self-cleaning façade system • Infiltration trenches • Integrated storm water retention/treatment into landscaping • Etc 	<p>2 credits for high impact item</p> <p>1 credit for medium impact item</p> <p>0.5 credit for low impact item</p> <p>(Up to 7 credits)</p>
<p>PART 5 – OTHER GREEN FEATURES CATEGORY SCORE:</p>	<p>Sum of GreenRE credits obtained from NRB 5-1</p>

Part 6- Carbon Footprint of Development	GreenRE Credits
<p><u>NRB 6-1 CARBON FOOTPRINT OF DEVELOPMENT</u></p> <p>a) Recognise the carbon emission based on operational carbon footprint computation of the building comprising energy [B6] and water consumption [B7].</p> <p>b) Calculation of product stage embodied carbon based on following building materials [A1-A3]:</p> <ul style="list-style-type: none"> - concrete - steel - bricks - cement - steel and metal <p>c) Calculation of construction stage embodied carbon [A4-A5]</p> <p>d) Reduction from reference embodied carbon (for Ready Mix Concrete, Cement, Steel Reinforcement, Bricks, Steel & Metal)</p>	<p style="text-align: center;">1 credit</p> <p style="text-align: center;">0.5 credit</p> <p style="text-align: center;">0.5 credit</p> <p style="text-align: center;">>10% 0.5 credit >30% 1 credit</p>
<p>PART 6- CARBON FOOTPRINT OF DEVELOPMENT</p> <p>CATEGORY SCORE:</p>	<p>Sum of GreenRE credits obtained from NRB 6-1</p>
<p>GreenRE Score (Non- Residential)</p> <p>GreenRE Score (NRB) = \sumCategory score [(Part 1-Energy Efficiency)+ (Part 2-Water Efficiency)+ (Part 3-Environmental Protection)+ (Part 4-Indoor Environmental Quality)+ (Part 5-Other Green Features)+ (Part 6-Carbon Emission of Development)]</p> <p>Where: Category Score for Part 1 \geq 30 credits and \sumCategory score for Part 2 to Part 6 \geq 20 credits</p>	

Option 1 – Energy Saving Requirement

Requirements	<p>To demonstrate the stipulated energy savings over its reference model using an energy modelling framework set out. Details and submission requirements on energy modelling can be found in Appendix A Energy Modelling Guideline. (Baseline – MS1525:2007)</p> <table border="1" data-bbox="424 405 1410 622"> <thead> <tr> <th data-bbox="424 405 775 450" rowspan="2">Type of AC System</th> <th colspan="2" data-bbox="775 405 1410 450">Energy Saving Required (%)</th> </tr> <tr> <th data-bbox="775 450 1078 495">Gold</th> <th data-bbox="1078 450 1410 495">Platinum</th> </tr> </thead> <tbody> <tr> <td data-bbox="424 495 775 577">Centralized Air Conditioning system</td> <td data-bbox="775 495 1078 577">45</td> <td data-bbox="1078 495 1410 577">50</td> </tr> <tr> <td data-bbox="424 577 775 622">District Cooling System</td> <td data-bbox="775 577 1078 622">25</td> <td data-bbox="1078 577 1410 622">30</td> </tr> </tbody> </table>	Type of AC System	Energy Saving Required (%)		Gold	Platinum	Centralized Air Conditioning system	45	50	District Cooling System	25	30
Type of AC System	Energy Saving Required (%)											
	Gold	Platinum										
Centralized Air Conditioning system	45	50										
District Cooling System	25	30										
Documentary Evidences	<p><u>Actual Assessment:</u></p> <ul style="list-style-type: none"> • Detailed report from simulation software. <p><u>Site Verification Assessment</u></p> <ul style="list-style-type: none"> • 12 months of operational energy consumption data. • Justification of energy saving. • Breakdown of the energy consumption based on power meters reading. • Energy audit report. 											

Option 2– Energy Usage Intensity (EUI)

Requirements	<p>Total Building annual energy consumption over the gross floor area of the building (kWh/m²/yr). Based on:</p> <ul style="list-style-type: none"> • Energy Calculation or Energy Simulation • Measurement – In operation <p>The project shall demonstrate the Energy Usage Intensity (EUI) and show compliance to the table below (minimum occupancy >80%):</p> <p>EUI is derived using the following equation:</p> $EUI = [(TBEC - CPEC) / GFA \text{ excluding carpark}]$ <p>Where: TBEC = Total building energy consumption (kWh/year) CPEC = Car Park Energy Consumption in (kWh/year) GFA = Gross Floor Area (exclude car park area) (m²)</p> <p>Note:</p> <ol style="list-style-type: none"> 1) Design EUI is based on 100% occupancy rate for consistency. 2) All major active equipment to be included in the estimation of TBEC. 3) During verification stage, if the occupancy rate is low, e.g., only 20% occupancy rate, it needs to be projected to 80% to get the EUI which reflects the actual operation situation <table border="1" data-bbox="432 1218 1342 1655"> <thead> <tr> <th>Building Type</th> <th>Gold (kWh/m²/year)</th> <th>Platinum (kWh/m²/year)</th> </tr> </thead> <tbody> <tr> <td>Office Building</td> <td>135</td> <td>120</td> </tr> <tr> <td>Hotel</td> <td>240</td> <td>220</td> </tr> <tr> <td>Retail Mall</td> <td>230</td> <td>210</td> </tr> <tr> <td>School, University and College</td> <td>110</td> <td>100</td> </tr> <tr> <td>School, University and College (MOE)</td> <td>38</td> <td>35</td> </tr> </tbody> </table>	Building Type	Gold (kWh/m ² /year)	Platinum (kWh/m ² /year)	Office Building	135	120	Hotel	240	220	Retail Mall	230	210	School, University and College	110	100	School, University and College (MOE)	38	35
Building Type	Gold (kWh/m ² /year)	Platinum (kWh/m ² /year)																	
Office Building	135	120																	
Hotel	240	220																	
Retail Mall	230	210																	
School, University and College	110	100																	
School, University and College (MOE)	38	35																	

Documentary Evidences	<p><u>Actual Assessment:</u></p> <ul style="list-style-type: none"> • Details report from simulation software <p><u>Site Verification Assessment</u></p> <ul style="list-style-type: none"> • Scenario 1), based on utility bill, if the occupancy rate is low, e.g. only 20% occupancy rate, it needs to be projected to 80% to get the EUI which reflects the actual operation situation; • Scenario 2), based on the utility bills, If the actual operation hours are the same as what were used during the design stage, no adjustment required for operational hours; If fixed operational hours were used during design and they are different from actual operation hours, adjustment needs to be done based on actual operational hour 																														
Worked Example	<p>Example 1</p> <table border="1" data-bbox="373 757 1412 1133"> <thead> <tr> <th>Office building</th> <th colspan="2">Result based on projected data for existing building undergoing retrofit)</th> </tr> </thead> <tbody> <tr> <td>TBEC (Total Annual Building Energy Consumption):</td> <td>250,500</td> <td>kWh/year</td> </tr> <tr> <td>GFA</td> <td>2,584</td> <td>m²</td> </tr> <tr> <td>EUI</td> <td>96.9</td> <td>kWh/m²/year</td> </tr> </tbody> </table> <p>Based on the requirement, it meets the Platinum EUI <120 requirement.</p> <p>Example 2:</p> <p>During verification stage, which is one year after operation, if the occupancy rate is only 30%:</p> <table border="1" data-bbox="373 1370 1412 1955"> <thead> <tr> <th>A small office building</th> <th colspan="2">Results based on projected data for existing building undergoing retrofit)</th> </tr> </thead> <tbody> <tr> <td>Annual Total Building Energy Consumption: At 30% occupancy</td> <td>100,000</td> <td>kWh/year</td> </tr> <tr> <td>GFA</td> <td>2,584</td> <td>m²</td> </tr> <tr> <td>EUI</td> <td>38.77</td> <td>kWh/m²/year</td> </tr> <tr> <td>TBEC Adjusted to 80% occupancy</td> <td>=100,000 ÷ 0.3 × 0.8 = 266667</td> <td>kWh/year</td> </tr> <tr> <td>EUI after adjustment</td> <td>103.2</td> <td>kWh/m²/year</td> </tr> </tbody> </table> <p>With adjusted EUI of 103.2 the project can pass the verification requirement for Platinum</p>	Office building	Result based on projected data for existing building undergoing retrofit)		TBEC (Total Annual Building Energy Consumption):	250,500	kWh/year	GFA	2,584	m ²	EUI	96.9	kWh/m ² /year	A small office building	Results based on projected data for existing building undergoing retrofit)		Annual Total Building Energy Consumption: At 30% occupancy	100,000	kWh/year	GFA	2,584	m ²	EUI	38.77	kWh/m ² /year	TBEC Adjusted to 80% occupancy	=100,000 ÷ 0.3 × 0.8 = 266667	kWh/year	EUI after adjustment	103.2	kWh/m ² /year
Office building	Result based on projected data for existing building undergoing retrofit)																														
TBEC (Total Annual Building Energy Consumption):	250,500	kWh/year																													
GFA	2,584	m ²																													
EUI	96.9	kWh/m ² /year																													
A small office building	Results based on projected data for existing building undergoing retrofit)																														
Annual Total Building Energy Consumption: At 30% occupancy	100,000	kWh/year																													
GFA	2,584	m ²																													
EUI	38.77	kWh/m ² /year																													
TBEC Adjusted to 80% occupancy	=100,000 ÷ 0.3 × 0.8 = 266667	kWh/year																													
EUI after adjustment	103.2	kWh/m ² /year																													

(I) Energy Related Requirements

Part 1- Energy Efficiency

- NRB 1-1 Thermal Performance of Building Envelope-OTTV**
- NRB 1-2 Air-Conditioning System**
- NRB 1-3 Building Envelope – Design / Thermal Parameters**
- NRB 1-4 Natural Ventilation (exclude carparks)**
- NRB 1-5 Daylighting**
- NRB 1-6 Artificial Lighting**
- NRB 1-7 Ventilation in Carparks**
- NRB 1-8 Ventilation in Common Areas**
- NRB 1-9 Lift and Escalators**
- NRB 1-10 Energy Efficient Practices & Features**
- NRB 1-11 Renewable Energy**

NRB 1-1 THERMAL PERFORMANCE OF BUILDING ENVELOPE - OTTV

Objectives	Enhance overall thermal performance of building envelope to minimise heat gain thus reducing the overall cooling load requirement.
Applicability	Applicable to air-conditioned building spaces with aggregate areas > 1000m ² .
Baseline Standard	<p>Maximum permissible OTTV = 50 W/m²</p> <p>OTTV stands for Overall Thermal Transfer Value.</p> <p>Maximum permissible RTTV = 25 W/m²</p> <p>RTTV stands for Roof Thermal Transfer Value.</p> <p>In the case of an air-conditioned building, the concept of Roof Thermal Transfer Value (RTTV) is applied if the roof is provided with skylight and the entire enclosure below is fully air-conditioned.</p> <p>The computation of OTTV & RTTV shall be based on the methodology specified in the MS 1525:2019.</p>
Requirements	<p>Up to 15 credits can be scored for building envelope with better thermal performance than the baseline standard:</p> <p>2 credits for every reduction of 1 W/m² in OTTV from the baseline.</p> <p>Credits scored = 100 – [2 x (OTTV)] where OTTV ≤ 50 W/m²</p> <p>For developments consisting of more than one building, the weighted average of the OTTVs based on the façade areas of these buildings shall be used as the basis for credits allocation.</p> <p>That is:</p> $OTTV_{\text{weighted average}} = \sum (OTTV_{\text{bldg}} \times A_{\text{bldg}}) / A_{\text{devt}}$ <p>where OTTV_{bldg} = OTTV for building (W/m²) A_{bldg} = Summation of all façade areas (m²) in a building A_{devt} = Summation of total applicable façade areas of all buildings within the development (m²) (i.e. $\sum A_{\text{bldg}}$)</p>
Prerequisite Requirements	GreenRE Gold – OTTV of 42 W/m ² or lower GreenRE Platinum – OTTV of 40 W/m ² or lower

<p>Documentary Evidences</p>	<ul style="list-style-type: none"> • Site plan with clearly demarcated the orientation of the building. • Architectural elevation drawings showing the composition of the different façade or wall systems that are relevant for the computation of OTTV. • Glazing specification showing the U Value and SC Value. • Window and door schedule. • Detailed area (m²) tabulation of fenestration and wall for every façade showing the window to wall ratio (WWR). • Calculation of U Value for all type of external walls. • Calculation of the Shading Coefficient for external shading device. • OTTV calculation for each facing wall. • A drawing showing the cross-sections of typical parts of the roof construction, giving details of the type and thickness of basic construction materials, insulation and air space. • The U-value of the roof assembly and technical specification of the roof insulation (if any). <p><i>In the case of an air-conditioned building, the concept of Roof Thermal Transfer Value (RTTV) is applied if the roof is provided with skylight and the entire enclosure below is fully air-conditioned.</i></p> <ul style="list-style-type: none"> • RTTV Calculation (if applicable) • Skylight specification showing the U Value and SC Value.
<p>References</p>	<p>MS1525:2019- Energy Efficiency and Use of Renewable Energy for Non-Residential Buildings - Code of Practice</p>

NRB 1-2 AIR-CONDITIONING SYSTEM

Objectives	Encourage the use of better efficient air-conditioned equipment to minimise energy consumption.											
Applicability	<p>Applicable to air-conditioned building areas where its aggregate air-conditioned areas > 1000m².</p> <p>Scope covers all air-conditioned equipment for the buildings as listed:</p> <ul style="list-style-type: none"> • Chillers • Chilled water pumps • Condenser water pumps • Cooling Towers • Air Handling Units (AHU) • Fan Coil Units (FCU) • Unitary Air-Conditioners/ Condensing Units which include single-split units, multi-split units and variable refrigerant flow (VRF) system 											
Baseline Standard	<p>Minimum efficiency requirement of the air-conditioning system stated in MS 1525:2019 or SS 530 & SS CP 13.</p> <p>Points scoring and fulfilment of pre-requisite for air-conditioning will be allowed in the following scenarios:</p> <ul style="list-style-type: none"> • Provided by developer for NLA. • Not provided by developer but included as part of green lease AND inclusion in building user guide. • Not provided by developer but included as obligation to purchaser AND inclusion in building user guide. <p>Fulfilment of pre-requisite for air-conditioning without point scoring:</p> <ul style="list-style-type: none"> • Included in building user guide. • For gold and platinum projects, savings in energy model to reflect efficiency of air-conditioners proposed in building user guidelines. <p>1-2(a) <u>Water-Cooled Chilled Water Plant</u></p> <table border="1" data-bbox="518 1523 1332 1724"> <thead> <tr> <th rowspan="2">Baseline</th> <th colspan="2">Building Cooling Load</th> </tr> <tr> <th>< 500 RT</th> <th>≥ 500 RT</th> </tr> </thead> <tbody> <tr> <td><i>Prerequisite Requirements</i></td> <td>0.85</td> <td>0.75</td> </tr> <tr> <td>Minimum system efficiency of central chilled-water plant</td> <td>kW/RT</td> <td>kW/RT</td> </tr> </tbody> </table> <p>i. Baseline for Water-Cooled Chiller – Refer Table 25 of MS 1525:2007 to calculate Its Coefficient of Performance (COP)</p> <p>ii. Chilled-water pump and condenser water pump efficiency – Refer to Clause 8.2.5.1 in MS 1525:2007 which states that for chilled water or condenser water pumping system operating for more than 750 hours a year, the pump efficiency shall be:</p>	Baseline	Building Cooling Load		< 500 RT	≥ 500 RT	<i>Prerequisite Requirements</i>	0.85	0.75	Minimum system efficiency of central chilled-water plant	kW/RT	kW/RT
Baseline	Building Cooling Load											
	< 500 RT	≥ 500 RT										
<i>Prerequisite Requirements</i>	0.85	0.75										
Minimum system efficiency of central chilled-water plant	kW/RT	kW/RT										

Table 21. Maximum power consumption for pumping system

Type of pumping system	Maximum Power consumption [W/(m3/h)]
Condenser water pump	84
Chilled water pump	97

Cooling tower performance at the rating condition states in Table 3 SS 530.

Rating condition is as follows: 35°C Entering water
29°C Leaving water
24°C Wet Bulb Outdoor air

Propeller and axial fan cooling tower:

With heat rejected from every 3.23 L/s of condenser water per 1 kW of fan power rating:

Cooling tower performance $\leq 1\text{kW} / 3.23 \text{ L/s}$
 $\leq 0.310 \text{ kW/ L/s}$

Centrifugal fan cooling tower:

With heat rejected from every 1.7L/s of condenser water per 1kW of fan power rating:

Cooling tower performance $\leq 1\text{kW} / 1.7 \text{ L/s}$
 $\leq 0.588 \text{ kW / L/s}$

OR

1-2(b) Air-Cooled Chilled-Water Plant / Unitary Air-Conditioners

Baseline	Building Cooling Load	
	< 500 RT	$\geq 500 \text{ RT}$
<u>Prerequisite Requirements</u> Minimum system efficiency of air cooled chilled water plant or unitary conditioners	1.1 kW/RT	1.0 kW/RT

- Air-cooled chilled water plant - Refer Table 25 of MS 1525:2007 to calculate its Coefficient of Performance (COP).
- Unitary Air-Conditioners / Condensing Units – Refer Table 23 of MS 1525:2007

Note: If the specific type of air conditioned is not found in MS 1525:2007, please refer to SS 530 to make the calculation on COP. Priority given to MS 1525:2007.

1-2(c) Air Distribution System – Refer ASHRAE 90.1:2010 Clause 6.5.3.1 as prescribed below:

Baseline Air Distribution System Type	Allowable Fan System Input Power	
	(kW/m ³ /s)	(W/CMH)
AHUs / FCUs ≥ 4kW (Constant Volume)	1.5	0.42
AHUs ≥ 4kW (Variable Volume)	2.1	0.58
Fan systems with nameplate motor power < 4kW	0.6	0.17

1-2(d) Provision of permanent measuring instruments to monitor water-cooled and air-cooled chilled water plant

- The instrumentation installed in the system shall have capability to calculate resultant plant efficiency within $\pm 5\%$ of its true value – Refer ASHRAE Guide 22 and AHRI 550/590.
- The following instrumentation accuracy as follow can be considered for monitoring central water-cooled chilled plant efficiency.

Description	Measurement error
<u>Temperature sensors</u> - 10K/30K Thermistor - Platinum Resistance Thermometers	$\pm 0.03 - 0.05$ °C at 0°C
<u>Floor Sensor Meter</u> - Ultrasonic - Full bore magnetic	$\pm 0.5 - 1.0$ % over entire measurement range
Power meter	ANSI C12.1-2008, Class 1 $\pm 1\%$

1-2(e) Verification of central chilled water plant instrumentation – Heat Balance substantiating test

- Substantiating test shall be conducted as accordance to AHRI 550/590
- The heat balance shall be conducted over entire normal operating hours with more than 80% of the computed balance within $\pm 5\%$ over the audit period

	<p>Heat balance is denoted by below equation:</p> $q_{\text{condenser}} = q_{\text{evaporator}} + W_{\text{input}}$ <p>Where;</p> <p>$q_{\text{condenser}}$ = heat rejected (in kW or RT) $q_{\text{evaporator}}$ = cooling load (in kW or RT) W_{input} = measured electrical power input to compressor</p> <p>1-2(f) Provisioning of variable speed controls for chiller plant equipment</p> <p>1-2(g) Provisioning of automatic control devices or sensors to regulate outdoor air flow rate to maintain the concentration of Carbon Dioxide at acceptable range ≤ 700 ppm above outdoor concentration.</p>
<p>Requirements</p>	<p><u>1-2(a) Air-Conditioned Plant (Up to 20 credits)</u></p> <ul style="list-style-type: none"> • Building cooling load $\geq 500\text{RT}$: <p>14 credits for achieving plant efficiency of 0.75 kW/ton</p> <p>0.35 credit for every percentage improvement in the chiller plant efficiency better than 0.75 kW/ton</p> <p>Credit scored = 0.35 x (% improvement)</p> <ul style="list-style-type: none"> • Building cooling load $< 500\text{RT}$: <p>14 credits for achieving plant efficiency of 0.85 kW/ton</p> <p>0.3 credit for every percentage improvement in the chiller plant efficiency better than 0.85 kW/ton</p> <p>Credit scored = 0.3 x (% improvement)</p> <p style="text-align: center;">(up to 20 credits)</p> <p style="text-align: center;">OR</p> <p><u>1-2(b) Air-Conditioned Plant (Up to 20 credits)</u></p> <ul style="list-style-type: none"> • Building cooling load $\geq 500\text{RT}$: <p>14 credits for achieving plant efficiency of 1.0 kW/ton</p> <p>0.25 credit for every percentage improvement in the chiller plant efficiency better than 1.0 kW/ton</p>

	<p>Credit scored = $0.25 \times (\% \text{ improvement})$</p> <ul style="list-style-type: none"> • Building cooling load < 500RT: <p>14 credits for achieving plant efficiency of 1.1 kW/ton</p> <p>0.2 credit for every percentage improvement in the chiller plant efficiency better than 1.1 kW/ton</p> <p>Credit scored = $0.2 \times (\% \text{ improvement})$</p> <p>(up to 20 credits)</p> <p><u>1-2 (c) Air Distribution System (Up to 8 credits)</u></p> <p>0.15 credits for every percentage improvement in the air distribution system efficiency above the baseline.</p> <p>Credits scored = $0.15 \times (\% \text{ improvement})$</p> <p>Note (1): For building using district cooling system, there is no need to compute the plant efficiency under item NRB 1-2(a). The credit obtained will be pro-rated based on the air distribution system efficiency under NRB 1-2(c).</p> <p>1-2 (d) 2 credit can be scored for the provision of permanent measuring instruments for monitoring of water cooled chilled-water plant and air-cooled chilled water plant efficiency</p> <p>1-2 (e) 1 credit can be scored for verification of central water cooled chilled-water plant instrumentation: Heat Balance – substantiating test for water cooled chilled-water plant to be computed in accordance with AHRI 550/590. The operating system efficiency and heat balance to be submitted to GreenRE upon commissioning.</p> <p>1-2(f) 1 credit can be scored if variable speed controls for chiller plant equipment such as chilled-water pumps and cooling tower fans are provided to ensure better part-load plant efficiency.</p> <p>1-2(g) 1 credit can be scored if sensors or similar automatic control devices are used to regulate outdoor air flow rate to maintain the concentration of carbon dioxide (CO₂) ≤ 700 ppm above outdoor.</p>
<p>Documentary Evidences</p>	<p><u>For 1-2 (a) and 1-2 (b)</u></p> <ul style="list-style-type: none"> • Detailed calculations of the overall improvement in equipment/system efficiency of the air-conditioning plants/ units showing the design cooling system capacity and the system efficiency (including individual equipment efficiency).

- Calculation and technical data of the designed system efficiency of chillers at part load condition.
- Technical product information of all air-conditioning and system which included chillers, chilled water pumps, condenser water pumps, cooling towers.
- Schematic drawings showing the air-conditioning system.
- Schedules of the air-conditioning system.

For 1-2 (c)

- Detailed calculations of the overall improvement for air distribution system.
- Technical product information of all AHUs, FCUs, and etc.
- AHUs and FCUs schedule and schematic drawing.

For 1-2 (d)

- Instrument's calibration certificates from accredited laboratory or batch calibration certificates from manufacturer.
- Schematic drawing showing the location of the digital power meters, flow meters and temperature sensors.
- Summary of instruments, standard and measurement accuracy to be presented in the following format:

Instruments	Instruments calibration standard	Quantity	Measurement Error (% of reading)	Resultant Error (% kW/RT)	Type/Brand/ Model
Temperature/Sensors					
Flow meter/Sensors					
Power Meter					

- Technical specification of the digital power meters, flow meters and temperature sensors.

For 1-2 (e)




- Computation of the percent heat balance that is the total heat gain and total heat rejected must be within $\pm 5\%$ for 80% of the sampled credits over the normal building operations hours accordance with AHRI550/590.
- Detailed calculations of the overall uncertainty of measurement of the resultant chiller plant efficiency in kW/RT to be within $\pm 5\%$ of the true value based on instrumentation specification.

For 1-2 (f) and 1-2 (g)

- Extracts of the tender specification showing the requirements to incorporate these control devices.
- Plan layouts showing the locations and the types of control devices used to regulate fresh air intake.

	<ul style="list-style-type: none"> • Technical product specification of the control devices.
References	<p>(a) MS 1525:2019 – Energy efficient and use of renewable energy for non-residential building – Code of Practice</p> <p>(b) SS 530 – Code of Practice for Energy Efficiency Standard for Building Services and Equipment.</p> <p>(c) SS CP 13 – Code of Practice for Mechanical Ventilation and Air-Conditioning in Buildings.</p>
Worked Example	<p>Case: District Cooling Plant (DCP)</p> <p><u>For 1-2(a) (ii)</u> An air-conditioned building equipped only AHU and FCU. Whilst its chiller, cooling tower and pumps are placed outside the building. The AHU performance system is 8 %.</p> <p>0.5 credit for AHU improvement; $0.15 \times 8 \% = 1.2$ credits</p> <p><u>For 1-2(a) (i).</u> The pro-rate calculation shall be;</p> <p>$\frac{1.2 \text{ credits}}{5 \text{ credits}} \times 20 \text{ credits} = 4.8 \text{ credits}$</p> <p>Total credits scored for part 1-2(a)(i) and 1-2(a)(ii) = $1.2 + 4.8 = 6$ credits</p>

NRB 1-3 BUILDING ENVELOPE – DESIGN/THERMAL PARAMETERS

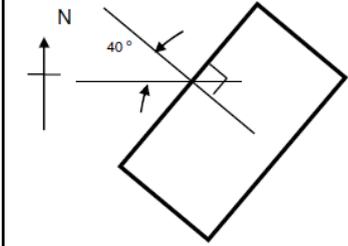Objectives	Enhance the overall performance of building envelope to minimise heat gain which would improve indoor thermal comfort and encourage natural ventilation.						
Applicability	Applicable to non-air-conditioned building spaces with aggregate areas > 10% of the total floor areas excluding carparks and common area						
Baseline Standard	<p>Baseline standard for 1-3(d) – U-value for roof:</p> <p style="text-align: center;">Table 1-3.1: Maximum U-value for roof</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Roof Weight Group</th> <th>Maximum U-Value (W/m²K)</th> </tr> </thead> <tbody> <tr> <td>Light (Under 50 kg/m²)</td> <td>0.4</td> </tr> <tr> <td>Heavy (Above 50 kg/m²)</td> <td>0.6</td> </tr> </tbody> </table>	Roof Weight Group	Maximum U-Value (W/m ² K)	Light (Under 50 kg/m ²)	0.4	Heavy (Above 50 kg/m ²)	0.6
Roof Weight Group	Maximum U-Value (W/m ² K)						
Light (Under 50 kg/m ²)	0.4						
Heavy (Above 50 kg/m ²)	0.6						
Requirements	<p>1-3(a) Up to 10 credits can be scored if the building envelope is designed with minimum direct west facing façade by having better building orientation. Where there is no west facing façade, the credits scored will be 24 credits and the requirements under 1-3 (b)(i), b(ii) and (c) will not be applicable for scoring.</p> <p style="text-align: center;">Credits scored = 10 – [0.2 x (% of west facing façade areas over total façade areas)]</p> <p>Note: Orientation of façade that falls within the range of 22.5° N of W and 22.5° S of W will be defined as <u>west facing façade</u> (see illustration below). Core walls for lift or staircases and toilets that are located within this range are exempted in computation.</p> <p style="text-align: center;">Illustration 1-3.1: Orientation of facade</p> <div style="display: flex; justify-content: space-around;"> <div style="text-align: center;">  <p>Illustration 1 An example of direct west facing facade</p> </div> <div style="text-align: center;">  <p>Illustration 2 The block is orientated 10°N of W which is less than of 22.5° N of W. In this instance, the façade is defined as 'west facing façade'.</p> </div> </div> <div style="text-align: center; margin-top: 20px;">  <p>Illustration 3 The block is orientated 40°N of W which exceeds 22.5°N of W and hence the façade is not considered as 'west facing façade' in the computation.</p> </div>						

1-3(b) Up to 10 credits can be scored for design with (i) minimum west facing window opening and/or (ii) having effective sun shading provision for windows with minimum shading of 30% on the west façade.

For 1-3 (b)(i) Credits scored = $10 - [0.1 \times (\% \text{ of west facing window areas over total west facing façade areas})]$

For 1-3 (b)(ii) Credits scored = $0.1 \times (\% \text{ of west facing window areas with sun shading devices over total west facing façade areas})$

Notes: For 1-3 (b)(ii), credits can only be scored if the sun shading devices meet at least a shading of 30% as tabulated in Table 1-3.2 below:

Table 1-3.2 : Minimum Requirement on Shading Devices for West Façade

Types of Sun shading Devices	Angle of inclination	Desired Shading			
		30%	40%	50%	60%
Horizontal Shading (R ₁)	0°	0.6	0.9	1.5	
	20°	0.4	0.6	0.9	1.8
	40°	0.4	0.5	0.7	1.1
Vertical Shading (R ₂)	0°	2.1			
	20°	1.1	1.7	2.5	
	40°	0.7	1	1.4	
	50°	0.6	0.9	1.1	2.8

Where

Horizontal Shading/ Projections (R₁)


$$R_1 = \frac{P}{H}$$

θ_1 = Angle of inclination

Vertical Shading/ Projections (R₂)

$$R_2 = \frac{P}{W}$$

θ_2 = Angle of inclination

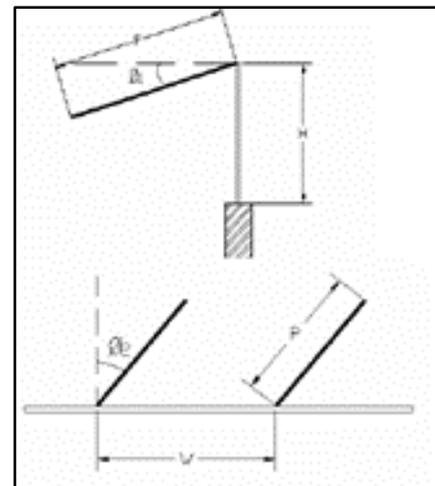

1-3(c) Up to 5 credits can be scored for external west facing wall that are designed with better thermal transmittance that is U-value of wall equal or less than 2W/m²K.

Credits scored = $0.04 \times (\% \text{ of the external west facing walls areas with U-value of } 2 \text{ W/m}^2\text{K or less over the total west facing façade areas})$

	<p>1-3(d) Up to 5 credits can be scored for roof design with better thermal transmittance that is U-value of roof than the baseline standard.</p> <p>Credits scored = 2 credits for every 0.1 W/m²K reduction from the baseline.</p>																																		
<p>Prerequisite Requirements</p>	<p>Ventilation simulation and its recommendation must be carried out using the prescribed methodology stated in Ventilation Simulation Methodology and Requirements to be eligible for GreenRE Platinum rating.</p>																																		
<p>Documentary Evidences</p>	<p><u>For 1-3(a)</u></p> <ul style="list-style-type: none"> Architectural plan layouts and elevation drawings of all façade. Highlight those areas that are considered as west facing façade. Calculation showing the percentage of west facing façade areas in the prescribed tabulated format as shown in Table 1-3(a). <p style="text-align: center;">Table 1-3(a) Minimum direct west facing external façade</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th></th> <th style="text-align: center;">Area of west facing external façade (m²) (a)</th> <th style="text-align: center;">Total area of external façade (b)</th> <th style="text-align: center;">% of west facing external facade</th> </tr> </thead> <tbody> <tr> <td>Block 1</td> <td></td> <td></td> <td rowspan="4" style="text-align: center;">$\sum (a) / \sum (b) \times 100$</td> </tr> <tr> <td>Block 2</td> <td></td> <td></td> </tr> <tr> <td>Block 3</td> <td></td> <td></td> </tr> <tr> <td>Total</td> <td></td> <td></td> </tr> </tbody> </table> <p style="text-align: center;">Credits scored for 1-3(a) = $10 - [0.2 \times (\sum (a) / \sum (b) \times 100)]$</p> <p><u>For 1-3(b)(i) and (ii)</u></p> <ul style="list-style-type: none"> Architectural plan layouts and elevation drawing of west facing façade and highlight the window openings. Sectional drawing showing the details of the sun shading devices. Highlight those sun shading devices that meet the 30% shading requirement. Window schedules. Calculation showing the percentage of west facing window areas in the prescribed tabulated format. <p style="text-align: center;">Table 1-3(b)(i) : Minimum west facing windows openings</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Description</th> <th style="text-align: center;">Area of west facing window area (m²) (a)</th> <th style="text-align: center;">Total area of west facing external façade (m²) (b)</th> <th style="text-align: center;">% of west facing window areas over total west facing external façade areas</th> </tr> </thead> <tbody> <tr> <td>Block 1</td> <td></td> <td></td> <td rowspan="4" style="text-align: center;">$\sum (a) / \sum (b) \times 100$</td> </tr> <tr> <td>Block 2</td> <td></td> <td></td> </tr> <tr> <td>Block 3</td> <td></td> <td></td> </tr> <tr> <td>Total</td> <td></td> <td></td> </tr> </tbody> </table> <p style="text-align: center;">Credits scored for 1-3(a) = $10 - [0.1 \times (\sum (a) / \sum (b) \times 100)]$</p>		Area of west facing external façade (m ²) (a)	Total area of external façade (b)	% of west facing external facade	Block 1			$\sum (a) / \sum (b) \times 100$	Block 2			Block 3			Total			Description	Area of west facing window area (m ²) (a)	Total area of west facing external façade (m ²) (b)	% of west facing window areas over total west facing external façade areas	Block 1			$\sum (a) / \sum (b) \times 100$	Block 2			Block 3			Total		
	Area of west facing external façade (m ²) (a)	Total area of external façade (b)	% of west facing external facade																																
Block 1			$\sum (a) / \sum (b) \times 100$																																
Block 2																																			
Block 3																																			
Total																																			
Description	Area of west facing window area (m ²) (a)	Total area of west facing external façade (m ²) (b)	% of west facing window areas over total west facing external façade areas																																
Block 1			$\sum (a) / \sum (b) \times 100$																																
Block 2																																			
Block 3																																			
Total																																			

Table 1-3(b)(ii) : Effective sun shading provisions for west facing window with minimum 30% shading

Description	Area of west facing window with effective sun shading provision(m ²) (a)	Total area of west facing external façade (m ²) (b)	% of west facing window areas over total west facing external façade areas
Block 1			$\frac{\sum (a)}{\sum (b)} \times 100$
Block 2			
Block 3			
Total			

Credits scored for 1-3(a) = $0.1 \times [(\frac{\sum (a)}{\sum (b)}) \times 100]$

- Calculation showing the percentage of west facing window with the provision of sun shading devices meet at least of 30%.

For 1-3(c)

- Architectural drawings highlighting the material types and walls.
- Detailed sectional drawings showing the wall composition and the respective U-values calculation.
- Extracts of the tender specification which states the thermal transmittance (K-value) properties to be adopted for west facing walls.
- Technical product information of the insulation materials (if applicable).
- Calculation showing the percentage of west facing window areas in the prescribed tabulated format as shown in Table 1-3(c).

Table 1-3(c) : Better thermal transmittance of external west facing walls

Description	Area of external west facing walls with U-value of 2W/m ² K or less (m ²) (a)	Total area of west facing external façade (m ²) (b)	% of external west facing wall areas with prescribed U values over total west facing external façade areas
Block 1			$\frac{\sum (a)}{\sum (b)} \times 100$
Block 2			
Block 3			
Total			

Credits scored = $0.04 \times [(\frac{\sum (a)}{\sum (b)}) \times 100]$

For 1-3(d)

- Roof layout and sectional details of the development.
- Extracts of the tender specification which states the thermal transmittance properties of roof.
- Detailed sectional drawings showing the roof composition and the respective U-values and calculation showing the average reduction.
- Technical product information of the insulation materials (if applicable).


Table 1-3(d): Better thermal transmittance of roof

		Roof Type	Weight Group	Weight range (kg/m ²)	Maximum Thermal Transmittance (w/m ² K)	Designed U-value (W/m ² K)	Reduction (W/m ² K)
		Roof 1	Light	Under 50	0.4		
		Roof 2	Heavy	Above 50	0.6		
References	-						

NRB 1-4 NATURAL VENTILATION / MECHANICAL VENTILATION


Objectives	Encourage building that facilitates good natural ventilation. Encourage energy efficient mechanical ventilation system as the preferred ventilation mode to air-conditioning in buildings.						
Applicability	Applicable to Non Air-Conditioned Building Areas (with an aggregate non air-conditioned areas > 10% of total floor area excluding carparks and common areas) for Natural Ventilation.						
Baseline Standard	<p>Fan power limitation in mechanical ventilation systems:</p> <table border="1" data-bbox="550 600 1236 719"> <thead> <tr> <th colspan="2" data-bbox="550 600 1236 638">Allowable nameplate motor power</th> </tr> <tr> <th data-bbox="550 638 895 676">Constant volume</th> <th data-bbox="895 638 1236 676">Variable volume</th> </tr> </thead> <tbody> <tr> <td data-bbox="550 676 895 719">1.7 kW/m³/s</td> <td data-bbox="895 676 1236 719">2.4 kW/m³/s</td> </tr> </tbody> </table>	Allowable nameplate motor power		Constant volume	Variable volume	1.7 kW/m ³ /s	2.4 kW/m ³ /s
Allowable nameplate motor power							
Constant volume	Variable volume						
1.7 kW/m ³ /s	2.4 kW/m ³ /s						
Requirements	<p><u>1-4(a) Natural Ventilation</u></p> <p>Up to 10 credits can be scored for building design that utilises prevailing wind conditions to achieve adequate cross ventilation.</p> <p>1 credit for every (10% of units/ rooms with window openings facing north and south directions)</p> <p style="text-align: center;">Credits scored = 1 x (% of units / 10)</p> <p>Note: In Malaysia, the prevailing wind comes from two predominant directions; that is the north to north-east during the Northeast monsoon season and south to south-east during the South-west monsoon season. Hence, buildings designed with window openings facing the north and south directions have the advantages of the prevailing wind conditions which would enhance indoor thermal comfort. Meteorological data on the more precise wind direction and velocity of the site location can also be used as the basis for the design.</p> <p>It is not necessary for the window openings to be located perpendicularly to the prevailing wind direction. Only window adjoining the habitable space to be considered. Window adjoining toilets/ bathroom and store room will not be considered.</p> <p>An oblique angle is considered acceptable (see illustrations as shown in the next page).</p>						

Illustration 1-3.1: Orientation of facade facing North and South

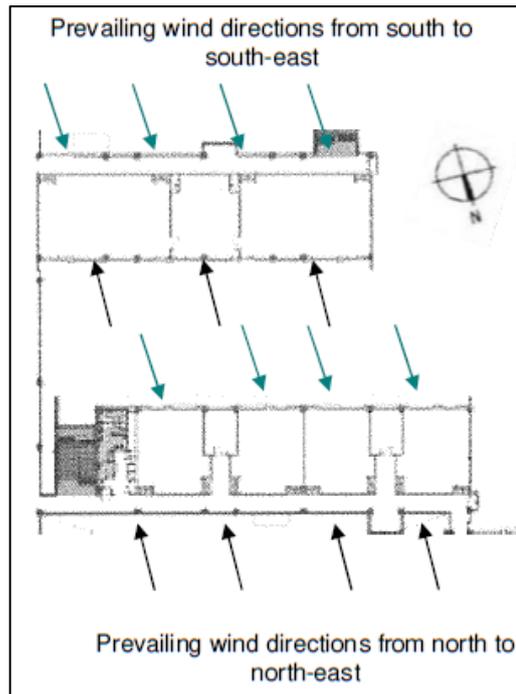

Building layout shows all rooms with window openings facing the North and South directions.

Illustration 1-3.2: Orientation of facade facing North and South

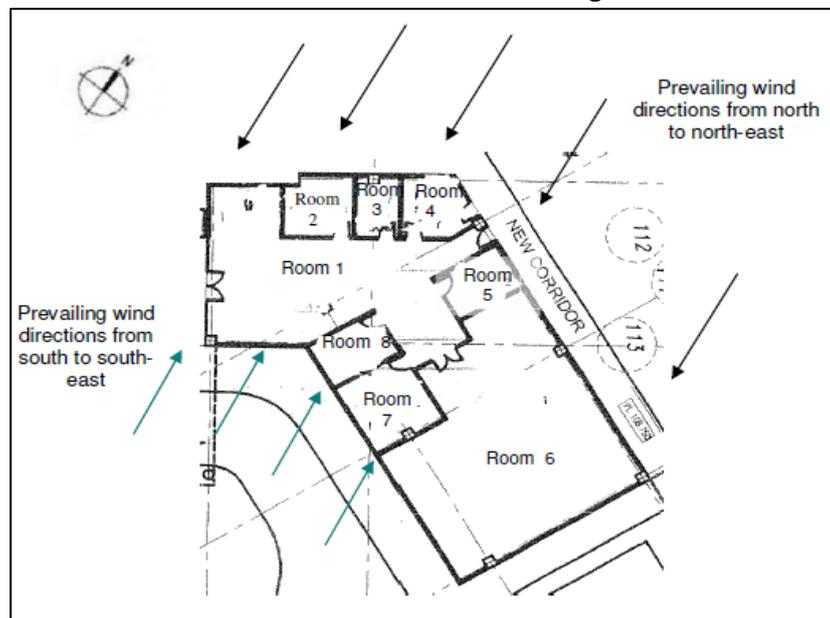

Building layout shows not all rooms with window facing the north and south directions. Room 2 to Room 5 would only have prevailing wind in one direction. Only Room 1 and 6 can be considered meeting requirement 1-3(a).

Alternative compliance: The application of ventilation simulation can be used to prove that the building layout utilises prevailing wind conditions and could

achieve adequate cross ventilation within the indoor units through sufficient window openings. The ventilation simulation should be carried in the same conditions outlined in paragraph 1-4(a) below. Credits should only be scored if the recommendations from the simulation are implemented.

1-4(a) 5 credits for the use of ventilation simulation software to identify the most effective building design and layout in achieving good natural ventilation.

The design should provide an average wind velocity within the space of at least 0.6 m/s or more. And additional 5 credits be scored if the recommendations from the ventilation simulation are implemented. The ventilation simulation shall be carried out in accordance with the methodology stated in Appendix B.

Note: Assistance from the ceiling fan is allowable to improve the thermal comfort of a space whereby ventilation simulation shall prove that unassisted ventilation (NV) complies with the minimum requirement of 0.14 m/s wind velocity.

1-4(b) Mechanical Ventilation

Up to 15 credits for the use of mechanical system in order to promote adequate ventilation between indoor and outdoor air.

0.6 credits for every subsequent 1% improvement in the baseline.

Documentary Evidences

1-4(a)(i) Building layout with the cross ventilation

- Architectural plan layouts showing the units / rooms of all blocks with highlights of those with north and south window openings.
- Calculation showing the percentage of units or rooms with window openings facing north and south directions in the prescribed formats as shown in Table 1-4(a).

Table 1-4(a) – Percentage of units with window opening in N-S direction

Ref	Description	Units/Rooms with window opening in the N-S direction (a)	Total no. of naturally ventilated units/room (b)	% of units/rooms with window opening in N-S direction
1	Classroom Block A & A1			$\sum (a) / \sum(b) \times 100$
2	Classroom Block B			
3	Offices, meeting rooms and computer rooms with air-conditioning			
Total:				

	<p style="text-align: center;">Credits scored = 1.0 x (% of units / 10) = 1.0 x [(\sum (a) / \sum(b) x 100) / 10]</p> <p><u>1-4(a)(ii) Ventilation simulation modelling</u></p> <ul style="list-style-type: none"> • Ventilation simulation modelling result and analysis or wind tunnel testing to identify the most effective building design and layout which achieve average wind velocity at least 0.6m/s or more. • A summary of the recommendation from the ventilation simulation report. • Architectural plan layout highlights the implementation base on the recommendation from the report. <p><u>1-4(b) Mechanical Ventilation</u></p> <ul style="list-style-type: none"> • Plan layout demarcate the area with mechanical ventilation system. • The overall design and drawings for mechanical ventilation system to make up the required outdoor air quantity into the building at desire fan power limit. • Detailed calculations showing the fan power improvement. • Product catalogue of the fan power used.
References	SS CP 13 – Code of Practice for Mechanical Ventilation and Air-Conditioning Buildings

NRB 1-5 DAYLIGHTING

Objectives	Encourage design that optimises the use of effective day lighting to reduce energy use for artificial lighting.								
Applicability	<p>1-5(a) Applicable to all normally occupied areas within the development.</p> <p>1-5(b) Applicable to all common areas within the development.</p>								
Baseline Standard	1-5(a) The minimum illuminance level for day lighting shall be in accordance with MS1525:2019.								
Requirements	<p>1-5(a) Up to 3 credits can be scored for the use of daylight simulation analysis or any relevant calculation documents to verify that 50% or more of all habitable spaces achieve adequate daylight illuminance levels as specified in Clause 5.4.1 in MS 1525:2019.</p> <p>The scoring will be based on percentage of habitable spaces with adequate ambient lighting level.</p> <p style="text-align: center;">Table 1-5.1: Credits allocation according to Habitable Spaces</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th style="text-align: center;">Percentage of Habitable Spaces with Adequate Ambient Lighting Level</th> <th style="text-align: center;">Credits Allocation</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">50% - 75%</td> <td style="text-align: center;">1</td> </tr> <tr> <td style="text-align: center;">76% - 90%</td> <td style="text-align: center;">2</td> </tr> <tr> <td style="text-align: center;">>90%</td> <td style="text-align: center;">3</td> </tr> </tbody> </table> <p>1-5(b) (i) 1 credit for provision of day lighting for lift lobbies and corridors.</p> <p>1-5(b) (ii) 1 credit for provision of day lighting for staircases.</p> <p>1-5(b) (iii) 1 credit for provision of day lighting for car parks.</p> <p>Note :</p> <ul style="list-style-type: none"> (a) Simulation or suitable daylight calculation is necessary for occupied space and common area to achieve the minimum daylight factors required. (b) For common areas, artificial lighting circuit schematics are necessary as documentary to proof design that allows controllability to maximise harvested daylight. 	Percentage of Habitable Spaces with Adequate Ambient Lighting Level	Credits Allocation	50% - 75%	1	76% - 90%	2	>90%	3
Percentage of Habitable Spaces with Adequate Ambient Lighting Level	Credits Allocation								
50% - 75%	1								
76% - 90%	2								
>90%	3								

<p>Documentary Evidences</p>	<p><u>For 1-5(a)</u></p> <ul style="list-style-type: none"> • Schedules showing the total floor area of the habitable spaces in the development. • Daylight simulation / calculation report summarizing the analysis and modelling results for each habitable space area that meets the requirement. • Architectural plan layout showing glazing/window area for each habitable space. <p><u>For 1-5(b)</u></p> <ul style="list-style-type: none"> • Architectural plan layout showing the window/ glazing at the lift lobby, corridors, staircases, and car parks (where applicable). • Calculation showing the 80% of each common area with the daylight provision. 																				
<p>References</p>	<p>MS 1525:2019 –Energy Efficiency and Use of Renewable Energy for Non-Residential Building - Code of Practice</p>																				
<p>Worked Example 1-5(a)</p>	<p>Tabulate occupied spaces and daylight factor achieved for all areas.</p> <p>Calculate % of occupied areas achieving daylight factor between 1-3.5%</p> <p>e.g.: % occupied areas with DF 1-3.5% = 60%</p> <p>Credits scored for 1-5(a) = 1 credits</p>																				
<p>Worked Example 1-5(b)</p>	<p>Proposed non-residential development with the following provision:</p> <p>All lift lobbies (including private lift lobbies), corridors and staircases are designed to have adequate day lighting that would eliminate the need for artificial lighting during daytime. 75% of the car park areas have day lighting provision while the other 25% of the car park areas need to employ the use of artificial lighting to maintain proper lighting level.</p> <p style="text-align: center;">Table 1-5.3: Credits Allocation</p> <table border="1" data-bbox="373 1458 1410 1641"> <thead> <tr> <th>No.</th> <th>Criteria</th> <th>Credit Allocated</th> <th>Credit</th> </tr> </thead> <tbody> <tr> <td>1-5(b) (i)</td> <td>Lift lobbies and corridors</td> <td>1</td> <td>1</td> </tr> <tr> <td>1-5(b) (ii)</td> <td>Staircases</td> <td>1</td> <td>1</td> </tr> <tr> <td>1-5(b) (iii)</td> <td>Day lighting for carparks.</td> <td>1</td> <td>0.75</td> </tr> <tr> <td></td> <td></td> <td style="text-align: center;">TOTAL</td> <td style="text-align: center;">2.75</td> </tr> </tbody> </table> <p>As carpark achieves adequate daylighting in only 75% of applicable areas (<80%) – scoring will be prorated to 0.75.</p> <p>Therefore, credits scored for 1-5(b) = 2.75 credits</p>	No.	Criteria	Credit Allocated	Credit	1-5(b) (i)	Lift lobbies and corridors	1	1	1-5(b) (ii)	Staircases	1	1	1-5(b) (iii)	Day lighting for carparks.	1	0.75			TOTAL	2.75
No.	Criteria	Credit Allocated	Credit																		
1-5(b) (i)	Lift lobbies and corridors	1	1																		
1-5(b) (ii)	Staircases	1	1																		
1-5(b) (iii)	Day lighting for carparks.	1	0.75																		
		TOTAL	2.75																		

NRB 1-6 ARTIFICIAL LIGHTING

Objectives	Encourage the use of better efficient lighting to minimise energy consumption from lighting usage while maintaining proper lighting level.										
Applicability	Applicable to lighting provisions that designed in accordance to the luminance level as recommended in MS 1525: 2019.										
Baseline Standard	Luminance level stated in MS 1525:2019 –Energy Efficiency and Use of Renewable Energy for Non-Residential Building - Code of Practice.										
Requirements	<p>Up to 12 credits if tenants’ light is provided OR Up to 5 credits if tenants’ light is excluded for the improvement in the lighting power consumption.</p> <p>0.25 credit for every percentage improvement in the lighting provisions over the baseline standard. That is</p> <p>Credits scored = 0.25 x (% improvement)</p> <p>Display lighting and specialised lighting are to be included in the calculation of lighting power budget.</p> <p>The design service illuminance, lamp efficiencies and the light output ratios of luminaries shall be in accordance with in MS 1525:2019 –Energy Efficiency and Use of Renewable Energy for Non-Residential Building - Code of Practice.</p> <p>For retail applications, the following lighting power budget baselines shall apply:</p> <table border="1" data-bbox="453 1245 1334 1491"> <thead> <tr> <th>Retail type</th> <th>Baseline</th> </tr> </thead> <tbody> <tr> <td>General</td> <td>≤ 15.0 W/m²</td> </tr> <tr> <td>Jewellery</td> <td>≤ 35.0 W/m²</td> </tr> <tr> <td>Furniture, clothing & accessories, cosmetic & art</td> <td>≤ 25.0 W/m²</td> </tr> <tr> <td>Supermarket, vehicle, sporting goods, stationary, & hardware</td> <td>≤ 20.0 W/m²</td> </tr> </tbody> </table> <p>Note :</p> <ol style="list-style-type: none"> a) Lux level simulation is required to show compliance as MS1525:2019 b) The lighting circuit also should comply to the following: <ul style="list-style-type: none"> • To install at least 1 light switch with labels for switched zone ≤ 30m². Zones ≥ 30m² to be matched accordingly. • Light switches are to be placed near doorways and easily accessed; AND • Separate switches for lights parallel to natural lighting. 	Retail type	Baseline	General	≤ 15.0 W/m ²	Jewellery	≤ 35.0 W/m ²	Furniture, clothing & accessories, cosmetic & art	≤ 25.0 W/m ²	Supermarket, vehicle, sporting goods, stationary, & hardware	≤ 20.0 W/m ²
Retail type	Baseline										
General	≤ 15.0 W/m ²										
Jewellery	≤ 35.0 W/m ²										
Furniture, clothing & accessories, cosmetic & art	≤ 25.0 W/m ²										
Supermarket, vehicle, sporting goods, stationary, & hardware	≤ 20.0 W/m ²										

Documentary Evidences	<ul style="list-style-type: none"> • Lighting layout plan. • Lighting schedules showing the numbers, locations and types of luminaires used and switching circuit not cover > 30 sqm . • Calculation of the proposed lighting power budget and the percentage of improvement in the prescribed tabulated format shown in Table 1-6-1 and 2. • Extract tender specification of lighting fittings used. • Technical product information of the lighting luminaires used. • Lux simulation result for all the spaces showing compliance with illuminance level in table 10, MS1525:2019.
------------------------------	--

References	MS 1525:2019 –Energy Efficiency and Use of Renewable Energy for Non-Residential Building - Code of Practice
-------------------	---

Worked Example 1-6	<p>a) Determine the total power consumption based on the lighting layout design for each area and light fitting types used.</p> <p>b) Calculate the total power consumption based on the maximum lighting power budget stated in MS 1525:2019.</p> <p>c) Calculate the percentage improvement in the total power consumption.</p>
---------------------------	---

Table 1-6-1 : Total power consumption based on each fitting type						
Description	Area (m ²)	Light Fitting Type	Power Consumption per fitting (W)	Ballast Loss (W)	No. of Fittings	Total power consumption based on fitting type
	(A)	(B)	(C)	(D)	(E)	[(C)+(D)] x E
Office Space 1	1500	T5	2x28	3	245	14455
Office Space 2	1250	T5	2x28	3	210	12390
Meeting Room	75	T8	1x36	3	15	585
		Surface downlight	2x36	0	8	416
Corridors 1	150	T5	2x28	3	15	885
Corridors 2	205	T5	2x28	3	15	885
		Surface downlight	1x70	0	9	630
Atrium	850	T8	2x36	3	87	6525
		Surface downlight	1x150	0	10	1500
Carparks	7500	T5	2x28	3	436	25724
Staircase	300	T5	2x28	3	20	1180
Total:						65175

Table 1-6-2 : Total power consumption based on design and MS 1525:2019

Description	Area (m ²)	Design Data		MS 1525:2019 Requirements	
		Total Power Consumption (by area)(W)	Design Lighting Power Budget (W/m ²)	Reference Lighting Power Budget (W/m ²)	Reference Total Power Consumption (by area)(W)
	(A)	(F)	(F/A)	(H)	(H x A)
Office Space 1	1500	14455	9.64	12	18000
Office Space 2	1250	12390	9.91	12	15000
Meeting Room	75	1001	13.35	12	900
Corridors 1	150	885	5.90	5	750
Corridors 2	205	1515	7.39	5	1025
Atrium	850	8025	9.44	5	4250
Carparks	7500	25724	3.43	5	37500
Staircase	300	1180	3.93	5	1500
Total:		65175			78,925

% improvement in the lighting power consumption

$$= [\Sigma (H \times A) - \Sigma(F)] / \Sigma (H \times A) \times 100\%$$

$$=(78925-65175)/78925 \times 100\%$$

$$=17.42\%$$

$$\text{Credits scored} = 0.25 \times 17.42\% = 4.35 \text{ credits}$$

Therefore, credits scored should be 4.35 credits if tenant's lighting is included: and credits scored should be 5 credits (max) if tenant's light is excluded.

NRB 1-7 VENTILATION IN CARPARKS

Objectives	Encourage the use energy efficient design and control of ventilation systems on carparks.
Applicability	Applicable to all carparks spaces in the development.
Baseline Standard	-
Requirements	<p>1-7(a) 4 credits can be scored if the carparks spaces that are fully naturally ventilated</p> <p>1-7(b) For carparks that have to be mechanically ventilated, credits can be s scored for the use of carbon monoxide (CO) sensors in regulating such demand based on the mode of mechanical ventilation (MV) used; 2.5 credits for carparks using fume extract system and 2 credits for those with MV with or without supply.</p> <p>Note: Where there is a combination of different ventilation mode adopted for carparks design, the credits scored under this requirement will be prorated accordingly.</p>
Documentary Evidences	<p><u>For 1-7 (a)</u></p> <ul style="list-style-type: none"> • Plan layouts showing all car park provision for the development with highlights of the car park spaces that are designed to be naturally ventilated. • Calculation showing the openings at the carpark level to meet the UBBL requirement. <p><u>For 1-7(b)</u></p> <ul style="list-style-type: none"> • Plan layouts showing all car park provision for the development with highlights of the car park spaces that are designed to be mechanical ventilated. • Plan layout indicating the location of CO sensors and the mode of ventilation adopted for the design. • Calculation showing the credits allocation if there is a combination of different ventilation mode adopted for the car park design. • Technical product information of CO sensors and mechanical ventilation.
References	MS 1525:2019 –Energy Efficiency and Use of Renewable Energy for Non-Residential Building - Code of Practice

<p>Worked Example 1-7</p>	<p>Proposed development has a 6-storey naturally ventilated carparks and one level of mechanically ventilated basement carparks with CO sensor to be installed to regulate MV.</p> <p>Areas of naturally ventilated carparks = 6 x 600 = 3600 m² Areas of basement carparks = 600 m² Total areas = 4200 m² Credits scored for 1-7 = (3600/4200) x 4 + (600/4200) x 2 = 3.71 credits</p>
----------------------------------	--

NRB 1-8 VENTILATION IN COMMON AREAS

Objectives	Encourage the use of energy efficient design and control of ventilation systems in common areas.
Applicability	Applicable to the following common areas of the development. <ul style="list-style-type: none"> • Toilets • Staircases • Corridors • Lift Lobbies • Atriums
Baseline Standard	-
Requirements	Up to 5 credits can be scored for the use of natural ventilation as an effective passive cooling design strategy to reduce the energy used by air- conditioning systems in these common areas. Credits are scored based on the mode of ventilation provided in these applicable areas. Natural ventilation – 1.5 credits for each area Mechanical ventilation – 0.5 credit for each area
Documentary Evidences	<ul style="list-style-type: none"> • Plan layouts showing the applicable areas and the respective modes of ventilation with proper demarcation of the opening. • Schedules showing the numbers, locations of the applicable areas and the mode of ventilation used. • Technical product information of mechanical ventilation system. (if applicable) of ventilation used • Schematic drawing of the mechanical ventilation system. • Calculation showing the credits allocation if there is a combination of different ventilation modes adopted for the applicable areas.
References	MS 1525:2019 –Energy Efficiency and Use of Renewable Energy for Non-Residential Building - Code of Practice

Worked Example 1-8	<p>Proposed development has the following details:</p> <p>No. of toilet = 45; where 10 units are designed with air-conditioning.</p> <p>% of toilet units with natural ventilation = $(45-10)/45 = 77.8\%$ Hence, it is less than 90%; no credit for this item</p> <p>No. Of staircases = 100; all are mechanical ventilated – 0.5 credit No. Of lift lobbies = 22; all are naturally ventilated – 1.5 credits</p> <p>Credits scored for 1-8 = $0.5 + 1.5 = 2$ credits < 5 credits (max)</p>
---------------------------	---

NRB 1-9 LIFTS AND ESCALATORS

Objectives	Encourage the use of energy efficient lifts and escalators.
Applicability	Applicable to <u>ALL</u> lifts and/or escalators in the development.
Baseline Standard	-
Requirements	<p>1 credit can be scored for the use of lifts with energy efficient features such as AC variable voltage and variable frequency (VVVF) motor drive and sleep mode features or equivalent.</p> <p>1 credit can be scored for the use of escalators with motion sensors to regulate usage.</p>
Documentary Evidences	<ul style="list-style-type: none"> • Extracts of the tender specification indicating the types of lifts & escalators and related features used. • Plan layout showing the location of the lifts and escalators. • Schedules showing the total number of lifts & escalators and its power consumption. • Technical information of the lifts & escalators.
References	-
Worked Example 1-9	<p>Proposed development has the following provision:</p> <p>Two lift types: Type L1 with VVVF motor drive and sleep mode features Type L2 with VVVF motor drive and sleep mode features</p> <p>Two escalator types: Type E1 with VVVF motor drive and motion sensors Type E2 without VVVF motor drive and motion sensors</p> <p>1 credit for the use of lifts with VVVF motor drive; and</p> <p>1 credit for the use of lifts with sleep mode features</p> <p>No credits for escalators as not all escalators are designed with motion sensors</p> <p>Credits scored for 1-9 = 2 credits (out of 3 credits)</p>

NRB 1-10 ENERGY EFFICIENT PRACTICES & FEATURES

Objectives	Encourage the use of energy efficient practices and features which are innovative and have positive environmental impact in terms of energy saving.
Applicability	1-10(a) Applicable to all developments 1-10(b) Applicable to practices and features that are not listed in the requirements under Part 1 – Energy Efficiency.
Baseline Standard	-
Requirements	<p>1-10(a) 1 credit can be scored for the practice of using Energy Usage Index (EUI) as a building performance indicator to measure the building's unit area energy consumption for future monitoring and improvements.</p> <p>EUI is derived using the following equation:</p> $\text{EUI} = [(\text{TBEC} - \text{CPEC}) / (\text{GFA excluding carpark})] * \text{FVR}$ <p>Where:</p> <ul style="list-style-type: none"> c) TBEC = Total building energy consumption (kWh/year) d) CPEC = Car Park Energy Consumption in (kWh/year) e) GFA = Gross Floor Area (exclude car park area) (m²) f) FVR = Floor Vacancy Rate (NLA) (m²) <p>Note: (1) Design EUI is based on 100% occupancy rate for consistency. (2) All major active equipment to be included in the estimation of TBEC.</p> <p>1-10(b) Up to 1 credit can be scored for the provision of greenery system on east and west facade to reduce the heat gain through the building envelope. 1 credit for high impact where provision is more than 50% of applicable facade areas. 0.5 credit for low impact where provision is at 25% of the same.</p> <p>1-10 (c) Up to 1 credit for the Installation of sub meter on switchboard for each service system that is >100kVA of the Total Connected Load (TCL)</p> <ul style="list-style-type: none"> • Install separate sub-meters for lighting systems, chillers, sockets, AHU, lifts, and other services that use loads of ≥ 100 kVA (TCL). <p>1-10(c) Up to 9 credits can be scored for the use of the following approved energy efficient features depending on the potential energy saving.</p> <ul style="list-style-type: none"> • Thermal storage system • Heat recovery devices • Light shelves • Motion sensors for staircases half landing and toilets • Sun pipes for natural lighting • Ductless fans for cleaning system • Auto-condenser tube cleaning system • Photo sensors to maximize the use of daylighting

	Note: For features that are not listed NRB 1-10(c) above, the QP is required to submit the details showing the positive environmental impacts and potential energy savings of the proposed features to GreenRE assessment.
Documentary Evidences	<p><u>For 1-10(a)</u></p> <ul style="list-style-type: none"> • Calculation of the Energy Usage Index (EUI) using the pre-determined daily usage pattern. • Detail calculation including operation hours for the estimated energy load for each component in the building etc.: lighting, air conditioning system, pump, receptacle load. • Technical product information and related drawing on the energy efficient features. • List of the assumption for the EUI calculation. <p><u>For 1-10(b)</u></p> <ul style="list-style-type: none"> • Landscape plan layout showing the vertical greenery provision and building elevation. • Calculation showing the extent of the vertical greenery provision over the east and west façade areas. <p><u>For 1-10(c)</u></p> <ul style="list-style-type: none"> • Electrical schematic drawings which show the location of the sub-meter on the main switchboard and on the small switchboard for each service of ≥ 100 kVA (TCL). <p><u>For 1-10(d)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the provision of the proposed energy efficient features and the extent of implementation where applicable. • Technical product information and related drawing on the energy efficient features used. • Calculation of the percentage energy saving that could be reaped from the use of these features.
References	-

Worked Example 1-10

For 1-10(a):

(1) Determine the total annual building electricity consumption (TBEC) based on the estimated electricity consumption and usage pattern in term of operation hours of all the major energy consumption systems and equipment

(2) Computation of the EUI of the building

Background info:

Assume a proposed development with GFA excluding car park of 86000 m², operational hours per week is 55 hours at 100% occupancy rate. No data centre in the building.

Table 1-10.1 : Total Building Electricity Consumption per year

System/Equipment	Total Annual Building Electricity Consumption (kWh)/year
Lighting (air-conditioned space)	3094380
Lighting (non air-conditioned space)	236321
Exterior Lighting	405800
Air-conditioned Plant	7924425
Air System Fans	632293
Mechanical Ventilation Fans	207571
Lifts	792966
Escalators	45865
Receptacle Equipment *(16W/m ²)	3936517
Domestic Water Pump Systems	226088
Hot Water Systems	93789
Others	-
Total :	17596015

*For tenant receptacle load, the nominal values shown in the following table can be adopted.

Receptacle Loads	Nominal Values
General office areas	12 W/m ²
Large conference areas	11 W/m ²
Server/Computer rooms	540 W/m ²

Source: ASHRAE STD 90.1:1999

Total annual Building Electricity Consumption (TBEC) excluding the carpark consumption = 17596015 kWh/year

Therefore, the EUI of the building is as follows:

$$\begin{aligned} \text{EUI} &= (\text{TBEC}/\text{GFA}) \\ &= (17596015/86000) \\ &= 204.6 \text{ kWh/m}^2/\text{yr} \end{aligned}$$

Credit scored for 1-10(a) = 1 credit

For 1-10(b):

The same proposed development has incorporated vertical greenery systems on the east and west facade to reduce heat gain to the building.

Table 1-10.2 : Total vertical greenery on east and west facade

Areas of vertical greenery systems = 2000 m ²	Percentage = 2000/4800 = 42% < 50%
Total east and west facade areas = 4800 m ²	Therefore, credits scored for 1-10(b) = 0.5 credit

For 1-10(c):

The same proposed development has included the use of motion sensors for all staircases and toilets

(i) Toilets

Total light fittings to be controlled by motion sensors = 2 x 350 nos.

Power consumption by light fitting = 2 x 350 x 36 W = 25200 W

Assume 5 hours per day that the light fittings are off when it is not occupied.

Electricity saving = 25200 W x 5 hours = 126 kWh

Annual electricity saving = 126 x 365 = 45990 kWh

(ii) Staircases

Total light fittings to be controlled by motion sensors = 2 x 180 nos.

Power consumption by light fitting = 2 x 180 x 18 W = 6480 W

Assume 10 hours per day that the light fittings are off when it is not used

Electricity saving = 6480 W x 10 hours = 64.8 kWh

Annual electricity saving = 64.8 x 365 = 23652 kWh

Total annual electricity saving using motion sensors = 45990+23652
= 69642 kWh

% energy savings = 69642/17596015 = 0.396%

Credits scored for 1-10(c) = 3 credits for every 1% energy saving
= 3 x 0.396% = 1.19 credit

NRB 1-11 RENEWABLE ENERGY

Objectives	Encourage the use of renewable energy sources in buildings.
Applicability	Includes all renewable energy sources.
Baseline Standard	-
Requirements	<p>Up to 20 credits can be scored based on the percentage replacement of electricity by the renewable energy source:</p> <p>5 credits for every 1% replacement of electricity (based on total electricity consumption) by renewable energy.</p> <p style="text-align: center;">OR</p> <p>3 credits for every 1% replacement of electricity (exclude tenant’s usage) by renewable energy.</p> <p style="text-align: center;">OR</p> <p>3 credits for every 10% of roof area used for solar panels.</p> <p style="text-align: center;">OR</p> <p>1 credit for the provision of solar panel installation roof, for a building where solar panels are not installed. Appropriate roof pitch, static loads, mounting system, and roof access to be considered.</p>
Documentary Evidences	<ul style="list-style-type: none"> • Extract of the tender specification of the renewable energy system and the extent of implementation. Technical product information for the renewable energy system and the expected renewable energy generated. Calculation of the percentage replacement of electricity and the total annual electricity consumption of the development. • Architectural plan and elevations marking out areas allocated a renewable energy.
References	-

(II) Other Green Requirements

Part 2 – Water Efficiency

NRB 2-1 Water Efficient Fittings

NRB 2-2 Water Usage and Leak Detection

NRB 2-3 Irrigation System

NRB 2-4 Water Consumption of Cooling Tower

NRB 2-1 WATER EFFICIENT FITTINGS

Objectives	Reduce to use of potable water by using water efficient fittings covered under the Water Efficiency Products Labelling Scheme (WEPLS) or Water Efficiency Labelling Scheme (WELS).									
Applicability	<p>Applicable to all water fittings covered by the WEPLS as follows:</p> <ul style="list-style-type: none"> • Basin taps and mixers • Sink/taps and mixers • Dual Flush Low-Capacity Flushing Cisterns • Showerheads • Shower taps and mixers • Urinals and Flush Valves 									
Baseline Standard	As specified under Water Efficiency Products Labelling Scheme (WEPLS)									
Requirements	<p>Up to 8 credits can be scored based on the number and water efficiency rating of the fitting type used.</p> <table border="1" data-bbox="400 875 1396 1077"> <thead> <tr> <th colspan="3">Rating Based on Water Efficiency Products Labelling Scheme (WEPLS)</th> </tr> <tr> <th>Efficient *</th> <th>Highly Efficient **</th> <th>Most Efficient ***</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">4 credits</td> <td style="text-align: center;">6 credits</td> <td style="text-align: center;">8 credits</td> </tr> </tbody> </table> <p>Note:</p> <ul style="list-style-type: none"> • Calculation of water saving based on the water efficient fittings. (<i>refer GreenRE Water Calculator</i>) • Pre-requisite requirement to demonstrate the 10% reduction of portable water consumption. 	Rating Based on Water Efficiency Products Labelling Scheme (WEPLS)			Efficient *	Highly Efficient **	Most Efficient ***	4 credits	6 credits	8 credits
Rating Based on Water Efficiency Products Labelling Scheme (WEPLS)										
Efficient *	Highly Efficient **	Most Efficient ***								
4 credits	6 credits	8 credits								
Documentary Evidences	<ul style="list-style-type: none"> • Extracts of the tender specification showing all the water fitting provisions for the development. • Water fitting schedules showing the numbers, types and the approved rating of the proposed fittings in the prescribed tabulated format shown in the Table 2.1-1. • Schematic drawing of cold water and sanitary plumbing. • WEPLS product specification or certificate. In the event no product recognition from WEPLS, product catalogue and test report from local or international body that equivalent to the SIRIM standard of testing is required. • Calculation of percentage of water saving based on the water efficient fittings and show the pre-requisite requirement is comply 									
References	<p>For more information about WEPLS, refer to http://www.span.gov.my/index.php?option=com_content&view=article&id=580%3Aabout-us1&catid=175%3Awepls&Itemid=457&lang=en</p>									

Worked Example 2-1

Example of a water fitting schedule showing the numbers, types and the approve rating of the proposed fitting for a residential development (including common facilities such as clubhouse toilets).

Table 2-1.1: Computation of the percentage of water fittings

Ref.	Water Fitting Type	WEPLS rating			Not Rated	Total
		Efficient	Highly Efficient	Most Efficient		
1	Shower taps and mixers	0	45	0	0	45
2	Basin taps and mixers	0	0	55	0	55
3	Sink/bib taps and mixers	0	70	0	0	70
4	Flushing cisterns	0	0	50	0	50
5	Others - Urinals for club house	0	0	0	5	5
Total no. based on rating (A)		0	115	105	5	$\Sigma A = 225$
Weightage (B)		4	6	8	0	
Total (AxB)		0	690	840	0	$\Sigma(AxB) = 1530$

$$\begin{aligned} \text{Credits scored} &= \Sigma(A \times B) / \Sigma A \\ &= 1530 / 225 \\ &= 6.8 \text{ credits} \end{aligned}$$

Use the water template calculator to calculate the water saving calculation.

NRB 2-2 WATER USAGE AND LEAK DETECTION

Objectives	Promote the use of sub-meter and leak detection system for better control and monitoring of water usage
Applicability	Applicable to sub-metering provisions for major water uses of the building developments.
Baseline Standard	-
Requirements	<p>2-2(a) 1 credit can be scored if sub-meters are provided for <u>ALL</u> major water uses i.e. irrigation system, cooling towers and tenant’s usage where applicable.</p> <p>2-2(b) 1 credit can be scored if all sub-meters are linked to the Building Management System (BMS) for monitoring and leak detection. The BMS should have specific alert features that can be set and triggered to detect the possibility of water leakage during operation.</p>
Documentary Evidences	<p><u>For 2-2(a)</u></p> <ul style="list-style-type: none"> • Extracts from the tender specification stating the locations and provision of sub meters for all major water uses. • List of a submeter and its location. • Schematic drawings of cold water distribution system showing the location of the sub meters provided. <p><u>For 2-2(b)</u></p> <ul style="list-style-type: none"> • Extracts from the tender specification and schematic drawing showing the location of sub-metering and its linkage to the Building Management System (BMS). • List of input and output point of the Building Management System (BMS) with highlighted the submeter point. • Write up on the specific alert features that can be triggered and detect the water leakage during operation.
References	-

NRB 2-3 IRRIGATION SYSTEM AND LANDSCAPING

Objectives	Reduce potable water consumption by provision of suitable systems that utilise rainwater or recycled water for landscape irrigation.																																													
Applicability	Applicable to development with landscaping provision.																																													
Baseline Standard	-																																													
Requirements	<p>2-3(a) 1 credit can be scored for the use of non-potable water including rainwater for landscape irrigation.</p> <p>For rainwater harvesting tank provision, RWHT to be sized in accordance to Guideline for Rainwater Harvesting and Utilisation System (SPAH) and MSMA guidelines. The rainwater tanks are to be optimally sized to cater for outdoor water use only</p> <p>Summary calculation of % replacement of outdoor water requirements from rainwater harvesting to be provided as part of claim for this credit</p> <p>2-3(b) 1 credit can be scored if more than 50% of the landscape areas are served by water efficient irrigation system with features such as automatic sub-soil drip irrigation system with rain sensor control.</p> <p>2-3(c) 1 credit can be scored if at least 50% of the landscape areas consist of drought tolerant plants or plants that require minimal irrigation.</p>																																													
Worked Example 2-3 (a)	<p>Landscape Consumption</p> <table border="1"> <thead> <tr> <th>Location</th> <th>Landscape type</th> <th>Water Required (L/day)</th> <th>Quantity</th> <th>Total watering requirement (L/Day)</th> </tr> </thead> <tbody> <tr> <td rowspan="3">GF</td> <td>Tree</td> <td>24</td> <td>200 Nos</td> <td>4800</td> </tr> <tr> <td>Shrub</td> <td>6.3</td> <td>5660 m2</td> <td>35658</td> </tr> <tr> <td>Turf</td> <td>3.1</td> <td>1415 m2</td> <td>4386.5</td> </tr> <tr> <td colspan="4"></td> <td>44844.5</td> </tr> </tbody> </table> <p>Irrigation water requirement (Litre/Day) 44844.5</p> <p>Roof Catchment</p> <table border="1"> <thead> <tr> <th>Type</th> <th>m²</th> <th>Run-off coefficient</th> </tr> </thead> <tbody> <tr> <td>Pitched Tile</td> <td></td> <td>0.8</td> </tr> <tr> <td>Steel Roof</td> <td>1239</td> <td>0.9</td> </tr> <tr> <td>RC Roof</td> <td>1110</td> <td>0.5</td> </tr> <tr> <td>Block Pavement</td> <td></td> <td>0.7</td> </tr> <tr> <td>Gravel Roadway</td> <td></td> <td>0.3</td> </tr> </tbody> </table> <table border="1"> <tr> <td>Total Catchment Area (m²)</td> <td>2349</td> </tr> <tr> <td>Catchment Area x Run -off coefficient</td> <td>1670.1</td> </tr> </table>	Location	Landscape type	Water Required (L/day)	Quantity	Total watering requirement (L/Day)	GF	Tree	24	200 Nos	4800	Shrub	6.3	5660 m2	35658	Turf	3.1	1415 m2	4386.5					44844.5	Type	m ²	Run-off coefficient	Pitched Tile		0.8	Steel Roof	1239	0.9	RC Roof	1110	0.5	Block Pavement		0.7	Gravel Roadway		0.3	Total Catchment Area (m²)	2349	Catchment Area x Run -off coefficient	1670.1
Location	Landscape type	Water Required (L/day)	Quantity	Total watering requirement (L/Day)																																										
GF	Tree	24	200 Nos	4800																																										
	Shrub	6.3	5660 m2	35658																																										
	Turf	3.1	1415 m2	4386.5																																										
				44844.5																																										
Type	m ²	Run-off coefficient																																												
Pitched Tile		0.8																																												
Steel Roof	1239	0.9																																												
RC Roof	1110	0.5																																												
Block Pavement		0.7																																												
Gravel Roadway		0.3																																												
Total Catchment Area (m²)	2349																																													
Catchment Area x Run -off coefficient	1670.1																																													

	<table border="1"> <tr> <td>Type Of System</td> <td>First Flush System</td> </tr> <tr> <td>Equation</td> <td>Collectible Rainwater = Rainfall x Catchment Area x Run Off Coefficient - (Total Catchment Area x First Flush Diversion)</td> </tr> <tr> <td>First Flush Diversion (L/sqm)</td> <td>1</td> </tr> <tr> <td>Tank Size (L)</td> <td>160,000.00</td> </tr> <tr> <td>Total Annual Collected Rain Water (L)</td> <td>3,880,633.50</td> </tr> <tr> <td>Average Daily Collected Rain Water (L)</td> <td>10,631.87</td> </tr> <tr> <td>Irrigation Consumption (L/Day)</td> <td>44,844.50</td> </tr> <tr> <td>Percentage of Reduction (%)</td> <td>23.71</td> </tr> </table>	Type Of System	First Flush System	Equation	Collectible Rainwater = Rainfall x Catchment Area x Run Off Coefficient - (Total Catchment Area x First Flush Diversion)	First Flush Diversion (L/sqm)	1	Tank Size (L)	160,000.00	Total Annual Collected Rain Water (L)	3,880,633.50	Average Daily Collected Rain Water (L)	10,631.87	Irrigation Consumption (L/Day)	44,844.50	Percentage of Reduction (%)	23.71	
Type Of System	First Flush System																	
Equation	Collectible Rainwater = Rainfall x Catchment Area x Run Off Coefficient - (Total Catchment Area x First Flush Diversion)																	
First Flush Diversion (L/sqm)	1																	
Tank Size (L)	160,000.00																	
Total Annual Collected Rain Water (L)	3,880,633.50																	
Average Daily Collected Rain Water (L)	10,631.87																	
Irrigation Consumption (L/Day)	44,844.50																	
Percentage of Reduction (%)	23.71																	
Documentary Evidences	<p><u>For 2-3(a)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing how the non-potable water source is to be provided. • Relevant drawings showing the location and design of the non-potable water source; and • Calculation of the estimation of saving of potable water for irrigation by the non -potable water source <p><u>For 2-3(b)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the provision and details of water efficient irrigation system. • Relevant layout plans showing the overall landscape areas and the areas that would be served using the system; and • Calculation showing the percentage of the landscape areas that would be served using the system (at least 50%) • Product technical information of the irrigation system. <p><u>For 2-3(c)</u></p> <ul style="list-style-type: none"> • Relevant layout plans showing the overall landscape areas and the areas that use drought tolerant plants or plants that require minimal irrigation. • Calculation showing the percentage of the landscape areas that use drought tolerant plants or plants that require minimal irrigation (at least 50%). • Plant species showing the minimum water requirement. 																	
References	<ol style="list-style-type: none"> 1. Manual Saliran Mesra Alam Malaysia(MSMA) (2000), Ministry of Natural Resources and Environment 2. "Rainwater – Guideline for Installing A Rainwater Collection and Utilization System",KPKT (1999) 3. "Rainwater Harvesting – Guidebook Planning and Design" Department of Irrigation and Drainage, Ministry of Natural Resources and Environment. 4. The list of drought tolerant or resistant plant species may be obtained from the online website : http://florafaunaweb.nparks.gov.sg/ 																	

NRB 2-4 WATER CONSUMPTION OF COOLING TOWER

Objectives	Reduce potable water consumption for cooling purpose.
Applicability	Applicable to building development with water-cooled central chillers systems and water-cooled package units.
Baseline Standard	-
Requirements	<p>2-4(a) 1 credit can be scored for the use of cooling tower water treatment system which can achieve 6 or better cycles of concentration at acceptable water quality.</p> <p>2-4(b) 1 credit can be scored for the use of recycled water from approved sources to meet the water demand for cooling purpose.</p>
Documentary Evidences	<p><u>For 2-4(a)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirements to incorporate with the cooling tower designs to achieve six cycles of concentration. • Details showing how the cooling towers have been designed to achieve at least six cycles of concentration. • Relevant drawings showing the location of the cooling towers and other supporting systems that are required to achieve the designed concentration. <p><u>For 2-4(b)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing how the recycled water source is to be provided. • Details of the recycled water system. • Schematic system showing the recycling system.
References	-

(II) Other Green Requirements

Part 3 – Environmental Protection

NRB 3-1 Sustainable Construction

NRB 3-2 Sustainable Products

NRB 3-3 Greenery Provision

NRB 3-4 Environmental Management Practice

NRB 3-5 Green Transport

NRB 3-6 Stormwater Management

NRB 3-7 Refrigerants

NRB 3-1 SUSTAINABLE CONSTRUCTION

Objectives	Encourage the adoption of building designs, construction practices and materials that are environmentally friendly and sustainable.																								
Applicability	Generally applicable to all building developments.																								
Baseline Standard	-																								
Requirements	<p>3-1(a) Up to 5 credits can be scored with the use of sustainable and recycled materials</p> <p>Credits can be scored for use of Green Cements with approved industrial by-product such as Ground Granulated Blast Furnace Slag (GGBS), silica fume, and fly ash to replace Ordinary Portland Cement (OPC) based on percentage replacement of ordinary concrete by Green Concrete:</p> <p>Table 3-1.1 : Credits allocation according to replacement percentage</p> <table border="1"> <thead> <tr> <th>Replacement of OPC by approved industrial by-products (%)</th> <th>Credit Allocation</th> </tr> </thead> <tbody> <tr> <td>10</td> <td>1</td> </tr> <tr> <td>20</td> <td>2</td> </tr> <tr> <td>30</td> <td>3</td> </tr> <tr> <td>40</td> <td>4</td> </tr> <tr> <td>>50</td> <td>5</td> </tr> </tbody> </table> <p>3-1(b) Up to 5 credits are allocated to encourage more efficient concrete usage for building components based on the percentage reduction in the prescribed Concrete Usage Index (CUI) limit.</p> <p>Table 3-1.2 : Credits allocation for project CUI</p> <table border="1"> <thead> <tr> <th>Project CUI (m³/m²)</th> <th>Credits Allocation</th> </tr> </thead> <tbody> <tr> <td>≤ 0.70</td> <td>1</td> </tr> <tr> <td>≤ 0.60</td> <td>2</td> </tr> <tr> <td>≤0.50</td> <td>3</td> </tr> <tr> <td>≤0.40</td> <td>4</td> </tr> <tr> <td>≤0.35</td> <td>5</td> </tr> </tbody> </table> <p>Note: Concrete Usage Index (CUI) is an indicator of the amount of concrete used to construct the superstructure that includes both the structural and non-structural elements. CUI does not include the concrete used for external works and sub-structural works such as basements and foundations. CUI is defined as the volume of concrete in cubic metres needed to cast a square metre of constructed floor area. It is expressed as:</p> $\text{Concrete Usage Index} = \frac{\text{Concrete Volume (m}^3\text{)}}{\text{Constructed Floor Area (m}^2\text{)}}$	Replacement of OPC by approved industrial by-products (%)	Credit Allocation	10	1	20	2	30	3	40	4	>50	5	Project CUI (m ³ /m ²)	Credits Allocation	≤ 0.70	1	≤ 0.60	2	≤0.50	3	≤0.40	4	≤0.35	5
Replacement of OPC by approved industrial by-products (%)	Credit Allocation																								
10	1																								
20	2																								
30	3																								
40	4																								
>50	5																								
Project CUI (m ³ /m ²)	Credits Allocation																								
≤ 0.70	1																								
≤ 0.60	2																								
≤0.50	3																								
≤0.40	4																								
≤0.35	5																								
Documentary Evidences	<u>For 3-1(a)</u>																								

	<ul style="list-style-type: none"> • Extract of tender specification showing the requirements to use of Green Cement / Concrete. • Certificate of products showing the recycled content. • Calculation of estimated quantity of replacement by mass of Green Cement / Concrete. <p><u>For 3-1(b)</u></p> <ul style="list-style-type: none"> • Structural plan layout, elevation and sectional plans showing the type of wall system used, the dimensions and sizes of all the building and structural elements. • Bill of quantities showing the volume of concrete to be used. • Detail Concrete Usage Index (CUI) calculation showing the quantity of concrete for each floor level. 																														
<p>Worked Example 3-1(a)</p>	<p>Proposed development will used Grade 35, 40, 70 and 80 concrete.</p> <p>From the concrete design mix the percentage of replacement of OPC by the green cements as follow: Grade 35 = 15.52 % Grade 40 = 63% Grade 70 = 59 % Grade 80 = 58 %</p> <table border="1" data-bbox="375 990 1412 1348"> <thead> <tr> <th>No</th> <th>Concrete Grade</th> <th>Quantity (m³)</th> <th>Percentage of Green Cement (%)</th> <th>Green Cement Quantity in (m³)</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Grade 35</td> <td>27,381</td> <td>15.52</td> <td>4250</td> </tr> <tr> <td>2</td> <td>Grade 40</td> <td>448</td> <td>63</td> <td>282</td> </tr> <tr> <td>3</td> <td>Grade 70</td> <td>12,141</td> <td>59</td> <td>7163</td> </tr> <tr> <td>4</td> <td>Grade 80</td> <td>12,155</td> <td>58</td> <td>7,050</td> </tr> <tr> <td></td> <td>Total</td> <td>52,155</td> <td></td> <td>18,745</td> </tr> </tbody> </table> <p>Overall % Green Cement replacement = $18,745/52,155 = 35.96\%$ Therefore, credit scored for NRB 3-1(a)= <u>2 credits</u></p>	No	Concrete Grade	Quantity (m ³)	Percentage of Green Cement (%)	Green Cement Quantity in (m ³)	1	Grade 35	27,381	15.52	4250	2	Grade 40	448	63	282	3	Grade 70	12,141	59	7163	4	Grade 80	12,155	58	7,050		Total	52,155		18,745
No	Concrete Grade	Quantity (m ³)	Percentage of Green Cement (%)	Green Cement Quantity in (m ³)																											
1	Grade 35	27,381	15.52	4250																											
2	Grade 40	448	63	282																											
3	Grade 70	12,141	59	7163																											
4	Grade 80	12,155	58	7,050																											
	Total	52,155		18,745																											
<p>Worked Example 3-1(b)</p>	<p>Proposed development comprises a 15-storey residential block with a basement carpark and the following details:</p> <p style="text-align: center;">Table 3-1.3: Concrete usage and constructed floor areas</p> <table border="1" data-bbox="379 1617 1412 1926"> <thead> <tr> <th colspan="2">Concrete usage for the superstructure</th> <th colspan="2">Constructed floor areas</th> </tr> </thead> <tbody> <tr> <td>For 1st storey</td> <td>= 587 m³</td> <td>For 1st storey</td> <td>= 1000 m²</td> </tr> <tr> <td>For 2nd to 15th storey (including roof level)</td> <td>= 5400 m³</td> <td>For 2nd to 15th (including roof level)</td> <td>= 14000 m²</td> </tr> <tr> <td>Therefore, Total concrete usage</td> <td>= 5987 m³</td> <td>Therefore, Total constructed floor area</td> <td>= 15000m²</td> </tr> </tbody> </table> <p>Note: The concrete usage for foundation and two basements are not required to be included.</p>	Concrete usage for the superstructure		Constructed floor areas		For 1 st storey	= 587 m ³	For 1 st storey	= 1000 m ²	For 2 nd to 15 th storey (including roof level)	= 5400 m ³	For 2 nd to 15 th (including roof level)	= 14000 m ²	Therefore, Total concrete usage	= 5987 m ³	Therefore, Total constructed floor area	= 15000m ²														
Concrete usage for the superstructure		Constructed floor areas																													
For 1 st storey	= 587 m ³	For 1 st storey	= 1000 m ²																												
For 2 nd to 15 th storey (including roof level)	= 5400 m ³	For 2 nd to 15 th (including roof level)	= 14000 m ²																												
Therefore, Total concrete usage	= 5987 m ³	Therefore, Total constructed floor area	= 15000m ²																												

$$\text{Concrete Usage Index (CUI)} = \frac{5987}{15000} = 0.4 \text{ m}^3/\text{m}^2$$

Based on the calculation shown in Table 3-1.4

$$\text{CUI of } 0.4 \text{ m}^3/\text{m}^2 \leq 0.4 \text{ m}^3/\text{m}^2$$

Therefore, credits scored = 4 credits

Refer to the following Table 3-1.4 for more details

Table 3-1.4 – Concrete Usage Index

COMPUTATION OF CONCRETE USAGE INDEX		RESIDENTIAL BLDG		
Project Reference No.: <u>AXXXX-00001-2007</u>		Total no. of storey for the project: <u>15</u>		
Block No: <u>A</u>				
Structural System		Thickness (mm) or size (mm x mm)	Volume of concrete (m ³)	Remark *
1	1st storey			
	1.1 Columns	200x400, 200x200	72	Precast
	1.2 Beams	200x400, 200x500	145	Precast
	1.3 Slabs	150,200	265	Post-tensioned
	1.4 Staircases	150	30	Precast
	1.5 Suspended structures like planter boxes, bay windows, ledges etc	150	10	Precast
	1.6 Parapets	150	5	RC
	1.7 External walls – load bearing walls	Nil	0	-
	1.8 External walls – non-load bearing walls	125	15	RC
	1.9 Internal walls – load bearing walls	200	40	RC
	1.10 Internal walls – non-load bearing walls	Nil	0	Light weight concrete
	1.11 Others (kerbs, ramps, services risers, etc)	Not required	5	RC
Total volume of concrete for this storey (m ³)			587	
Total constructed floor area for this storey (m ²)			1000	
2	Typical floor layout			
	2.1 Columns	200x400, 200x200	55	Precast
	2.2 Beams	200x400, 200x500	45	Precast
	2.3 Slabs	150,200	160	Post-tensioned
	2.4 Staircases	150	30	Precast
	2.5 Suspended structures like planter boxes, bay windows, ledges etc	150	10	Precast
	2.6 Parapets	150	5	RC
	2.7 External walls – load bearing walls	Nil	0	-
	2.8 External walls – non-load bearing walls	125	15	RC

COMPUTATION OF CONCRETE USAGE INDEX		RESIDENTIAL BLDG		
Project Reference No.: <u>AXXXX-00001-2007</u>		Total no. of storey for the project: <u>15</u>		
Block No: <u>A</u>				
Structural System	Thickness (mm) or size (mm x mm)	Volume of concrete (m ³)	Remark *	
2	2 nd storey to 30 th storey (Typical floor layout)			
	2.9 Internal walls – load bearing walls	200	40	RC
	2.10 Internal walls – non-load bearing walls	Nil	0	-
	2.11 Others (kerbs, ramps, services risers etc)	Nil	0	-
Volume of concrete for one storey (m ³)			360	
Constructed floor area for one storey			933.3	
Total volume of concrete for 2 nd to 15 th storey			360x15=5400	
Total constructed floor area for 2 nd to 15 th storey (m ²) (including roof level)			933.3x15=14000	
Total volume of concrete for this project (m ³)			5987	
Total constructed floor area for this project (m ²)			15000	
Concrete Usage Index (CUI in m ³ /m ²)			0.4	

*To indicate if the structural elements is of precast concrete, post-tensioned concrete, high strength concrete(>Grade 60) or reinforced concrete (RC) under the 'Remarks' column

Notes: The quantities of the concrete for all the structural and non-structural elements for each floor level are computed. All the elements listed in the table such as columns, beams, slabs, suspended structures (like planter boxes, bay windows and ledges etc), parapets, walls and others (service risers, kerbs, ramps etc) are to be included. The concrete usages for foundation and basement works are excluded in CUI computation.

NRB 3-2 SUSTAINABLE PRODUCTS

Objectives	Encourage the use of products that are environmentally friendly and sustainable.								
Applicability	Applicable to non-structural and architectural building components.								
Baseline Standard	-								
Requirements	<p>3-2 (a) Up to 8 credits are allocated to encourage the use of environmentally friendly products that are certified by approved local/international certification body. The criterion is only applicable for non-structural building components and construction. Credits scored will be based on the extent of use of environmentally friendly product under following category:</p> <ul style="list-style-type: none"> • Eco Label products • Wood products certified by the Forest Stewardship council (FSC) or the Malaysia Certification Council (MTCC) • Agreement of the manufacturer or suppliers for the buyback programmes within the life cycle or at the end of materials life for recycling reuse purpose <p>The environmentally friendly product proposed must be approved by a valid international or local certification body and is subject to GreenRE’s evaluation.</p> <p style="text-align: center;">Table 3-2.1 : Weightage for credits allocation</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th style="text-align: center;">Extent of use of environmentally friendly product</th> <th style="text-align: center;">Weightage for Credits Allocation</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">Low impact</td> <td style="text-align: center;">0.5</td> </tr> <tr> <td style="text-align: center;">Medium impact</td> <td style="text-align: center;">1</td> </tr> <tr> <td style="text-align: center;">High Impact</td> <td style="text-align: center;">2</td> </tr> </tbody> </table> <p>The use of environmentally friendly products or recycled materials used for all main building elements or functional spaces of the development will be considered as <u>high impact</u> (2 credits) on condition that quantities used by percentage are more than 50% (i.e extent of coverage as compared to total quantities used for same intended purpose. If not met, it will be classified as <u>medium impact</u> (1 credit).</p> <p>Items that are used for all common areas, external works and communal facilities are considered as <u>medium impact</u> (1 credit) if quantities used by percentage are more than 80% (i.e extent of coverage as compared to total quantities used for same intended purpose in common areas If not met, it will be classified as <u>low impact</u> (0.5 credit)</p>	Extent of use of environmentally friendly product	Weightage for Credits Allocation	Low impact	0.5	Medium impact	1	High Impact	2
Extent of use of environmentally friendly product	Weightage for Credits Allocation								
Low impact	0.5								
Medium impact	1								
High Impact	2								

	<p>Notes:</p> <ol style="list-style-type: none"> (1) The impact categories listed above generally apply to main building elements – e.g internal / external wall, floor, ceiling, roof, doors, etc. Singular products – e.g termite treatment system, playground equipment, gym flooring etc will be classed as <u>low impact</u>. All applications will be subject to GreenRE's evaluation. (2) Same type of the product not allowed to be double claimed for different area of application (3) The credit allocated for low volatile organic compound (VOC) paints and adhesives certified by approved local certification body can be found in NRB 4-3 and hence shall not be included in the scoring for NRB 3-2. <p>3-2 (b) Up to 1 credit for reuse & Salvage or reuse construction materials for 2% of building materials based on the total material cost (extracted from the bill of quantities).</p> <p>3-2 (c) Recycled Content of the Steel and Glass</p> <p>Up to 1 credit for the utilisation and use of recycled content material so that the total of post-consumer recycled content plus half of the pre-consumer content constitutes at least 10% based on the total material cost .</p>
<p>Documentary Evidences</p>	<p><u>3-2 (a)</u></p> <ul style="list-style-type: none"> • Extracts from the tender specification and drawings showing the requirements to incorporate the environmentally friendly products that are certified and approved by local/international certification body. • Certification details from approved local/international certification body such as the material certification standards and rating within validity period. • Technical product information on the sustainable products. • Calculation of products and extent of coverage. <p><u>3-2 (b)</u></p> <ul style="list-style-type: none"> • A list of proposed salvaged materials. • A calculation of the value of reused materials against the estimated total value of the materials for the project. • <p><u>For 3-1(c)</u></p> <ul style="list-style-type: none"> • Calculation of the total percentage (based on cost) of materials with recycled content against the actual total value of the materials for the project. • The percentage of post-consumer and/or pre-consumer recycled content must be established based on cost. The calculation of the recycled content value of each material must be provided. • Product brochure of each installed recycled content material showing the percentage of post- and pre-consumer recycled content.

Reference	https://www.myhijau.my/directory/																																	
Worked Example 3-2	<p>Determine if the environmentally friendly products selected are certified with approved local/international certification body. Check if the products used are meant for main building elements or functional spaces and can be considered <u>high impact or medium impact</u>. Products that are meant for common areas and external works such as toilets, lobbies and landscaping areas are considered as <u>medium impact or low impact</u>.</p> <p>Note: Certain products can have more environmentally friendly features than others. Other than recycled materials, they may have features like low VOC assembly or manufactured with resource efficient processes, durability etc that will render the products more environmental friendly than others. If the certified products selected are more environmental friendly and are given a better rating by the approved local/international certification body, a higher weightage can be considered in credit scoring.</p> <p>Example of a proposed development with the following provisions:</p> <ul style="list-style-type: none"> (a) Use of carpets for all office spaces. Product is not certified. (b) Use of panel boards as internal partitions for more than 50% of the office spaces and the product is rated by an approved certification body. (c) Precast concrete road kerbs. Product is rated by approved local certification body. – (Singular product) (d) Use of roof waterproofing coating. Product is rated by approved local certification body. (e) Use of wooden doors for all areas. Product is rated by approved local certification body. <table border="1" data-bbox="387 1162 1382 1606"> <thead> <tr> <th colspan="2">Products and Extent of coverage</th> <th>With approved certification</th> <th>Extent of use category</th> <th>Credits scored</th> </tr> </thead> <tbody> <tr> <td>(a)</td> <td>Carpets for all office spaces</td> <td>No</td> <td>N/A</td> <td>0</td> </tr> <tr> <td>(b)</td> <td>Panel boards as internal partition for more than 50% of office spaces</td> <td>Yes</td> <td>2</td> <td>2</td> </tr> <tr> <td>(c)</td> <td>Precast road kerbs</td> <td>Yes</td> <td>0.5</td> <td>0.5</td> </tr> <tr> <td>(d)</td> <td>Roof waterproofing</td> <td>Yes</td> <td>1</td> <td>1</td> </tr> <tr> <td>(e)</td> <td>Wooden doors for all areas</td> <td>Yes</td> <td>2</td> <td>2</td> </tr> </tbody> </table> <p>Therefore, credits scored for 3-2 = 2 + 0.5 + 1 + 2 = 5.5 credits</p>				Products and Extent of coverage		With approved certification	Extent of use category	Credits scored	(a)	Carpets for all office spaces	No	N/A	0	(b)	Panel boards as internal partition for more than 50% of office spaces	Yes	2	2	(c)	Precast road kerbs	Yes	0.5	0.5	(d)	Roof waterproofing	Yes	1	1	(e)	Wooden doors for all areas	Yes	2	2
Products and Extent of coverage		With approved certification	Extent of use category	Credits scored																														
(a)	Carpets for all office spaces	No	N/A	0																														
(b)	Panel boards as internal partition for more than 50% of office spaces	Yes	2	2																														
(c)	Precast road kerbs	Yes	0.5	0.5																														
(d)	Roof waterproofing	Yes	1	1																														
(e)	Wooden doors for all areas	Yes	2	2																														

NRB 3-3 GREENERY PROVISION

Objectives	Encourage greater use of greenery and restoration of existing trees reduce heat island effect.															
Applicability	Applicable to building developments with landscaping areas.															
Baseline Standard	-															
Requirements	<p>3-3(a) Up to 6 credits can be scored for the provision of greenery within the developments including roof top/ sky garden and green roof.</p> <p>Green Plot Ratio (GnPR) is calculated by considering the 3D volume covered by plants using the following Leaf Area Index (LAI).</p> <p style="text-align: center;">Table 3-3.1: Leaf Area Index (LAI)</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Plant group</th> <th>Trees</th> <th>Palms</th> <th>Shrubs & Groundcover</th> <th>Turf</th> </tr> </thead> <tbody> <tr> <td>LAI</td> <td>Canopy: Open = 2.5 Intermediate = 3.0 Dense = 4.0</td> <td>Solitary = 2.5 Cluster = 4.0</td> <td>Monocot = 3.5 Dicot = 4.5</td> <td>Turf = 2.0</td> </tr> <tr> <td>Area</td> <td>All = 60 m²</td> <td>Solitary = 20m² Cluster = 17m²</td> <td>Planted area</td> <td>Planted area</td> </tr> </tbody> </table> <div style="text-align: center; margin-top: 20px;"> <p>TREES</p> <div style="display: flex; justify-content: space-around;"> <div style="text-align: center;">  <p>Samanea saman open canopy</p> </div> <div style="text-align: center;">  <p>Syzygium polyanthum intermediate canopy</p> </div> <div style="text-align: center;">  <p>Mimusops elengi dense canopy</p> </div> </div> <p>PALMS</p> <div style="display: flex; justify-content: space-around;"> <div style="text-align: center;">  <p>Archontophoenix alexandrae solitary</p> </div> <div style="text-align: center;">  <p>Ptychosperma macarthurii cluster</p> </div> </div> <div style="text-align: center; margin-top: 20px;"> <p>SHRUBS & GROUNDCOVER</p> <div style="display: flex; justify-content: space-around;"> <div style="text-align: center;">  <p>Cordyline fructicosa 'Firebrand' monocot</p> </div> <div style="text-align: center;">  <p>Ixora 'Super pink' dicot</p> </div> </div> <p>TURF</p> <div style="text-align: center;">  <p>Zoysia matrella</p> </div> </div> </div>	Plant group	Trees	Palms	Shrubs & Groundcover	Turf	LAI	Canopy: Open = 2.5 Intermediate = 3.0 Dense = 4.0	Solitary = 2.5 Cluster = 4.0	Monocot = 3.5 Dicot = 4.5	Turf = 2.0	Area	All = 60 m ²	Solitary = 20m ² Cluster = 17m ²	Planted area	Planted area
Plant group	Trees	Palms	Shrubs & Groundcover	Turf												
LAI	Canopy: Open = 2.5 Intermediate = 3.0 Dense = 4.0	Solitary = 2.5 Cluster = 4.0	Monocot = 3.5 Dicot = 4.5	Turf = 2.0												
Area	All = 60 m ²	Solitary = 20m ² Cluster = 17m ²	Planted area	Planted area												

Green Plot Ratio (GnPR) = Total Leaf Area / Site Area

Table 3-3.2 : Credits Allocation according to GnPR

GnPR	Credits Allocation
1.0 to < 2.0	1
2.0 to < 3.0	2
3.0 to < 4.0	3
4.0 to < 5.0	4
5.0 to < 6.0	5
≥ 6.0	6

Note :

- To include site inventory analysis on greenery pre-development and calculation of carbon sequestration of greenery post development.

3-3 (b) 1 credit for restoration of trees on-site, conservation or relocation of existing trees on site. (at least 20%)

3-3 (c) 1 credit for provision of compost bins to recycle organic waste to meet at least 30% of landscape fertilizer needs.

Documentary Evidences

For 3-3 (a)


- Plan layouts showing the site area as well as the greenery that is provided within the development (including a listing of the number of trees, palms, shrubs, turf and the respective sub category and LAI values).
- Calculation showing the extent of the greenery provision in the prescribed tabulated formats.
- The plant species sub categories and its LAI values obtained from the online website: <http://florafaunaweb.nparks.gov.sg/>.
- To submit the site inventory analysis on greenery pre-development and calculation of carbon sequestration of greenery post development

For 3-3 (b)

- Site layouts showing the existing and final locations (where applicable) and number of the trees to be restored or conserved or relocated.
- Documentary evidence showing the relocation or restoration activities.

For 3-3 (c)

- Extracts of the tender specification showing the requirements to provide compost bin
- Product specifications.
- Method statement with details steps of composting process (if applicable).
- The calculation of the 30% of fertilizer replacement with the composting
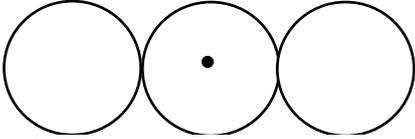
<p>Exceptions</p>	<p>TREES AND PALMS SPACING (CENTRE-TO-CENTRE)</p> <p>(a) If the selected trees and palms are to be planted at $\leq 2\text{m}$ from trunk-to-trunk as illustrated below, the leaf area shall be calculated as the product of LAI value and planted area (in m^2).</p> <p style="text-align: center;"> —2m— </p>  <p>COLUMNAR TREES</p> <p>(b) For trees that have tight, columnar crowns, the canopy area of 12m^2 is to be adopted for calculation of leaf area. These species include, but not limited to the following:</p> <ul style="list-style-type: none"> • Garciniacymosa forma pendula • Garciniasubelliptica • Polyalthialongifolia • Carallia brachiate • Gnetumgnemon 																																																																		
<p>References</p>	<p>The plant species, its sub categories and LAI values may be obtained from the online website: http://florafauanaweb.nparks.gov.sg</p>																																																																		
<p>Worked Example 3-3(a)</p>	<p>(1) Determine the number of trees, palms and the trees for shrubs and turfs and other greenery area.</p> <p>(2) The Leaf Area Index (LAI) of the individual plant species and its canopy area are predetermined design parameters applicable for all developments.</p> <p>(3) The plant species sub categories and its LAI values can be obtained from the online website: http://florafauanaweb.nparks.gov.sg/ (see example below) by searching the common / scientific names of the plants.</p> <p>(4) Compute the green areas as shown in the Table 3-3.3 below</p> <p style="text-align: center;">Table 3-3.3: Calculation of the Green Plot Ratio</p> <table border="1" data-bbox="373 1234 1412 1742"> <thead> <tr> <th rowspan="2">Category</th> <th rowspan="2">Sub category</th> <th>(A)</th> <th>(B)</th> <th>(C)</th> <th>(A)x(B)x(C)</th> </tr> <tr> <th>LAI value</th> <th>Canopy area</th> <th>Qty/Planted Area</th> <th>Leaf Area</th> </tr> </thead> <tbody> <tr> <td rowspan="3">Trees (no.)</td> <td>Open Canopy</td> <td>2.5</td> <td>60 m^2</td> <td>0 no.</td> <td>0</td> </tr> <tr> <td>Intermediate Canopy</td> <td>3.0</td> <td>60 m^2</td> <td>8 no.</td> <td>1440</td> </tr> <tr> <td>Dense Canopy</td> <td>4.0</td> <td>60 m^2</td> <td>12 no.</td> <td>2880</td> </tr> <tr> <td rowspan="2">Palms (no.)</td> <td>Solitary</td> <td>2.5</td> <td>20 m^2</td> <td>10 no.</td> <td>500</td> </tr> <tr> <td>Cluster</td> <td>4.0</td> <td>17 m^2</td> <td>10 no.</td> <td>680</td> </tr> <tr> <td rowspan="2">Shrubs (m^2)</td> <td>Monocot</td> <td>3.5</td> <td>NA</td> <td>0 m^2</td> <td>0</td> </tr> <tr> <td>Dicot</td> <td>4.5</td> <td>NA</td> <td>20 m^2</td> <td>90</td> </tr> <tr> <td>Turf(m^2)</td> <td>Turf</td> <td>2.0</td> <td>NA</td> <td>90 m^2</td> <td>180</td> </tr> <tr> <td>Vertical Greenery (m^2)</td> <td>-</td> <td>2.0</td> <td>NA</td> <td>10 m^2</td> <td>20</td> </tr> <tr> <td colspan="5" style="text-align: right;">Total Leaf Area:</td> <td>5790</td> </tr> </tbody> </table> <p>Note: Green roof landscaping would be calculated as per illustrated above Assume site area is 4000m^2 Green Plot Ratio (GnPR) = total leaf area / site area = $5790 / 4000 = 1.45$ Where GnPR = 1.0 to < 2.0</p> <p>Therefore, credits scored for 3-3(a) = 1 credit</p>	Category	Sub category	(A)	(B)	(C)	(A)x(B)x(C)	LAI value	Canopy area	Qty/Planted Area	Leaf Area	Trees (no.)	Open Canopy	2.5	60 m^2	0 no.	0	Intermediate Canopy	3.0	60 m^2	8 no.	1440	Dense Canopy	4.0	60 m^2	12 no.	2880	Palms (no.)	Solitary	2.5	20 m^2	10 no.	500	Cluster	4.0	17 m^2	10 no.	680	Shrubs (m^2)	Monocot	3.5	NA	0 m^2	0	Dicot	4.5	NA	20 m^2	90	Turf(m^2)	Turf	2.0	NA	90 m^2	180	Vertical Greenery (m^2)	-	2.0	NA	10 m^2	20	Total Leaf Area:					5790
Category	Sub category			(A)	(B)	(C)	(A)x(B)x(C)																																																												
		LAI value	Canopy area	Qty/Planted Area	Leaf Area																																																														
Trees (no.)	Open Canopy	2.5	60 m^2	0 no.	0																																																														
	Intermediate Canopy	3.0	60 m^2	8 no.	1440																																																														
	Dense Canopy	4.0	60 m^2	12 no.	2880																																																														
Palms (no.)	Solitary	2.5	20 m^2	10 no.	500																																																														
	Cluster	4.0	17 m^2	10 no.	680																																																														
Shrubs (m^2)	Monocot	3.5	NA	0 m^2	0																																																														
	Dicot	4.5	NA	20 m^2	90																																																														
Turf(m^2)	Turf	2.0	NA	90 m^2	180																																																														
Vertical Greenery (m^2)	-	2.0	NA	10 m^2	20																																																														
Total Leaf Area:					5790																																																														

NRB 3-4 ENVIRONMENTAL MANAGEMENT PRACTICE

Objectives	Encourage the adoption of environmental friendly practices during construction and building operation.
Applicability	Generally applicable to all building developments.
Baseline Standard	-
Requirements	<p>3-4(a) 1 credit can be scored if effective implementation of environmental friendly programmes including monitoring and setting targets to minimise energy use, water use and construction waste are in place during the construction stage.</p> <p>The minimum requirement of the Environmentally friendly programmes as follows;</p> <ul style="list-style-type: none"> • To record the electrical consumption during the construction stage and hence, minimise energy usage by on-site utilities. • Appointment of safety, health and environment officer • To prepare an Environmental Management Plan and conduct a complete Erosion Sedimentation Control Plan (ESCP) • To prepare a Construction Waste Management Plan • To include commitment to recycle and/or salvage 50% of the volume of non-hazardous construction debris • Provide at least the minimum level of sanitation/safety facilities for construction workers. • Use a low-flow flushing system and efficient fitting tap in the construction site office/ showroom • Provision of the Rainwater Harvesting System strategies of the rainwater usage • Develop and implement and IAQ Management plan for the Construction <p>3-4(b) 1 credit can be scored if main builder has good track records in completing internationally recognized accredited Green Buildings and adoption of sustainable, environmentally friendly, and considerate practices during construction</p> <p>3-4(c) 1 credit can be scored if the building quality is assessed and passed (Score < 70%) under the Quality Assessment System in Construction (QLASSIC) or Building Quality Assessment System (BuildQUAS).</p> <p>3-4(d) 1 credit can be scored for IBS content scoring ≥ 50% based on CIDB IBS scoring scheme. 1 credit can be scored for IBS content scoring ≥ 70% based on CIDB IBS scoring scheme.</p> <p>3-4(e) Up to 1 credit if the developer, main builder, M&E consultant, and architect are ISO 14000 certified. 0.25 credits are allocated for each firm that is certified.</p>

3-4(f) 1 credit if the project team comprises Certified GreenRE AP/Green Mark AP /MyCrest AP

3-4(g) 1 credit can be scored for the provision of building users' guide with details of the environmentally friendly facilities and features within the building and their uses in achieving the intended environment performance during building operation.

The minimum requirement of the Green Building User Guide as follows;

- Details of green building certification i.e rating tier, scorecard, certificate, validity etc.
- Summary of green building features (ideally with photographs and diagrams)
- Recommended practices for enhanced environmental performance of residence (refer to GreenRE green home user guide)
- Green fit out guidelines to detail recommended minimum environmental standards to assist building users' in making sustainable fit-out decisions.

3-4(h) 1 credit can be scored for provision of Sustainable Operation Management Guideline (SOMG) and at least one session of briefing to be conducted to the Building Management Team.

The minimum requirement of the Sustainable Operation Management Guideline as follow;

- Recommended performance standards to assist building users in making sustainable fit out decisions.
- Energy management and monitoring plan – common areas
- Water management and monitoring plan – common areas
- Waste management plan including details of recycling facilities – entire development
- Environmental policy and cleaning strategies / schedule – common areas
- Pandemic response plan (e.g increased cleaning requirements, closure of common facilities, signages etc)

3-4(i) 1 credit can be scored for the Provision of facilities or recycling bins for collection and storage of different recyclable waste such as paper, glass, plastic etc and establish the Waste Management Route and Provide recycler details.

For commercial building, waste separation bins to be provided at each floor in a convenient location and suitable strategy should be available to manage the waste collection centrally.

<p>Documentary Evidences</p>	<p><u>For 3-4(a)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirements for builder to provide and implement environmental friendly programmes to minimise energy use, water use and construction waste during construction stage • Details of the environmental friendly programmes implemented. <p><u>For 3-4(b)</u></p> <ul style="list-style-type: none"> • Main builder’s track records details in the adoption of sustainable, environmentally friendly, and considerate practices during construction. <p><u>For 3-4(c)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement to adopt QLASSIC with score > 70% where applicable. <p><u>For 3-4(d)</u></p> <ul style="list-style-type: none"> • A copy of CIDB IBS Score form. • Copy of structural drawings. <p><u>For 3-4(e)</u></p> <ul style="list-style-type: none"> • A certified true copy of the ISO 14000 certificate of developer, main contractor, M & E consultant, and architect where applicable. <p><u>For 3-4(f)</u></p> <ul style="list-style-type: none"> • A certified true copy of the certificate of GreenRE Accredited Professional / Green Mark Accredited Professional / MyCREST QP where applicable and a confirmation of their involvement performance in a project development. <p><u>For 3-4(g)</u></p> <ul style="list-style-type: none"> • A copy of the building users’ guide containing the details of the environmental friendly facilities and features within the building and their uses in achieving the intended environment performance during building operation. <p><u>For 3-4(h)</u></p> <ul style="list-style-type: none"> • A copy of the sustainable Operation Management Guideline (SOMG) containing the details of recommended minimum environmental practices for the building management organization <p><u>For 3-4(i)</u></p> <ul style="list-style-type: none"> • Plan layout showing the location of the recycling bins for collection and storage of different recyclable waste. • Product catalogue showing the size of recycle bins. • Details of the haulers/ recycler
<p>References</p>	<p>www.cidb.gov.my/index.php/my/bidang-utama/teknologi-dan-inovasi/ibs https://www.iso.org/iso-14001-environmental-management.html</p>

NRB 3-5 GREEN TRANSPORT

Objectives	Promote environmental friendly transport options and facilities to reduce pollution from individual car use.
Applicability	Generally applicable to all building developments.
Baseline Standard	-
Requirements	<p>3-5(a) 1 credit can be scored for design that provides good access (<800m walking distance) to public transport networks such as MRT/LRT stations or bus stops.</p> <p>3-5(b) 1 credit can be scored for provision of covered walkway to facilitate connectivity and the use of public transport.</p> <p>3-5(c) 1 credit can be scored for provision of infrastructure for electric charging stations to at least 10% of available parking spaces. Provision of minimum of isolator with 7kWp charger</p> <p>3-5(d) 1 credit can be scored for provision of electric vehicle charging stations and priority parking lots within the development. Provision of minimum of isolator with 7kWp charger</p> <p>Extent of coverage: Minimum 1 number priority parking bays for every 100 carpark lots. EV chargers – 1 for every 200 parking bays. (Cap at 3)</p> <p>3-5(e) Up to 1 credit can be scored for the provision of covered/sheltered bicycles parking lots with rack / locking bar.</p> <p>Extent of Coverage: Bicycles parking lot: Minimum 10 number and maximum 50 numbers of bicycle parking lot.</p> <p>Shower Facilities: Minimum 1 number for every 100 regular occupant and additional 1 for every 150 occupants. (Cap at 7)</p> <p>3-5 (f) Up to 3 credits for the building within 800m of 5 basic service, not limited to :</p> <ul style="list-style-type: none"> • Place of worship. • Bank • Pharmacy • Convenience grocery • Post Office • Laundry • Hardware Store • Supermarket • School • Library • Daycare Centre • Senior Care Facility • Beauty Salon • Hospital / Clinics • Community Centre • Park • Night Market
Documentary Evidences	<u>For 3-5(a)</u>

	<ul style="list-style-type: none"> • Site layout plan in the context of the surrounding area showing the location of the development site and walking path to the location of the MRT/LRT stations and bus stops not more than 800m. • Proposed bus-stop details drawing. <p><u>For 3-5(b)</u></p> <ul style="list-style-type: none"> • Site layout plan showing the connection of covered walkway from the development to the MRT/LRT stations or bus stops. • Extracts of the tender specification showing the requirement to provide covered walkway. <p><u>For 3-5(c)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement to provide electric charging stations. • Plan layout showing the location of the electric charging station in the development. • Calculation showing electric charging stations is at least 10% of available parking spaces. • Schematic showing the infrastructure of the EV charging station <p><u>For 3-5(d)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement to provide hybrid/electric vehicle refuelling/recharge stations and priority parking bays. • Plan layout showing the location of the electric vehicle charging station in the development. • Product technical information. <p><u>For 3-5(e)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement to provide covered/sheltered bicycles parking lots for the development and the total quantity of bicycles lots provided. • Plan layout showing the location of the covered/sheltered bicycle parking lots and rack/locking bar. <p><u>For 3-5(f)</u></p> <ul style="list-style-type: none"> • Submit the site plan showing the building location in connection to the above basic services, indicating the covered walkways, pedestrian access, and other connections like link bridges. • Proximity is determined by drawing a 0.8 km radius around the main building entrance on a site map.
References	-

NRB 3-6 STORMWATER MANAGEMENT

Objectives	Encourage the treatment of stormwater runoff through provision of infiltration or design features before discharge to public drains.
Applicability	Generally applicable to building developments.
Baseline Standard	-
Requirements	<p>Up to 3 credits can be scored for the provision of infiltration features or design features for new development and redevelopment whereby the post development stormwater peak discharge rate and quantity is lower than the pre-development peak discharge rate and quantity.</p> <p>Note: The treatment of stormwater runoff shall be through provision of infiltration or design features as recommended in Urban Storm Water Management (MSMA).</p>
Documentary Evidences	<ul style="list-style-type: none">• Urban Storm Water Management (MSMA) report showing reduction of post development stormwater peak discharge rate and quantity from exceeding pre-development peak discharge rate and quantity.• Drainage plan, schematic plan, location plan and details of water features such as the specification of filtration layer, transition layer and drainage layer, sub-soil drainage system, overflow arrangement, plant list etc.
References	MSMA – Urban Storm Water Management

NRB 3-7 REFRIGERANTS

Objectives	Reduce the potential damage to the ozone layer and the increase in global warming through the release of ozone depleting substances and greenhouse gases.
Applicability	Generally applicable to all building developments with air-conditioning systems.
Baseline Standard	-
Requirements	<p>3-7(a) 1 credit can be scored for the use of refrigerants with ozone depleting potential (ODP) of zero OR with global warming potential (GWP) of less than 100.</p> <p>3-7(b) 1 credit can be scored for the use of refrigerant leak detection system at critical areas of plant rooms containing chillers and other equipment with refrigerants.</p>
Documentary Evidences	<p><u>For 3-7(a)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement for all refrigerants to have ODP of zero OR GWP of less than 100. • Technical product information highlighted refrigerants to have ODP of zero OR GWP of less than 100. <p><u>For 3-7(b)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement to incorporate a refrigerant leak detection system. • Schematic drawing showing the location of the refrigerant leak detection system at critical areas of plant room containing chillers and others equipment with refrigerants. • Product technical information of the system.
References	-

(II) Other Green Requirements

Part 4 – Indoor Environment Quality

NRB 4-1 Thermal Comfort

NRB 4-2 Noise Level

NRB 4-3 Indoor Air Pollutants

NRB 4-4 Indoor Air Quality (IAQ) Management

NRB 4-5 High Frequency Ballasts

NRB 4-1 THERMAL COMFORT

Objectives	Recognise buildings that are designed with good thermal comfort.
Applicability	Generally applicable to all building developments with air-conditioning systems.
Baseline Standard	-
Requirements	<p>4-1(a) 1 credit can be scored if the air-conditioning systems are designed to Meet the minimum requirements of Section 4 through 7 of ASHRAE Standard 62.1, Ventilation for Acceptable Indoor Air Quality or any applicable local code, whichever is more stringent and requirement as follow:</p> <ul style="list-style-type: none"> • Indoor temperature between 23°C to 26°C • Relative Humidity between 50% to 70% <p>4-1 (b)Additional 1 credit will be awarded for provision of room temperature and humidity display.</p>
Documentary Evidences	<p><u>For 4-1 (a)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement to design the air-conditioning systems which would provide consistent indoor conditions for thermal comfort. • Design brief of the air-conditioning system highlighted room temperature and humidity requirement. <p><u>For 4-1 (b)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirements to provide the room temperature and humidity display. • Plan layout showing the location of the room temperature and humidity display.
References	-

NRB 4-2 NOISE LEVEL

Objectives	Recognise buildings that are designed to consider the potential noise levels within the dwelling units are maintained at an appropriate level. All building partitions to shall be in accordance with required STC ratings.								
Applicability	Generally applicable to building developments.								
Baseline Standard	ASTEM E413 or equivalent								
Requirements	<p>1 credit can be scored if the building is designed to achieve ambient internal noise level as specified:</p> <ul style="list-style-type: none"> • 55dB (6am – 10pm) L_{Aeq} • 45dB (10pm – 6 am) L_{Aeq} <p>This can be achieved by adhering to the following STC values for residential building partitions</p> <table border="1" data-bbox="446 801 1340 1131"> <thead> <tr> <th>Description</th> <th>Sound Transmission Class (STC)</th> </tr> </thead> <tbody> <tr> <td>Separation between functional spaces within dwelling units and in-between adjacent dwelling units.</td> <td>40 - 50</td> </tr> <tr> <td>Spaces between mechanical and equipment spaces and occupied spaces</td> <td>50 - 60</td> </tr> </tbody> </table> <p>For developments that are in close proximity to road with heavy traffic, flyover or highway, it is necessary to have a detailed analysis conducted by the acoustic consultant. Credits can only be scored if the recommendations from the acoustic consultant are implemented.</p>	Description	Sound Transmission Class (STC)	Separation between functional spaces within dwelling units and in-between adjacent dwelling units.	40 - 50	Spaces between mechanical and equipment spaces and occupied spaces	50 - 60		
Description	Sound Transmission Class (STC)								
Separation between functional spaces within dwelling units and in-between adjacent dwelling units.	40 - 50								
Spaces between mechanical and equipment spaces and occupied spaces	50 - 60								
Documentary Evidences	<ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement to design the occupied space with partitions meeting the required STC ratings as per table below: <table border="1" data-bbox="434 1444 1353 1758"> <thead> <tr> <th>Location</th> <th>STC rating of partitions</th> </tr> </thead> <tbody> <tr> <td>Between General Office Space</td> <td>40 - 50</td> </tr> <tr> <td>Hotel Rooms, Classrooms, Lecture Theaters, Meeting Rooms, Conference Rooms and spaces where confidential speech is required</td> <td>50 - 60</td> </tr> <tr> <td>Between Mechanical / Equipment spaces and occupied spaces</td> <td>50 - 60</td> </tr> </tbody> </table> <ul style="list-style-type: none"> • Architectural & structural plan layout, elevation and sectional plans showing types of wall system used, dimensions and size of all building and structural elements with STC ratings. OR • A report of detail analysis and recommendations from acoustic consultant (if applicable). 	Location	STC rating of partitions	Between General Office Space	40 - 50	Hotel Rooms, Classrooms, Lecture Theaters, Meeting Rooms, Conference Rooms and spaces where confidential speech is required	50 - 60	Between Mechanical / Equipment spaces and occupied spaces	50 - 60
Location	STC rating of partitions								
Between General Office Space	40 - 50								
Hotel Rooms, Classrooms, Lecture Theaters, Meeting Rooms, Conference Rooms and spaces where confidential speech is required	50 - 60								
Between Mechanical / Equipment spaces and occupied spaces	50 - 60								
References	-								

NRB 4-3 INDOOR AIR POLLUTANTS

Objectives	Minimise airborne contaminants, mainly from inside sources to promote a healthy indoor environment.																
Applicability	Generally applicable to all building developments.																
Baseline Standard	-																
Requirements	<p>4-3(a) 1 credit can be scored for the use of low volatile organic compounds (VOC) paints and coating certified under local/international certification body for at least 90% of the internal wall areas.</p> <p>4-3(b) 1 credit can be scored for the Use of Low VOC material for the adhesives and sealant certified under local/international certification body for composite wood products.</p> <p>.</p> <p>Use only zero-/low-VOC paints. All paints used in the interior of the building must be certified as containing zero VOC or less than the limits specified in Table 4 below.</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Paint applications</th> <th colspan="2">VOC limits (g at VOC per litre)</th> </tr> </thead> <tbody> <tr> <td rowspan="2">Interior Coatings</td> <td>Flat</td> <td>< 50</td> </tr> <tr> <td>Non Flat</td> <td><150</td> </tr> <tr> <td rowspan="2">Exterior Coatings</td> <td>Flat</td> <td>< 200</td> </tr> <tr> <td>Non Flat</td> <td><100</td> </tr> <tr> <td>Anti Corrosive</td> <td>Gloss/ semi gloss/flat</td> <td><250</td> </tr> </tbody> </table>	Paint applications	VOC limits (g at VOC per litre)		Interior Coatings	Flat	< 50	Non Flat	<150	Exterior Coatings	Flat	< 200	Non Flat	<100	Anti Corrosive	Gloss/ semi gloss/flat	<250
Paint applications	VOC limits (g at VOC per litre)																
Interior Coatings	Flat	< 50															
	Non Flat	<150															
Exterior Coatings	Flat	< 200															
	Non Flat	<100															
Anti Corrosive	Gloss/ semi gloss/flat	<250															
Documentary Evidences	<p><u>For 4-3(a)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement to use low VOC paints that are certified by approved local/ international certification body or equivalent. • Product catalogue. • Product certificate with validity expiry. <p><u>For 4-3(b)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement to use adhesive with low emission formaldehyde and are certified by approved local/ international certification body. • Product catalogue. • Product certificate with validity expiry. 																
References	-																

NRB 4-4 INDOOR AIR QUALITY (IAQ) MANAGEMENT

Objectives	Ensure building ventilation systems are designed and installed to provide acceptable IAQ under normal operating conditions.
Applicability	Applicable to air-conditioned buildings
Baseline Standard	-
Requirements	<p>4-4(a) 1 credit can be scored for the provision of filtration media and differential pressure monitoring equipment in Air Handling Unit (AHU)</p> <p>4-4(b) 1 credit can be scored by Implement effective IAQ management plan and Indoor Mould Prevention Guideline to ensure that building ventilation systems are clean and free from residuals left over from construction activities.</p>
Documentary Evidences	<p><u>For 4-4(a)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirements of the filter media and pressure monitoring equipment. • Technical product information which should include the minimum efficiency report value (MERV 8-12) parameters of the filter. • Technical product information of the differential pressure monitoring equipment <p><u>For 4-4(b)</u></p> <ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement for builder to provide and implement effective IAQ management and the details of the management plan. <p><u>For 4-4 (c)</u></p> <ul style="list-style-type: none"> • Floor plans displaying signage on smoking-restricted areas.
References	-

NRB 4-5 HIGH FREQUENCY BALLASTS

Objectives	Encourage the use of high frequency ballasts in fluorescent luminaries and LED low flicker LED drivers to improve the workplace lighting quality.
Applicability	Generally applicable to workplace such as offices, classrooms and training rooms and the like.
Baseline Standard	-
Requirements	<p>(a) 1 credit can be scored for the use of high frequency ballasts in the fluorescent luminaries if it is adopted in at least 90% of the applicable areas that are served by fluorescent luminaries.</p> <p style="text-align: center;">Or</p> <p>(b) 1 credit can be scored for the use of LED driver with output frequency < 200Hz and < 30% flicker for LED lighting in at least 90% of the applicable areas served by LED lighting.</p>
Documentary Evidences	<ul style="list-style-type: none"> • Extracts of the tender specification showing the requirement to have high frequency ballasts or LED driver. • A summary sheet listing all fluorescent and LED luminaries used for the developments. • Electrical lighting layout indicating all the fittings with high frequency ballasts or LED lighting. • Product catalogue specifying high frequency ballast for fluorescent luminaries. (if applicable) • Product catalogue specifying the LED driver with output frequency <200 Hz and <30% flicker for LED lighting. (if applicable) • Calculation showing at least 90% of the applicable areas that are served by high frequency ballast or LED lighting.
References	-

NRB 4-6 ACCESS TO VIEW FROM WORK AREA

Objectives	To promote higher levels of well-being, productivity, and human comfort.
Applicability	Generally applicable to workplace such as offices, classrooms, and training rooms and the like.
Baseline Standard	-
Requirements	Up to 1 credit for design \geq 60% of the occupied building spaces to have a direct line of sight through vision glazing and measured between 0.8 m and 2.3 m above the finished floor plan levels.
Documentary Evidences	<ul style="list-style-type: none">• Typical floor plans indicating and clearly marked with the identified occupied building spaces.• 2. Plan and sectional drawings clearly showing the line of sight drawn from occupied building spaces to the vision glazing perimeter.• 3. Design strategy of the interior layout that will be designed or recommended to maintain the view to the outside.
References	-

(II) Other Green Requirements

Part 5 – Other Green Features

NRB 5-1 GREEN FEATURES & INNOVATIONS

Objectives	Encourage the use of green features which are innovative and have positive environmental impact on water efficiency, environmental protection and indoor environmental quality of the buildings.
Applicability	Generally applicable to all building developments.
Baseline Standard	-
Requirements	<p>Up to 7 credits are awarded for the use of the following green features depending on their potential environmental benefits or reduced environmental impacts.</p> <p><u>Water efficiency</u></p> <ol style="list-style-type: none"> i. Use of self-cleaning façade system <ul style="list-style-type: none"> • 2 credits for more than 75% of the external walls. • 1 credit for more than 50% of the external walls. • 0.5 credit for at least 25% of the external walls. ii. Use of grey water recycling system <ul style="list-style-type: none"> • 2 credits for all blocks of the development. • 1 credit for at least one block of the development. iii. Recycling of AHU condensate <ul style="list-style-type: none"> • 1 credit for more than 75% of the AHU condensate • 0.5 credit for at least of 50% of the AHU condensate iv. 0.5 credit for the use of membrane filtration system to recycle water during construction. v. 0.5 credit for the use of non-chemical water treatment for cooling tower. <p><u>Environmental Protection</u></p> <ol style="list-style-type: none"> i. Provision of green roof and roof top garden <ul style="list-style-type: none"> • 1 credit for more than 50% of the roof areas • 0.5 credit for at least 25% of the roof areas ii. Provision of vertical greening <ul style="list-style-type: none"> • 1 credit for more than 50% of the external wall areas • 0.5 credit for at least 25% of the external wall areas iii. 1 credit for the provision of double refuse shuts for separating recyclable from non-recyclable waste iv. 0.5 credit for the use of non-chemical treatment system such as termite baiting system, anti-termite mesh. v. Up to 1 credit if at least 10% of the fine and/or coarse aggregate used for concrete production of structural application are replaced with recycled products from approved sources. 0.5 credit for each recycled product

	<p>used. Credits can only be scored if the extent of implementation covers at least 50% of all concrete structural elements of the superstructures (by volume).</p> <p><u>Indoor Air Quality</u></p> <ol style="list-style-type: none"> i. Use of Titanium Dioxide solutions to remove odour in toilets: <ul style="list-style-type: none"> • 1 credit for more than 50% of all toilets • 0.5 credit for at least 25% of all toilets ii. 1 credit for the use of pneumatic waste collection system. iii. 0.5 credit for the use of Ultraviolet light-C band (UV) emitters in <u>all</u> air handing units (AHUs) to improve indoor air quality. iv. Demonstrating the external view in the net lettable area (NLA). The submission must be showing the furniture plan layout. <ul style="list-style-type: none"> • 1 credit for more than 60% of the NLA having the external view • 2 credit for more than 75% of the NLA having the external view. <p><u>Others</u></p> <ol style="list-style-type: none"> i. Provision of landscape drainage and infiltration trenches: <ul style="list-style-type: none"> • 1 credit for at least 25% of the green areas • 0.5 credit for less than 25% of the green areas ii. Provision of system to recycle surface runoff from the vertical green wall and sky garden: <ul style="list-style-type: none"> • 1 credit for at least 25% of green areas • 0.5 credit for less than 25% green areas iii. 0.5 credit for the use of siphonic rainwater discharge system at roof. iv. 0.5 credit for the provision of eco-pond. v. 0.5 credit for the provision of carpark guidance system. <p>Note: For features that are not listed above, the QP is required to submit the details showing the positive environmental impacts, possible savings and benefits of the proposed features to GreenRE for assessment.</p>
Documentary Evidences	<ul style="list-style-type: none"> • Extracts of the tender specification showing the provision of the specific green features used and the extent of implementation where applicable. • Technical product information (including drawings and supporting documents) of the green features. • Quantified evidences on the potential environmental benefits that are features can bring to the development.
References	-

(II) Other Green Requirements

Part 6 – Carbon Emission of Development

NRB 6-1 CARBON EMISSION OF DEVELOPMENT

Objectives	To calculate the carbon emission resulted from the associated energy used during construction and operational phase of a development.															
Applicability	Generally applicable to all building development.															
Baseline Standard	-															
Requirements	<p>a) Recognise the carbon emission based on operational carbon footprint computation of the building comprising energy [B6] and water consumption [B7].</p> <p>b) Calculation of product stage embodied carbon based on following building materials [A1-A3]:</p> <ul style="list-style-type: none"> - concrete - steel - bricks - cement - steel and metal <p>c) Calculation of construction stage embodied carbon [A4-A5]</p> <p>d) Reduction from reference embodied carbon (for Ready Mix Concrete, Cement, Steel Reinforcement, Bricks, Steel & Metal)</p> <table border="1" data-bbox="376 1066 1422 1178"> <thead> <tr> <th colspan="5">EC (tCO₂eq/t)</th> </tr> <tr> <th>Ready Mixed Concrete</th> <th>Cement</th> <th>Steel Reinforcement</th> <th>Bricks</th> <th>Steel & Metal</th> </tr> </thead> <tbody> <tr> <td>0.199 - 0.219</td> <td>0.965 - 1.0857</td> <td>1.39 - 2.41</td> <td>0.249 - 0.279</td> <td>1.478 - 2.498</td> </tr> </tbody> </table>	EC (tCO ₂ eq/t)					Ready Mixed Concrete	Cement	Steel Reinforcement	Bricks	Steel & Metal	0.199 - 0.219	0.965 - 1.0857	1.39 - 2.41	0.249 - 0.279	1.478 - 2.498
EC (tCO ₂ eq/t)																
Ready Mixed Concrete	Cement	Steel Reinforcement	Bricks	Steel & Metal												
0.199 - 0.219	0.965 - 1.0857	1.39 - 2.41	0.249 - 0.279	1.478 - 2.498												
Documentary Evidences	<p><u>For 6-1 (a)</u></p> <ul style="list-style-type: none"> • Detail calculation for the estimated energy load for each component in the building e.g.: lighting, air-conditioning system, pump, receptacle load. • Details calculation for estimated water consumption of the building e.g.: water fittings, landscape, water features. • Technical product information on the energy efficient features and water efficient features used. • Summary tabulation of estimated total energy savings and total water savings of the development for the year. • Carbon emission calculation. <p><u>For 6-1 (b)</u></p> <ul style="list-style-type: none"> • Embodied carbon footprint calculation <p><u>For 6-1(c)</u></p> <ul style="list-style-type: none"> • Calculation of construction stage embodied carbon [A4-A5] <p><u>For 6-1 (d)</u></p> <ul style="list-style-type: none"> • Calculation showing the reduction from reference embodied carbon (for Ready Mix Concrete, Cement, Steel Reinforcement, Bricks, Steel & Metal) 															

References	-																																																																												
Worked Example 6-1	<p>Energy Consumption</p> <table border="1" data-bbox="459 241 1305 456"> <thead> <tr> <th>Type of usage</th> <th>Design (kWh/yr)</th> <th>Baseline (kWh/yr)</th> </tr> </thead> <tbody> <tr> <td>Lighting</td> <td>819,498</td> <td>1,151,575</td> </tr> <tr> <td>Air-Conditioning</td> <td>860,589</td> <td>1,406,899</td> </tr> <tr> <td>M/V System</td> <td>25,550</td> <td>25,550</td> </tr> <tr> <td>Total Energy Usage</td> <td>1,705,637</td> <td>2,584,024</td> </tr> </tbody> </table> <p>Water Consumption (Please refer GreenRE Water Calculator)</p> <table border="1" data-bbox="459 555 1305 730"> <thead> <tr> <th>Type of fixtures</th> <th>Design (m³/yr)</th> <th>Baseline (m³/yr)</th> </tr> </thead> <tbody> <tr> <td>Flow Fixtures</td> <td>2,402</td> <td>6,899</td> </tr> <tr> <td>Flush Fixtures</td> <td>5,366</td> <td>5,161</td> </tr> <tr> <td>Total Water Usage</td> <td>7,768</td> <td>12,060</td> </tr> </tbody> </table> <p>Carbon Footprint</p> <table border="1" data-bbox="435 797 1366 972"> <thead> <tr> <th>Type of usage</th> <th>Design kgCO₂e/yr</th> <th>Baseline kgCO₂e/yr</th> </tr> </thead> <tbody> <tr> <td>Energy</td> <td>1,226,619</td> <td>1,860,497</td> </tr> <tr> <td>Water</td> <td>155,344</td> <td>241,192</td> </tr> <tr> <td>Total Annual Carbon Footprint</td> <td>1,381,963</td> <td>2,101,689</td> </tr> </tbody> </table> <p>Energy CO₂ Emission Reduction (ktCO₂e/annum, based on electricity energy reduction only @ 1kWh =</p> <ul style="list-style-type: none"> • 0.694 kg CO₂- Peninsular • 0.699 kg CO₂- Sarawak • 0.536 kg CO₂- Sabah) <p>Water CO₂ Emission Reduction = 0.419 kg CO₂/m³</p> <p>Percentage savings = (2,101,689 - 1,381,963) / 2,101,689 = 34.25%</p> <p>Credits scored for 6-1 (a) = 1 credit</p> <p><u>Embodied carbon calculation</u></p> <table border="1" data-bbox="373 1482 1430 1850"> <thead> <tr> <th rowspan="2">No</th> <th rowspan="2">Material</th> <th rowspan="2">Description</th> <th colspan="2">tCO₂e</th> <th rowspan="2">Quantity</th> <th rowspan="2">Total tCO₂e</th> </tr> <tr> <th>Value</th> <th>Unit</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Concrete (G30)</td> <td>Slab</td> <td>0.309</td> <td>m³</td> <td>9876.19</td> <td>3051.74</td> </tr> <tr> <td>2</td> <td>Glass</td> <td>10mm of Glass (Single Glass excluding Frame)</td> <td>0.035</td> <td>m²</td> <td>4500.00</td> <td>157.50</td> </tr> <tr> <td>3</td> <td>Steel</td> <td>Rebar</td> <td>1.2</td> <td>kg</td> <td>5000.00</td> <td>6000.00</td> </tr> <tr> <td></td> <td>Total</td> <td></td> <td></td> <td></td> <td></td> <td>9209.24</td> </tr> </tbody> </table> <p>Credits scored for 6-1 (b) = 1 credit</p> <p>The project entitled = 2 credit</p>	Type of usage	Design (kWh/yr)	Baseline (kWh/yr)	Lighting	819,498	1,151,575	Air-Conditioning	860,589	1,406,899	M/V System	25,550	25,550	Total Energy Usage	1,705,637	2,584,024	Type of fixtures	Design (m ³ /yr)	Baseline (m ³ /yr)	Flow Fixtures	2,402	6,899	Flush Fixtures	5,366	5,161	Total Water Usage	7,768	12,060	Type of usage	Design kgCO ₂ e/yr	Baseline kgCO ₂ e/yr	Energy	1,226,619	1,860,497	Water	155,344	241,192	Total Annual Carbon Footprint	1,381,963	2,101,689	No	Material	Description	tCO ₂ e		Quantity	Total tCO ₂ e	Value	Unit	1	Concrete (G30)	Slab	0.309	m ³	9876.19	3051.74	2	Glass	10mm of Glass (Single Glass excluding Frame)	0.035	m ²	4500.00	157.50	3	Steel	Rebar	1.2	kg	5000.00	6000.00		Total					9209.24
Type of usage	Design (kWh/yr)	Baseline (kWh/yr)																																																																											
Lighting	819,498	1,151,575																																																																											
Air-Conditioning	860,589	1,406,899																																																																											
M/V System	25,550	25,550																																																																											
Total Energy Usage	1,705,637	2,584,024																																																																											
Type of fixtures	Design (m ³ /yr)	Baseline (m ³ /yr)																																																																											
Flow Fixtures	2,402	6,899																																																																											
Flush Fixtures	5,366	5,161																																																																											
Total Water Usage	7,768	12,060																																																																											
Type of usage	Design kgCO ₂ e/yr	Baseline kgCO ₂ e/yr																																																																											
Energy	1,226,619	1,860,497																																																																											
Water	155,344	241,192																																																																											
Total Annual Carbon Footprint	1,381,963	2,101,689																																																																											
No	Material	Description	tCO ₂ e		Quantity	Total tCO ₂ e																																																																							
			Value	Unit																																																																									
1	Concrete (G30)	Slab	0.309	m ³	9876.19	3051.74																																																																							
2	Glass	10mm of Glass (Single Glass excluding Frame)	0.035	m ²	4500.00	157.50																																																																							
3	Steel	Rebar	1.2	kg	5000.00	6000.00																																																																							
	Total					9209.24																																																																							

Reference Table				
EC (tCO ₂ eq/t)				
Ready Mixed Concrete	Cement	Steel Reinforcement	Bricks	Steel & Metal
0.199~0.219	0.965~1.0857	1.39~2.41	0.24 9-0.279	1.478~2.498

6. Documentation Requirements

All documents submitted for the REHDA GreenRE Assessment should be duly verified and signed by the Qualified Person (QP) and appropriate practitioners where applicable.

The documentation required for ventilation simulation and energy modelling should also be endorsed by the QP and appropriate practitioners as part of the documentary evidences for certification.

Table: Summary Checklist and the Corresponding Signatories for GreenRE Non-Residential Criteria

GreenRE Criteria	Required Signatories
Part 1 – Energy Efficiency	
NRB 1-1 Thermal Performance of Building Envelope - OTTV	PA
NRB 1-2 Air-Conditioning System	PE
NRB 1-3 Building Envelope – Design/ Thermal Parameters	PA
NRB 1-4 Natural Ventilation (exclude carparks)	PA
NRB 1-5 Daylighting	PA
NRB 1-6 Artificial Lighting	PE
NRB 1-7 Ventilation in Carparks	PE
NRB 1-8 Ventilation in Common Areas	PE
NRB 1-9 Lifts and Escalators	PE
NRB 1-10 Energy Efficient Practices & Features <ul style="list-style-type: none"> • Heat Recovery Devices • Motion Sensors/ Photo Sensors • Others 	PE PE S
NRB 1-11 Renewable Energy	S
Part 2 – Water Efficiency	
NRB 2-1 Water Efficient Fittings	PA
NRB 2-2 Water Usage and Leak Detection	PE
NRB 2-3 Irrigation System	PE
NRB 2-4 Water Consumption of Cooling Tower	PE
Part 3 – Environmental Protection	
NRB 3-1 Sustainable Construction	PE
NRB 3-2 Sustainable Products	PA
NRB 3-3 Greenery Provision	PE
NRB 3-4 Environmental Management Practice	PE
NRB 3-5 Green Transport	PA
NRB 3-6 Stormwater Management	PE
NRB 3-7 Refrigerants	PA
Part 4 – Indoor Environmental Quality	
NRB 4-1 Thermal Comfort	PE
NRB 4-2 Noise Level	S
NRB 4-3 Indoor Air Pollutants	PA
NRB 4-4 Indoor Air Quality (IAQ) Management	PA
NRB 4-5 High Frequency Ballasts	PE
Part 5 – Other Green Features	
NRB 5-1 Green Features & Innovations	S
Part 6 – Carbon Emission of Development	
NRB 6-1 Carbon Emission of Development	S

1. PA refers to Professional Architect
2. PE refers to Professional Engineer, Landscape Architect, Planner and Quantity Surveyor (QS)
3. S refers to Specialist which includes Facilitator, Project Manager, Facilities Manager, Energy or Sustainable consultant and Commissioning Specialist